

POST WAR BUNGALOW

CULVER CITY PROTOTYPE ACCESSORY DWELLING UNIT - PLAN 3

SHEET INDEX

| FOR CITY | STAFF ONLY | *FOR CITY STAFF ONLY | |
|-------------|---|-----------------------------|------------------|
| NITIAL WH | IEN SECTION HAS BEEN REVIEWED. STAFF INITIALS: | INITIAL WHEN SECTION HAS BE | EEN REVIEWED. |
| G-003 | TITLE SHEET - PLAN 3 | APPLICANT | |
| G-101 | GENERAL NOTES | | ADDRESS: |
| G-102 | GENERAL NOTES | | ADDRESS. |
| G-201 | CAL GREEN RESIDENTIAL REQUIREMENTS | | CONTACT: |
| G-202 | CAL GREEN RESIDENTIAL REQUIREMENTS | | |
| T24-300 | ENERGY COMPLIANCE - PLAN 3 | | EMAIL: PHONE: |
| T24-301 | ENERGY COMPLIANCE - PLAN 3 | | |
| T24-302 | ENERGY COMPLIANCE - PLAN 3 | | |
| 21002 | | ARCHITECT | RRM D |
| S-101 | ARCHITECTURAL SITE PLAN (EXAMPLE & INSTRUCTIONS) | (MODIFICATION | ADDRESS: 3765 S |
| | N N N | TO PROTOTYPE) | SAN LU |
| STRIKET | HROUGH SHEETS THAT ARE NOT APPLICABLE TO CHOSEN STYLE | TO FROTOFILE) | CONTACT: RANDA |
| \3-101 | FLOOR PLANS - PLAN 3 | | EMAIL: TWTUSS |
| \3-111 | MECHANICAL & ELECTRICAL PLANS - PLAN 3 | | PHONE: P:(805) |
| 3-121 | ROOF & REFLECTIVE CEILING PLANS - BUNGALOW - PLAN 3 | | PHONE:(003) |
| \3-122 | ROOF & REFLECTIVE CEILING PLANS - SPANISH - PLAN 3 | | |
| \3-123 | ROOF & REFLECTIVE CEILING PLANS -MODERN - PLAN 3 | CIVIL | |
| 43-201 | EXTERIOR ELEVATIONS - BUNGALOW- PLAN 3 | ENGINEER | ADDRESS: |
| 43-202 | EXTERIOR ELEVATIONS - SPANISH- PLAN 3 | | |
| 43-203 | EXTERIOR ELEVATIONS - MODERN- PLAN 3 | | CONTACT: |
| | | | EMAIL: |
| AD-901 | ARCHITECTURAL DETAILS - COMMON | | PHONE: |
| AD-902 | ARCHITECTURAL DETAIL - BUNGALOW | | |
| AD-903 | ARCHITECTURAL DETAILS - SPANISH | LANDSCAPE | |
| \D-904 | ARCHITECTURAL DETAILS - MODERN | ARCHITECT | ADDRESS: |
| 6-101 | SHEET INDEX, ABBREVIATION & SYMBOLS | | CONTACT: |
| S-102 | GENERAL NOTES | | EMAIL: |
| S-103 | GENERAL NOTES. SPECIAL INSPECTION & TESTS | | |
| S-201 | FOUNDATION PLAN & ROOF FRAMING PLAN - BUNGALOW | | PHONE: |
| S-211 | FOUNDATION PLAN & ROOF FRAMING PLAN - SPANISH | STRUCTURAL | RRM D |
| S-221 | FOUNDATION PLAN & ROOF FRAMING PLAN - MODERN | ENGINEER | address: 3765 S |
| S-301 | TYPICAL CONCRETE DETAILS | | SAN LU |
| S-311 | CONCRETE DETAILS | | CONTACT: JESSIC |
| S-401 | TYPICAL WOOD DETAILS | | EMAIL: jmmead |
| S-402 | TYPICAL WOOD DETAILS | | PHONE: P:(805) |
| S-403 | TYPICAL WOOD DETAILS | | |
| S-421 | ROOF FRAMING DETAILS | | |
| S-422 | ROOF FRAMING DETAILS | | |
| Grand total | : 34 | UTILITIES | |
| | | UIILIIEJ | |

GENERAL RELEASE AND AGREEMENT TO HOLD HARMLESS CLAUSE

THESE PERMIT READY ACCESSORY DWELLING UNIT CONSTRUCTION I (CONSTRUCTION DOCUMENTS) ARE PROVIDED BY THE CITY OF CULV COURTESY. THE USER ASSUMES ALL RISKS INVOLVED WITH USE OF CONSTRUCTION PLANS. BY USING OR IN ANY WAY RELYING UPON TH CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE, INDE AND HOLD HARMLESS THE CITY OF CULVER CITY, ITS ELECTED OFFICIALS, BOARDS AND COMMISSIONS, OFFICERS, AGENTS, VOLUNTEERS AND EMPLOYEES, RRM DESIGN GROUP, AND THE ARCHITECT OR ENGINEER WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM AND AGAINST ANY AND ALL CLAIMS (INCLUDING, WITHOUT LIMITATION, CLAIMS FOR BODILY INJURY, DEATH, OR DAMAGE TO PROPERTY), DEMANDS, OBLIGATIONS, DAMAGES, ACTIONS, CAUSES OF ACTION, LIABILITIES, SUITS, LOSSES, JUDGMENTS, FINES, PENALTIES, COSTS AND EXPENSES (INCLUDING, WITHOUT LIMITATION, ATTORNEYS' FEES, DISBURSEMENTS, AND COURT COSTS) OF EVERY KIND AND NATURE WHATSOEVER, WHICH MAY ARISE FROM OR IN ANY WAY RELATE TO THE USE OF THESE CONSTRUCTION DOCUMENTS. THE USE OF THESE CONSTRUCTION DOCUMENTS DOES NOT ELIMINATE OR REDUCE THE USER'S RESPONSIBILITY TO VERIFY ANY AND ALL SITE SPECIFIC INFORMATION.

PROJECT DIRECTORY

| | *FOR CITY STAFF ONLY | | |
|------------------------|---|------------|--|
| _S: | INITIAL WHEN SECTION HAS BEEN | REVIEWED. | STAFF INITIALS: |
| | APPLICANT | | |
| | | ADDRESS: | |
| | | | |
| | | | |
| | | | |
| | | | |
| | ARCHITECT | | RM DESIGN GROUP |
| | | | 65 S Higuera St, Suite 102 |
| N STYLE | TO PROTOTYPE) | | N LUIS OBISPO, CA 9340 NDALL RUSSOM |
| | | | russom@rrmdesign.com |
| 0 | | | (805) 543-1794 |
| 3 | | | |
| | CIVIL | | |
| | ENGINEER | ADDRESS: | |
| | | | |
| | | CONTACT: | |
| | | EMAIL: | |
| | | PHONE: | |
| | LANDSCAPE | | |
| | ARCHITECT | ADDRESS: | |
| | | | |
| | | | |
| | | PHONE: | |
| | STRUCTURAL | | |
| | ENGINEER | | M DESIGN GROUP 65 S Higuera St, Suite 102 |
| | LITOILLER | | N LUIS OBISPO, CA 9340 |
| | | | SSICA MEADOWS, SE |
| | | - | meadows@rrmdesign.com |
| | | PHONE: P:(| 805) 543-1794 |
| | | | |
| | | | |
| | UTILITIES | | |
| | | | |
| | | | |
| | | | GOLDEN STATE WATER |
| | ELECTRICAL SERVICE GAS SERVICE | | PACIFIC GAS & SOUTHERN CALIF |
| | TELEPHONE SERVICE | | SOOTHERN CALI |
| | GARBAGE SERVICE | | CULVE |
| | CABLE SERVICE | | |
| | | | |
| | SUPPORTING | | |
| N DOCUMENTS | | | |
| VER CITY AS A | | | |
| F THESE THESE | STRUCTURAL CALCULATIONS PREPARED BY: | | RRM DES |
| HESE EMNIFY, DEFEND | DATE PREPARED: | | |
| ICIALS BOARDS | | | |

| STRUCTURAL CALCULATIONS PREPARED BY: DATE PREPARED: JOB NUMBER: | RRM |
|--|------|
| ENERGY COMPLIANCE PREPARED BY: DATE PREPARED: JOB NUMBER: | ТІМС |
| TRUSS CALCULATIONS | |

PREPARED BY:

JOB NUMBER:

DATE PREPARED:

DATE



SPANISH REVIVAL



STREET ADDRESS (TO BE PROVIDED BY OWNE CITY OF CULVER CITY, CA

PROJECT INFORMATION

| *FOR CITY STAFF ONLY | | | |
|---|------------|--------------------------------|--|
| INITIAL WHEN SECTION HAS BEEN RE | VIEWED. | STAFF INITIALS: | |
| PROJECT SCOPE: 1. CONSTRUCTION OF A DWELLING UNIT WITH 2. ALL SITE WORK WITHIN 3. ALL THE WORK SHOW | ONE BEDROO | M AND ONE BATH(S) RTY LINE. | |
| SITE INFORMATION: APN: ZONING: LOT SIZE: | (CONFIRM | WITH THE CITY OF C | |
| FLOOR AREA LIMIT MAXIMUM FAL: PROPOSED FAL: | (CONFIRM | WITH THE CITY OF O | |
| ADU FLOOR AREA LIMIT | (CONFIRM | I WITH THE CITY OF | CULVER CIT |
| SETBACKS FRONT: REAR: SIDES: | (CONFIRM | | CULVER CITY PROPOSE |
| BUILDING INFORMATION: NUMBER OF STORIES: OCCUPANCY GROUP: CONSTRUCTION TYPE: MAX. HEIGHT PROPOSED: BUNGALOW MODERN SPANISH ROOF RATING: | | | R- V 13" - (13' - { 13' - { |
| BUILDING ARE | EAS | | |

ER COMPANY & ELECTRIC FORNIA GAS ER CITY EPO

AREAS - PLAN 3

PLAN 3 FLOOR

CONDITIONED

GARAGE

EXISTING RESIDENTIAL BUILDING FLOOR AREA

SIGN GROUP

OTHY CARSTAIRS 08/28/2023 23-08289

PROJECT CHECKLIST

| *FOR CITY STAFF ONLY | |
|---|-----------------|
| INITIAL WHEN SECTION HAS BEEN REVIEWED. | STAFF INITIALS: |

DRY STYLE SELECTION

- POST WAR BUNGALOW
- *STRIKE THROUGH SHEETS A1-122,123 & A1-202,203 & AD-903,904 SPANISH REVIVAL
- *STRIKE THROUGH SHEETS A1-121,123 & A1-201,203 & AD-902,904 MODERN
- *STRIKE THROUGH SHEETS A1-121,122 & A1-201,202 & AD-902,903

WINDOW MATERIAL

- VINYL
- FIBERGLASS
- WOOD
- ALUMINUM CLAD WOOD

COLORS ROOFING (PER MANUF.)

- ROOFING
- _____ _____ SIDING
- WINDOWS
- ENTRY DOOR

WASTE WATER

SEWER

806 SF

ELECTRICAL PANEL (SEE SITE PLAN FOR LOCATION):

| | NEW ELECTRICAL MAIN PANEL WITH 225 AMP MINIMUM |
|----------|---|
| | BUSBAR RATING |
| OPTION 2 | A NEW ELECTRICAL SUBPANEL CONNECTS TO THE ELECTRICAL |
| | MAIN PANEL OF THE PRIMARY HOME WITH A 225 AMP MINIMUM |
| | BUSBAR RATING. A SEPARATE ELECTRICAL PERMIT SHALL BE |
| | PULLED FOR THE ELECTRICAL MAIN PANEL OF THE PRIMARY |
| | HOME, ELECTRICAL LOAD CALCULATIONS IS REQUIRED. |

DEFERRED SUBMITTALS

- 1. FIRE SPRINKLER (YES / NO) (SEPARATE PLAN CHECK / PERMIT)
- 2. SOLAR PV (-KW) (SEPARATE PLAN CHECK / PERMIT)

GENERAL NOTES

1. A SEISMIC SHUTOFF VALVE IS REQUIRED FOR NEW CONSTRUCTION AND EXISTING CONSTRUCTION WITH PERMIT OVER \$10,000. 1208.13.1 CCMC 15.02.130

MODERN

*FOR CITY STAFF ONLY

INITIAL WHEN SECTION HAS BEEN REVIEWED.

STAFF INITIALS

VERY HIGH FIRE SEVERITY ZONE

IF THE PROPERTY THAT WILL CONTAIN THE ADU IS IN THE VERY HIGH FIRE HAZARD SEVERITY ZONE SEE NOTES BELOW

- AN ADU IN THE VERY HIGH FIRE SEVERITY ZONE SHALL COMPLY WI CHAPTER 7A OF THE CURRENT CALIFORNIA BUILDING CODE STRUCTURES IN THE VERY HIGH FIRE HAZARD SEVERITY ZONE SHAI ROVIDE & MAINTAIN A FUEL MODIFICATION ZONE. FUEL MODIFICATION ONES: THE APPLICANT SHALL PROVIDE & MAINTAIN FIRE/FUEL BREAKS TO THE SATISFACTION OF THE LOCAL FIRE DEPARTMENT. FIRE/FUEL BREAKS SHALL BE SHOWN ON THE GRADING, MAP, AND BUILDING PLANS USE FIRE RATED ASSEMBLY ALTERNATIVE AS SHOWN IN ROOF FRAM
- DETAILS AS REFERENCED ON PLANS. 4. USE RATED WALL ASSEMBLIES (34/AD-902, 24/AD-10\902) 5. THE INTENSITY OF FUELS MANAGEMENT MAY VARY WITHIN THE 100-FOOT PERIMETER OF THE STRUCTURE, WITH MORE INTENSE FUEL REDUCTIONS BEING USED BETWEEN 5 AND 30 FEET AROUND THE
- STRUCTURE, AND AN EMBER-RESISTANT ZONE BEING REQUIRED WITHIN 5 FEET OF THE STRUCTURE ACCORDING TO GOVERNMENT CODE 51182. THE EMBER RESISTANT ZONE FOR THE ADU SHALL BE SEPARATE FROM THE 5-FOOT EMBER RESISTANCE ZONE OF THE EXISTING STRUCTURE. THE DEFENSIBLE SPACE PLAN AND VEGETATION MANAGEMENT SHALL BE REVIEWED BY THE CITY CULVER FIRE DEPARTMENT. 6. VERIFY COMPLIANCE WITH YOUR INSURANCE UNDERWRITER PRIOR TO

FIRE SPRINKLERS

CONSTRUCTION OF THE ADU.

DOES THE PRIMARY RESIDNENCE HAVE NFPA 13D SPRINKLERS?

🗆 NO

🗌 YES

REQUIRED AT PROPOSED ADU:

- **NO** (NOT REQUIRED IF THE PRIMARY RESIDENCE IS UNSPRINKLERED
- **YES** (REQUIRED IF THE PRIMARY RESIDENCE IS SPRINKLERED

FIRE SPRINKLERS NOTES

- 1. FIRE SPRINKLER SHOP DRAWINGS & CALCULATIONS SHALL BE SUBMITTED TO COMMUNITY RISK REDUCTION & APPROVAL BY FIRE DEPT. PRIOR TO INSTALLATION
- 2. IF FIRE SPRINKLERS ARE REQUIRED AT PROPOSED ADU THEN THE FOLLOWING NOTES APPLY.

CALLING FOR ROOF SHEATHING INSPECTION.

- 3. DEFERRED SUBMITTAL: OBTAIN FIRE SPRINKLER PERMIT PRIOR TO
- 4. AUTOMATIC FIRE SPRINKLER SYSTEM AN AUTOMATIC FIRE SPRINKLER SYSTEM SHALL BE INSTALLED AS PER NFPA 13D THE MOST CURRENT EDITION. DETAILED SPRINKLER PLANS SHALL BE SUBMITTED TO THE FIRE PREVENTION BUREAU AND APPROVED PRIOR TO INSTALLATION. PLANS AND INSTALLATION MUST BE BY A C16 LICENSED SPRINKLER CONTRACTOR.
- 5. LOCATION AND SIZE OF WATER SERVICE UNDERGROUND SHALL BE INSTALLED AS SHOWN ON APPROVED FIRE SPRINKLER PLANS.
- 6. A FIRE UNDERGROUND FLUSH CERTIFICATION SHALL BE REQUIRED AT FINAL INSPECTION.
- 7. A HYDRO INSPECTION OF THE FIRE SPRINKLER SYSTEM IS REQUIRED PRIOR TO FRAME INSPECTION.

THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARC TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DON UNDER A SEPARATE PERMIT ONCE THE BUILDING PERM FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTIO KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDE YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

S Ζ \mathcal{O} Ζ 4 **N A** <u>ш</u> О « ш > z Ш CUL STAN CULVI Т \mathcal{S} Ш DATE SET 01/03/2024 ^oUBLIC SHEET G-003

| | WEATHER BARRIERS. a. NOT FEWER THAN ONE-LAYER WATER-RESISTIVE BARRIER SHALL BE |
|----------|---|
| | APPLIED OVER STUDS OR SHEATHING OF ALL EXTERIOR WALLS CONTINUOUS FROM TOP OF WALS AND TERMINATED AT PENETRATIONS |
| | AND BUILDING APPENDAGES WITH FLASHING. MINIMUM NO. 15 FELT COMPLYING WITH ASTM D226, TYPE 1. |
| | b. PROVIDE (2) LAYERS OF GRADE D PAPER OR EQUAL WHEN PLASTER IS INSTALLED OVER WOOD BASED SHEATHING. (2022 CRC R703.7.3) |
| 2. | SURFACES. (2022 CMC 504.3) |
| 3. | CLOTHES DRYER MOISTURE EXHAUST DUCTS SHALL TERMINATE OUTSIDE THE BUILDING AND HAVE A BACK-DRAFT DAMPER. EXHAUST DUCT IS |
| | LIMITED TO 14'-0" W/ TWO ELBOWS. THIS SHALL BE REDUCED 2'-0" FOR EVERY ELBOW IN EXCESS OF TWO. MIN. DIA. 4", SMOOTH, METAL DUCT.(2022 |
| 4. | CMC 504.4) ALL MANUFACTURED EQUIPMENT SHALL BE INSTALLED AS PER |
| | MANUFACTURER'S SPECIFICATION AND DIMENSIONS VERIFIED WITH INSTALLATION REQUIREMENTS. ALL MANUFACTURER'S INSTALLATION |
| 5. | INSTRUCTIONS SHOULD BE ON SITE FOR INSPECTIONS. SHOWERS AND TUB-SHOWER COMBINATIONS: CONTROL VALVES MUST BE |
| 6. | PRESSURE BALANCED OR THERMOSTATIC MIXING VALVES. (2022 CPC 417.0.) WET-ROOM GLAZING. PROVIDE TEMPERED GLAZING IN DOORS AND |
| 0. | ENCLOSURES FOR SHOWERS, BATHTUBS, SAUNAS, STEAM ROOMS, HOT TUBS & SIMILAR USES WHERE THE BOTTOM EXPOSED EDGE IS LESS THAN |
| 7. | 60-INCHES ABOVE A STANDING SURFACE. (2022 CRC R308.4.5) |
| 7. 8. | CALGREEN SEC. 4.507, ENVIRONMENTAL COMFORT. |
| 0. | a. CLEARANCES: 24" MIN. FRONT, 30" MIN COMPARTMENT WIDTH. b. PROVIDE A MIN 3 SF WINDOW, 1/2 OF WHICH SHALL BE OPENABLE OR AN |
| | EXHAUST FAN 50 CFM FOR INTERMITTENT OR 20 CFM FOR CONTINUOUS. |
| | DIRECT VENT TO OUTSIDE WITH BACKDRAFT DAMPER. (2022 CRC R303.3) c. NEW WATER CLOSETS AND ASSOCIATED FLUSHOMETER VALVES, IF ANY |
| | SHALL USE NO MORE THAN 1.28 GALLONS PER FLUSH AND SHALL MEET PERFORMANCE STANDARDS ESTABLISHED BY THE AMERICAN SOCIETY |
| | OF MECHANICAL ENGINEERS STANDARD A112.19.2. H & S CODE, SECTION 17921.3(B). |
| 9. | BATH ACCESSORIES: PROVIDE MINIMUM 1 TOILET PAPER HOLDER AND 1 TOWEL BAR PER BATHROOM. PROVIDE NECESSARY BLOCKNG FOR TOILET |
| 10. | PAPER HOLDER AND TOWEL BARS. WHOLE-BUILDING MECHANICAL VENTILATION SYSTEM PER ASHRAE |
| | STANDARD 62.2. AT TIME OF BUILDING PERMIT APPLICATION, APPLICANT TO PROVIDE THE FOLLOWING INFORMATION: |
| | a. CALCULATIONS FOR REQUIRED VENTING RATES. b. CALCULATION ADJUSTMENTS FOR INTERMITTENT SYSTEMS IF |
| | APPLICABLE. c. DUCT DIAMETER AND MAXIMUM DUCT LENGTH PER ASHRAE 62.2 TABLE |
| | d. TYPE OF SYSTEM USED AND PROVIDE COMPLETED CF-6R-MECH-05 |
| | FORM. e. FANS SHALL BE A MAXIMUM OF 1 SONE. |
| 11 | f. FANS SHALL BE PROVIDED A COVER OF R-4.2 WHEN OFF. ATTIC ACCESS: |
| | a. WHERE REQUIRED, PROVIDE 30" MIN. HEADROOM IN THE ATTIC SPACE (2022 CRC R807.1) |
| | b. BUILDINGS WITH COMBUSTIBLE CEILING OR ROOF CONSTRUCTION SHALL HAVE AN ATTIC ACCESS OPENING TO ATTIC AREAS THAT EXCEED |
| | 30 SQUARE FEET AND HAVE A VERTICAL HEIGHT OF 30-INCHES OR GREATER. THE VERTICAL HEIGHT SHALL BE MEASURED FROM TOP OF |
| | THE CEILING FRAMING MEMBERS TO THE UNDERSIDE OF THE ROOF FRAMING MEMBERS. |
| | c. THE ROUGH-FRAMED OPENING SHALL NOT BE LESS THAN 22" X 30" AND |
| | SHALL BE LOCATED NOT OVER 20 FEET FROM THE EQUIPMENT. (2022 CRC R807.1) |
| | d. IN ATTIC, PROVIDE LIGHT AND SWITCH, AND ALL NECESSARY ELECTRICAL. PROVIDE UNOBSTRUCTED PASSAGEWAY 24" WIDE OF |
| | SOLID CONTINUOUS FLOORING FROM ACCESS TO EQUIPMENT AND IT'S CONTROLS. ALSO PROVIDE UNOBSTRUCTED WORK SPACE IN FRONT OF |
| | EQUIPMENT 30" DEPTH MINIMUM. PROVIDE COMBUSTION AIR AND CONDENSATE LINE TO OUTSIDE OR AN APPROVED DRAIN FOR OPTIONAL |
| | AIR CONDITIONING. e. PROVIDE A 120V RECEPTACLE AND A LIGHT NEAR THE EQUIPMENT WITH |
| 12 | LIGHT SWITCH LOCATED AT THE ATTIC ACCESS. BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH |
| | INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NONABSORBENT SURFACE. SUCH WALL SURFACES SHALL |
| | EXTEND TO A HEIGHT OF NOT LESS THAN 6 FEET ABOVE THE FLOOR PER 2022 CRC, SECTION R307.2. |
| | |
| | |
| | |
| | |
| | |
| | |
| S | |
| S | ITE NOTES |
| S | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORW WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT TO EXISTING |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORN WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE FACILITY AS NECESSARY. EXISTING PUBLIC IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE REPAIRED OR REPLACED. EXISTING DAMAGED PUBLIC IMPROVEMENTS WITHIN THE PROJECT LIMITS SHALL BE REPAIRED OR |
| | CALL BEFORE YOU DIGI CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATERNS SHALL NOT BE ALTERED IN A MANNER WHICH WOULD CAUSE STORM WATER TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE FACILITY AS NECESSARY. EXISTING PUBLIC IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE REPAIRED OR REPLACED. EXISTING DAMAGED PUBLIC IMPROVEMENTS WITHIN THE PROJECT LIMITS SHALL BE REPAIRED OR REPLACED EVEN IF THE DAMAGE OCCURRED PRIOR TO THE START OF CONSTRUCTION. |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE FACILITY AS NECESSARY. EXISTING PUBLIC IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE REPAIRED OR REPLACED. EXISTING DAMAGED PUBLIC IMPROVEMENTS WITHIN THE PROJECT LIMITS SHALL BE REPAIRED OR REPLACED EVEN IF THE DAMAGE OCCURRED PRIOR TO THE START OF CONSTRUCTION. EROSION AND SEDIMENT CONTROL FACILITIES SHALL BE INSTALLED PRIOR TO OCTOBER 1 AND SHALL BE MAINTAINED DAILY UNTIL APRIL 30. THESE |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE FACILITY AS NECESSARY. EXISTING PUBLIC IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE REPAIRED OR REPLACED. EXISTING DAMAGED PUBLIC IMPROVEMENTS WITHIN THE PROJECT LIMITS SHALL BE REPAIRED OR REPLACED EVEN IF THE DAMAGE OCCURRED PRIOR TO THE START OF CONSTRUCTION. EROSION AND SEDIMENT CONTROL FACILITIES SHALL BE INSTALLED PRIOR TO OCTOBER 1 AND SHALL BE MAINTAINED DAILY UNTIL APRIL 30. THESE FACILITIES SHALL CONTROL AND CONTAIN EROSION-CAUSED SILT DEPOSITS AND PROVIDE FOR THE SAFE DISCHARGE OF SILT-FREE STORM WATERS INTO |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE FACILITY AS NECESSARY. EXISTING PUBLIC IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE REPAIRED OR REPLACED. EXISTING DAMAGED PUBLIC IMPROVEMENTS WITHIN THE PROJECT LIMITS SHALL BE REPAIRED OR REPLACED EVEN IF THE DAMAGE OCCURRED PRIOR TO THE START OF CONSTRUCTION. EROSION AND SEDIMENT CONTROL FACILITIES SHALL BE INSTALLED PRIOR TO OCTOBER 1 AND SHALL BE MAINTAINED DAILY UNTIL APRIL 30. THESE FACILITIES SHALL CONTROL AND CONTAIN EROSION-CAUSED SILT DEPOSITS AND PROVIDE FOR THE SAFE DISCHARGE OF SILT-FREE STORM WATERS INTO EXISTING STORM DRAIN FACILITIES. EROSION AND SEDIMENT CONTROL SUPPLIES MUST BE KEPT ON-SITE DURING THE DRY SEASON AND EMPLOYED, |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GXTERIOR THARDSCAPE WITHIN 10-FEET OF A BUILDING SHOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERVISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORN WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE FACILITY AS NECESSARY. EXISTING PUBLIC IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE REPAIRED OR REPLACED. EXISTING DAMAGED OR REPLACED EVEN IF THE DAMAGE OCCURRED PRIOR TO THE START OF CONSTRUCTION. EROSION AND SEDIMENT CONTROL FACILITIES SHALL BE INSTALLED PRIOR TO OCTOBER 1 AND SHALL BE MAINTAINED DAILY UNTIL APRIL 30. THESE FACILITIES SHALL CONTROL FACILITIES SHALL BE INSTALLED PRIOR TO OCTOBER 1 AND SHALL BE MAINTAINED DAILY UNTIL APRIL 30. THESE FACILITIES SHALL CONTROL FACILITIES SHALL BE INSTALLED PRIOR TO OCTOBER 1 AND SHALL BE MAINTAINED DAILY UNTIL APRIL 30. THESE FACILITIES SHALL CONTROL |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SUOPE. ALL GADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TO WARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIRED OR REPLACED CONTRACTOR SHALL BE REPAIRED OR REPLACED. EXISTING DAMAGED PUBLIC IMPROVEMENTS WITHIN THE PROJECT LIMITS SHALL BE REPAIRED OR REPLACED EVEN IF THE DAMAGE OCCURRED PRIOR TO THE START OF CONSTRUCTION. EROSION AND SEDIMENT CONTROL FACILITIES SHALL BE INSTALLED PRIOR TO OCTOBER 1 AND SHALL BE MAINTAINED DAILY UNTIL APRIL 30. THESE FACILITY AS NECESSARY. EXISTING STORM DRAIN FACILITIES. EROSION AND SEDIMENT CONTROL SON AND SEDIMENT CONTROL SON AND SEDIMENT CONTROL SUPPLIES SHALL BE KEPT ON AND GUING RAIN PRACTICES FOR THE SAME DERY PROPRIATE BEST MANAGEMENT PRACTICES FOR THE FOLLOWING SITE MANAGEMENT CATEGORIES MUATERS INTO EXISTING STORM DRAIN FACILITIES. EROSION AND BEIM |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF AN BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF A BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PATTERNS SHALL NOT BE ALTERED IN A MANNER TO CAUSE DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE SYSTEM AND CONNECT TO EXISTING DRAINAGE FACILITY AS NECESSARY. EXISTING PUBLIC IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE PAIRED OR REPLACED. EXISTING DAMAGED PUBLIC IMPROVEMENTS WITHIN THE PROJECT LIMITS SHALL BE REPAIRED OR REPLACED EVEN IF THE DAMAGED OCCURRED PRIOR TO THE START OF CONTROL FACILITIES SHALL CONTROL AND CONTAIN EROSION-CAUSED SILT DEPOSITS AND PROVIDE FOR THE SAFE DISCHARGE OF SILT-FREE STORM WATERS INTO EXISTING DRAIN FACILITIES. EROSION AND SEDIMENT CONTROL SUPPLIES MUST BE KEPT ON-SITE DURING THE DRY SEASON AND EMPLOYED |
| | CALL BEFORE YOU DIG! CONTACT UNDERGROUND SERVICE ALERT (USA) AT 1-800-227-2600 AT LEAST 2 WORKING DAYS BEFORE EXCAVATING. UNLESS OTHERWISE NOTED ON THE PLANS, FINISHED GROUND SURFACES SHALL BE GRADED TO DRAIN THE FINISHED SITE PROPERLY WITHIN 10-FEET OF ANY BUILDING FOUNDATION WITH A SLOPE OF 5% AWAY FROM ANY BUILDING OR STRUCTURE. ALL EXTERIOR HARDSCAPE WITHIN 10-FEET OF ANY BUILDING FOUNDATION SHALL BE INSTALLED WITH A 2% MINIMUM SLOPE AWAY FROM ANY BUILDING OR STRUCTURE. DRAINAGE SWALES SHALL BE A 1.5% MINIMUM SLOPE. ALL GRADED SLOPES SHALL HAVE A MAXIMUM SLOPE OF 3H TO 1V (33%), UNLESS SHOWN OTHERWISE ON THE PLANS. LOT GRADING SHALL CONFORM AT THE PROPERTY LINES AND SHALL NOT SLOPE TOWARD PROPERTY LINES IN A MANNER WHICH WOULD CAUSE STORM WATER TO FLOW ONTO NEIGHBORING PROPERTY. HISTORIC DRAINAGE PROBLEMS TO NEIGHBORING PROPERTY. NEW RAINWATER DOWNSPOUTS SHALL BE DISCONNECTED AND DIRECT RUNOFF TO A LANDSCAPED AREA. DOWNSPOUTS MAY BE CONNECTED TO A POP-UP DRAINAGE EMITTER IN THE LANDSCAPED AREA OR MAY DRAIN TO SPLASH BLOCKS OR COBBLESTONES THAT DIRECT WATER AWAY FROM THE BUILDING. CONTRACTOR TO FIELD VERIFY EXISTING DRAINAGE. IF THE EXISTING DRAINAGE SYSTEM IS DAMAGED DURING EXCAVATION, CONTRACTOR SHALL REPAIR AND/OR REROUTE DRAINAGE SYSTEM AND CONNECT O EXISTING DRAINAGE FACILITY AS NECESSARY. EXISTING PUBLIC IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE REPAIRED OR REPLACED. EXISTING DRAINAGE FACILITY AS NECESSARY. EXISTING PUBLIC IMPROVEMENTS THAT ARE DAMAGED BY THE PROJECT CONSTRUCTION SHALL BE REPAIRED OR REPLACED EXISTING DRAINAGE FACILITIES SHALL CONTROL FACILITIES SHALL BE INSTALLED PRIOR TO COTOBER 1 AND SHALL BE MAINTAINED DAILY UNTIL APRIL 30. THESE FACILITIES SHALL CONTROL AND CONTAIN EROSION-CAUSED SILT DEPOSITS AND PROVIDE FOR THE SAFED SICHARGE OF SILT-FREE STORM WATERS INTO EXISTING STORM DRAIN FACILITIES. EROSION AND SEDIMENT CONTROL SUPPLIES MUST BE KEPT ON-SITE DURING RAIN EVENTS. SEASONALLY APPROPRIATE BEST MANAGEMENT PRACTICES FOR THE FOLLOWING SITE MANAGEMENT FRACTI |

ELECTRICAL NOTES

- 1. CONFORM WITH CURRENT CEC, NFPA, MFR'S, AND LOCAL REQUIREMENTS. ELECTRICAL SYSTEM GROUND TO BE PROVIDED PER NEC ARTICLE 250-81. . ALL MATERIALS TO BE U.L. LABELED.
- 4. METER IS NOT REQUIRED. IF IT IS PROVIDED FOR ADU. MAIN PANEL IS REQUIRED FOR ADU WITH MINIMUM OF 225 AMP BUS-BAR. IF MAIN PANEL IS NOT PROVIDED FOR ADU, ELECTRICAL PERMIT SHALL BE PULLED FOR THE PRIMARY RESIDENCE WITH ELECTRICAL LOAD CALCULATIONS. 5. IF PROVIDED, ELECTRICAL SUB PANEL: FLUSH MOUNT, 30" CLEARANCE. 100
- 6. CONDUCTORS: TW. THW. COPPER. MINIMUM 14 AT LIGHTING, 12 AT OTHER CIRCUITS.
- 7. ALL LUMINARIES SHALL COMPLY WITH 2022 CENC SECTION 150.0 (K) AND TABLE 150.0-A AS REFERENCED IN ENERGY NOTES, LUMINAIRE **REQUIREMENTS SHEET G-101.**
- 8. ALL ELECTRICAL OUTLETS INSTALLED IN BATHROOMS, GARAGES, LAUNDRY AREAS, BASEMENTS, CRAWL SPACES, OUTDOORS, KITCHEN COUNTERS, AND AT WET BAR SINKS SHALL HAVE GROUND-FAULT CIRCUIT-INTERRUPTER PROTECTION IN COMPLIANCE WITH NEC Art. 210-8, CONSISTING OF 125 VOLT, SINGLE-PHASE, 15- AND 20- AMPERE RECEPTACLES.
- 9. ALL BATHROOM RECEPTACLE OUTLETS SHALL BE SUPPLIED BY A MINIMUM OF ONE 120-VOLT, 20-AMPERE BRANCH CIRCUIT. SUCH CIRCUITS SHALL HAVE NO OTHER OUTLETS. THIS DEDICATED CIRCUIT MAY SERVE MORE THAN ONE BATHROOM. (2022 CEC 210.11(C))
- 10. THERMOSTAT SHALL BE A PROGRAMMABLE TYPE, HONEYWELL TH8320 OR EQUAL
- 11. CEILING-SUSPENDED (PADDLE) FANS SHALL BE SUPPORTED INDEPENDENTLY OF AN OUTLET BOX OR BY LISTED OUTLET BOX OR OUTLET BOX SYSTEMS IDENTIFIED FOR THE USE AND INSTALLED IN ACCORDANCE WITH 2022 CEC 314.27(C) (2022 CEC 422.18).
- 12. ALL LUMINARIES, LAMPHOLDERS, AND RETROFIT KITS SHALL BE LISTED (2022 CEC 410.6). 13. ALL 120-VOLT, SINGLE PHASE 15- AND 20- AMPERE BRANCH CIRCUITS
- SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, LIVING ROOMS, DINING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE, INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT. (2022 CEC 210-12(A)).
- 14. ALL NON-LOCKING TYPE 125-VOLT, 15 AND 20 AMPERE RECEPTACLES IN A DWELLING UNIT SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES. EXCEPTIONS: (1) RECEPTACLES MORE THAN 5'6" ABOVE THE FLOOR, (2) RECEPTACLES PART OF A LUMINAIRE OR APPLIANCE, (3) A SINGLE RECEPTACLE OR A DUPLEX RECEPTACLE FOR TWO APPLIANCES THAT ARE NOT EASILY MOVED AND LOCATED WITHIN DEDICATED SPACE AND ARE CHORD-AND-PLUG CONNECTED AS PER CEC 400.10, AND (4) NON-GROUNDING RECEPTACLES USED FOR REPLACEMNETS AS PERMITTED IN CEC 406.4(D)(2)(A).
- 15. HIGH EFFICACY LUMINAIRES OTHER THAN OUTDOOR HID LIGHTING CONTAIN ONLY ONLY HIGH EFFICACY LAMPS AS OUTLINED IN TABLE 150-C OF THE RESIDENTIAL ENERGY CODE AND NOT CONTAIN A MEDIUM SCREW BASE SOCKET
- 16. BALLAST FOR LAMPS 13 WATTS OR GREATER SHALL BE ELECTRONIC AND HAVE AN OUTPUT FREQUENCY NO LESS THAT 20 kHz.
- 17. SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL SMOKE DETECTORS SHALL BE INTERCONNECTEED. ALL SMOKE DETECTORS SHALL MAINTAIN A MINIMUM 3 FOOT CLEARANCE TO HVAC SUPPLY OR RETURN AIR REGISTERS
- 18. CARBON MONOXIDE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL CARBON MONOXIDE ALARAMS SHALL BE INTERCONNECTEED.
- 19. EXHAUST FANS WILL BE CONTROLLED BY A HUMIDISTAT PER THE GREEN BUILDING STANDARDS CODE SECTION 4.506. EXHAUST FANS MUST BE SWITCHED SEPARATELY FROM LIGHTS (2022 CEnC 150.0(k)2G).
- 20. IN ADDITION TO THE NUMBER OF BRANCH CIRCUTS REQUIRED BY OTHER PARTS OF THE CODE, TWO OR MORE 20-AMPERE SMALL-APPLIANCE BRANCH CIRCUTS SHALL BE PROVIDED FOR ALL RECEPTACLE OUTLETS IN THE KITCHEN, PANTRY, BREAKFAST ROOM, DINING ROOM, OR SIMILAR AREA PER 2022 CEC, ARTICLE 210.11 (C)(1). THE CIRCUTS SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 210.52(B).
- 21. IN ADDITION TO THE NUMBER OF BRANCH CIRCUTS REQUIRED BY OTHER PARTS OF THE CODE AT LEAST ONE ADDITIONAL 20-AMPERE BRANCH CIRCUT SHALL BE PROVIDED TO SUPPLY THE LAUNDRY RECEPTACLE OUTLET(S) REQUIRED BY 2022 CEC, ARTICLE 210.52 (F). THIS CIRCUT SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 201.11(C)(2).

ENERGY NOTES

1. THE BUILDER MUST PROVIDE NEW HOMEWONERS WITH A LUMINAIRE SCHEDULE THAT INCLUDES A LIST OF INSTALLED LAMPS AND LUMINARIES.

LUMINAIRE REQUIREMENTS (2022 CEnC 150.0(k)1). A. LUMINAIRE EFFICACY. ALL INSTALLED LUMINAIRES SHALL MEET THE

- **REQUIREMENTS IN TABLE 150.0-A. EXCEPT:** INTEGRATED DEVICE LIGHTING. LIGHTING INTEGRAL TO EXHAUST FANS, KITCHEN RANGE HOODS, BATH VANITY MIRRORS AND GARAGE DOOR OPENERS. NAVIGATION LIGHTING: SUCH AS NIGHT LIGHTS, STEP LIGHTS, AND PATH LIGHTS LESS THAN 5 WATTS. CABINET LIGHTING: LIGHTING INTERNAL TO DRAWERS, CABINETRY AND LINEN CLOSETS WITH AN EFFICACY OF 45 LUMENS PER WATT OR GREATER.
- THE FOLLOWING ARE HIGH-EFFICACY LIGHT SOURCES PER TABLE 150.0-A: THE FOLLOWING LIGHT SOURCES, OTHER THAN THOSE INSTALLED IN CEILING RECESSED DOWNLIGHT LUMINAIRES, ARE NOT REQUIRED TO
- COMPLY WITH REFERENCE JOINT APPENDIX JA8: 1. LED LIGHT SOURCES INSTALLED OUTDOORS. INSEPARABLE SOLID STATE LIGHTING (SSL) LUMINAIRES CONTAINING COLORED LIGHT SOURCES THAT ARE INSTALLED TO PROVIDE
- DECORATIVE LIGHTING. 3. PIN-BASED LINEAR FLUORESCENT OR COMPACT FLUORESCENT LIGHT
- SOURCES USING ELECTRONIC BALLASTS. 4. HIGH INTENSITY DISCHARGE (HID) LIGHT SOURCES INCLUDING PULSE
- START METAL HALIDE AND HIGH PRESSURE SODIUM LIGHT SOURCES. LUMINAIRES WITH HARDWIRED HIGH FREQUENCY GENERATOR AND
- INDUCTION LAMP. 6. CEILING FAN LIGHT KITS SUBJECT TO FEDERAL APPLIANCE REGULATIONS.
- THE FOLLOWING LIGHT SOURCES ARE ONLY CONSIDERED TO BE HIGH EFFICACY IF THEY ARE CERTIFIED TO THE COMMISSION AS HIGH EFFICACY LIGHT SOURCES IN ACCORDANCE WITH REFERENCE JOINT APPENDIX JA8
- AND MARKED AS REQUIRED BY JA8: 1. ALL LIGHT SOURCES INSTALLED IN CEILING RECESSED DOWNLIGHT LUMINAIRES. NOTE THAT CEILING RECESSED DOWNLIGHT LUMINAIRES SHALL NOT HAVE SCREW BASES REGARDLESS OF LAMP TYPE AS
- DESCRIBED IN SECTION 150.0(K)1C. 2. ANY LIGHT SOURCE NOT OTHERWISE LISTED.
- B. SCREW-BASED LUMINAIRES. SCREW-BASED LUMINAIRES SHALL CONTAIN LAMPS THAT COMPLY WITH REFERENCE JOINT APPENDIX JA8. C. RECESSED DOWNLIGHT LUMINAIRES IN CEILINGS. LUMINAIRES RECESSED INTO CEILINGS SHALL MEET ALL OF THE FOLLOWING REQUIREMENTS:
- SHALL NOT CONTAIN SCREW BASE LAMP SOCKETS; AND HAVE A LABEL THAT CERTIFIES THE LUMINAIRE IS AIRTIGHT WITH AIR LEAKAGE LESS THAN 2.0 CFM AT 75 PASCALS WHEN TESTED IN ACCORDANCE WITH ASTM E283. AN EXHAUST FAN HOUSING WITH
- INTEGRAL LIGHT SHALL NOT BE REQUIRED TO BE CERTIFIED AIRTIGHT; AND BE SEALED WITH A GASKET OR CAULK BETWEEN THE LUMINAIRE HOUSING AND CEILING, AND HAVE ALL AIR LEAK PATHS BETWEEN CONDITIONED AND UNCONDITIONED SPACES SEALED WITH A GASKET OR CAULK. OR BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS TO MAINTAIN
- AIRTIGHTNESS BETWEEN THE LUMINAIRE HOUSING AND CEILING; AND 4. MEET THE CLEARANCE AND INSTALLATION REQUIREMENTS OF CALIFORNIA ELECTRICAL CODE SECTION 410.116 FOR RECESSED LUMINAIRES. **EXCEPT:** RECESSED LUMINAIRES MARKED FOR USE IN FIRE-RATED INSTALLATIONS EXTRUDED INTO CEILING SPACE AND RECESSED LUMINAIRES INSTALLED IN NONINSULATED CEILINGS.

ENERGY NOTES CONTINUED

- D. LIGHT SOURCES IN ENCLOSED OR RECESSED LUMINAIRES. LAMPS AND OTHER SEPARABLE LIGHT SOURCES THAT ARE NOT COMPLIANT WITH THE JA8 ELEVATED TEMPERATURE REQUIREMENTS, INCLUDING MARKING REQUIREMENTS, SHALL NOT BE INSTALLED IN ENCLOSED OR RECESSED
- LUMINAIRES E. BLANK ELECTRICAL BOXES. THE NUMBER OF ELECTRICAL BOXES THAT ARE MORE THAN 5 FEET ABOVE THE FINISHED FLOOR AND DO NOT CONTAIN A LUMINAIRE OR OTHER DEVICE SHALL BE NO GREATER THAN THE NUMBER OF BEDROOMS. THESE ELECTRICAL BOXES MUST BE SERVED BY A DIMMER, VACANCY SENSOR CONTROL, LOW VOLTAGE WIRING OR FAN SPEED CONTROL
- INDOOR LIGHTING CONTROLS (2022 CEnC 150.0(k)2). A. LIGHTING SHALL HAVE READILY ACCESSIBLE WALL-MOUNTED CONTROLS THAT ALLOW THE LIGHTING TO BE MANUALLY TURNED ON AND OFF. A. **EXCEPT:** CEILING FANS MAY PROVIDE CONTROL OF INTEGRATED
- LIGHTING VIA A REMOTE CONTROL. B. NO CONTROLS SHALL BYPASS A DIMMER, OCCUPANT SENSOR OR VACANCY SENSOR FUNCTION WHERE THAT DIMMER OR SENSOR HAS BEEN INSTALLED TO COMPLY WITH SECTION 150.0(K).
- C. LIGHTING CONTROLS SHALL COMPLY WITH THE APPLICABLE
- **REQUIREMENTS OF SECTION 110.9.** D. AN ENERGY MANAGEMENT CONTROL SYSTEM (EMCS) OR A MULTISCENE PROGRAMMABLE CONTROL MAY BE USED TO COMPLY WITH DIMMING, OCCUPANCY AND LIGHTING CONTROL REQUIREMENTS IN SECTION 150.0(K)2 IF IT PROVIDES THE FUNCTIONALITY OF THE SPECIFIED CONTROLS IN ACCORDANCE WITH SECTION 110.9, AND THE PHYSICAL CONTROLS SPECIFIED IN SECTION 150.0(K)2A.
- E. AUTOMATIC-OFF CONTROLS. 1. IN BATHROOMS, GARAGES, LAUNDRY ROOMS, UTILITY ROOMS AND WALK-IN CLOSETS, AT LEAST ONE INSTALLED LUMINAIRE SHALL BE CONTROLLED BY AN OCCUPANCY OR VACANCY SENSOR PROVIDING AUTOMATIC-OFF FUNCTIONALITY.
- 2. FOR LIGHTING INTERNAL TO DRAWERS AND CABINETRY WITH OPAQUE FRONTS OR DOORS, CONTROLS THAT TURN THE LIGHT OFF WHEN THE DRAWER OR DOOR IS CLOSED SHALL BE PROVIDED.
- DIMMING CONTROLS, LIGHTING IN HABITABLE SPACES, INCLUDING BUT NOT LIMITED TO LIVING ROOMS, DINING ROOMS, KITCHENS AND BEDROOMS, SHALL HAVE READILY ACCESSIBLE WALL-MOUNTED DIMMING CONTROLS THAT ALLOW THE LIGHTING TO BE MANUALLY ADJUSTED UP AND DOWN. FORWARD PHASE CUT DIMMERS CONTROLLING LED LIGHT SOURCES IN THESE SPACES SHALL COMPLY WITH NEMA SSL 7A. **EXCEPT:** CEILING FANS MAY PROVIDE CONTROL OF INTEGRATED LIGHTING VIA A REMOTE CONTROL. LUMINAIRES CONNECTED TO A CIRCUIT WITH CONTROLLED LIGHTING POWER LESS THAN 20 WATTS OR CONTROLLED BY AN OCCUPANCY OR VACANCY SENSOR PROVIDING AUTOMATIC-OFF FUNCTIONALITY. NAVIGATION LIGHTING SUCH AS NIGHT LIGHTS, STEP LIGHTS, AND PATH LIGHTS LESS THAN 5 WATTS, AND LIGHTING INTERNAL TO DRAWERS AND CABINETRY WITH OPAQUE FRONTS OR DOORS OR WITH
- AUTOMATIC-OFF CONTROLS. G. INDEPENDENT CONTROLS. INTEGRATED LIGHTING OF EXHAUST FANS SHALL BE CONTROLLED INDEPENDENTLY FROM THE FANS. THE FOLLOWING SHALL BE CONTROLLED SEPARATELY FROM CEILING-INSTALLED LIGHTING SUCH THAT ONE CAN BE TURNED ON WITHOUT TURNING ON THE OTHER: UNDERCABINET LIGHTING, UNDERSHELF LIGHTING, INTERIOR LIGHTING

OF DISPLAY CABINETS, AND SWITCHED OUTLETS. RESIDENTIAL OUTDOOR LIGHTING (2022 CEnC 150.0(k)3). IN ADDITION TO MEETING THE REQUIREMENTS OF SECTION 150.0(K)1A, LUMINAIRES PROVIDING RESIDENTIAL OUTDOOR LIGHTING SHALL MEET THE FOLLOWING REQUIREMENTS, AS APPLICABLE:

- A. FOR SINGLE-FAMILY RESIDENTIAL BUILDINGS, OUTDOOR LIGHTING PERMANENTLY MOUNTED TO A RESIDENTIAL BUILDING OR TO OTHER BUILDINGS ON THE SAME LOT SHALL MEET THE REQUIREMENT IN ITEM I AND THE REQUIREMENTS IN EITHER ITEM II OR ITEM III:
 - CONTROLLED BY A MANUAL ON AND OFF CONTROL SWITCH THAT PERMITS THE AUTOMATIC ACTIONS OF ITEMS II OR III BELOW; & ii. CONTROLLED BY A PHOTOCELL AND EITHER A MOTION SENSOR OR AN AUTOMATIC TIME SWITCH CONTROL; OR iii. CONTROLLED BY AN ASTRONOMICAL TIME CLOCK CONTROL.
 - NOTE: CONTROLS THAT OVERRIDE TO ON SHALL NOT BE ALLOWED UNLESS THE OVERRIDE AUTOMATICALLY RETURNS THE AUTOMATIC CONTROL TO ITS NORMAL OPERATION WITHIN 6 HOURS. AN ENERGY MANAGEMENT CONTROL SYSTEM THAT PROVIDES THE SPECIFIED LIGHTING CONTROL FUNCTIONALITY AND COMPLIES WITH AL REQUIREMENTS APPLICABLE TO THE SPECIFIED CONTROLS MAY BE USED TO MEET THESE REQUIREMENTS.
- 1. ALL JOINTS, PENETRATIONS AND OTHER OPENINGS IN THE BUILDING ENVELOPE THAT ARE POTENTIAL SOURCES OF AIR LEAKAGE SHALL BE CAULKED. GASKETED. WEATHER-STRIPPED OR OTHERWISE SEALED TO
- LIMIT INFILTRATION AND EXFILTRATION (2022 CEnC 110.7). 2. ATTIC ACCESS DOORS SHALL HAVE PERMANENTLY ATTACHED INSULATION USING ADHESIVE OR MECHANICAL FASTENERS. THE ATTIC ACCESS SHALL BE GASKETED TO PREVENT AIR LEAKAGE (2022 CEnC 150.0(a)3)

ADDTIONAL NOTES PER AGING IN PLACE REQUIREMENTS:

- 1. ELECTRICAL RECEPTABLE OUTLET, SWITCH AND CONTROLS (INCLUDING CONTROLS FOR HEATING, VENTILATION AND AIR CONDITIONING) INTENDED TO BE USED BY OCCUPANTS SHALL BE LOCATED NO MORE THAN 48" MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15" MEASURED FROM THE BOTTOM OF THE OUTLET BOX ABOVE THE FINISH FLOOR (PER CRC R327.1.2).
- 2. DOORBELL BUTTONS OR CONTROLS, WHEN INSTALLED, SHALL NOT EXCEED 48" ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY. WHERE DOORBELL BUTTONS INTEGRATED WITH OTHER FEATURES ARE REQUIRED TO BE INSTALLED ABOVE 48" MEASURED FROM THE EXTERIOR FLOOR OR LANDING, A STANDARD DOORBELL BUTTON OR CONTROL SHALL ALSO BE PROVIDED AT A HEIGHT NOT EXCEEDING 48" ABOVE EXTERIOR FLOOR OR LANDING. MEASURED FROM THE TOP OF THE DOORBELL BUTTON OR CONTROL (PER CRC R327.1.4)

ENERGY STORAGE READINESS

- **ENERGY STORAGE SYSTEM (ESS) REQUIREMENTS:**
- IN SINGLE-FAMILY RESIDENTIAL BUILDINGS THAT INCLUDE ONE OR TWO DWELLINGS, EACH DWELLING UNIT SHALL BE PROVIDED WITH DEDICATED RACEWAYS, DESIGNATED BRANCH CIRCUITS AND ISOLATION DEVICES FOR ENERGY STORAGE SYSTEMS AS SPECIFIED IN CALIFORNIA ENERGY CODE SECTION 150.0(S). ADDITIONALLY, THE PANELBOARDS SHALL BE PROVIDED WITH THE MINIMUM BUSBAR RATING AS SPECIFIED IN CALIFORNIA ENERGY CODE SECTION 150.0(S). (2022 CEC SECTION 706.10)
- CALIFORNIA ENERGY CODE SECTION 150.0(S) AT LEAST ONE OF THE FOLLOWING SHALL BE PROVIDED:
- A. ESS READY INTERCONNECTION EQUIPMENT WITH A MINIMUM BACKED-UP CAPACITY OF 60 AMPS AND A MINIMUM OF FOUR ESS-SUPPLIED BRANCH CIRCUITS, OR
- B. A DEDICATED RACEWAY FROM THE MAIN SERVICE TO A PANELBOARD (SUBPANEL) THAT SUPPLIES THE BRANCH CIRCUITS IN SECTION 150.0(S)(2). ALL BRANCH CIRCUITS ARE PERMITTED TO BE SUPPLIED BY THE MAIN SERVICE PANEL PRIOR TO THE INSTALLATION OF AN ESS. THE TRADE SIZE OF THE RACEWAY SHALL BE NOT LESS THAN 1 INCH. THE PANELBOARD THAT SUPPLIES THE BRANCH CIRCUITS (SUBPANEL) MUST BE LABELED "SUBPANEL SHALL INCLUDE ALL BACKEDUP LOAD CIRCUITS."
- A MINIMUM OF FOUR BRANCH CIRCUITS SHALL BE IDENTIFIED AND HAVE THEIR SOURCE OF SUPPLY COLLOCATED AT A SINGLE PANELBOARD SUITABLE TO BE SUPPLIED BY THE ESS. AT LEAST ONE CIRCUIT SHALL SUPPLY THE REFRIGERATOR, ONE LIGHTING CIRCUIT SHALL BE LOCATED NEAR THE PRIMARY EGRESS AND AT LEAST ONE CIRCUIT SHALL SUPPLY A SLEEPING ROOM RECEPTACLE OUTLET.
- THE MAIN PANELBOARD SHALL HAVE A MINIMUM BUSBAR RATING OF 225 AMPS. SUFFICIENT SPACE SHALL BE RESERVED TO ALLOW FUTURE INSTALLATION OF A SYSTEM ISOLATION EQUIPMENT/TRANSFER SWITCH WITHIN 3 FEET OF THE MAIN PANELBOARD. RACEWAYS SHALL BE INSTALLED BETWEEN THE PANELBOARD AND THE SYSTEM ISOLATION EQUIPMENT/TRANSFER SWITCH LOCATION TO ALLOW THE CONNECTION OF BACKUP POWER SOURCE.

PLUMBING NOTES

- 1. CONFORM WITH CURRENT CPC AND LOCAL REQUIREMENTS.
- PIPING 2. DOMESTIC WATER (WITHIN BUILDING): COPPER OR PEX PIPE OR APPROVED
- EQUAL 3. AIR CHAMBERS: 12" LONG CAPPED NIPPLE AT END OF EACH BRANCH TO EACH FIXTURE.
- 4. DIELECTRIC UNIONS "F.P.C.O." REQUIREMENT AT ALL DISSIMILAR MATERIAL CONNECTIONS.
- 5. WHEN "OPTIONAL" SOFT-WATER LOOP INTALLED, PROVIDE WITH 2 GATE VALVES. 6. WATER SERVICE PIPE SHALL BE PER CIVIL PLANS OR AS REQUIRED BY THE
- JURISDICTION. 7. WATER METER: PER WATER DISTRICT (REFER SIZE W/ FIRE SPRINKLER PLANS IF APPLICABLE)
- 8. SHOWER HEADS AND FAUCETS: FLOW RATES PER 2022 CGBSC SECTION 4 303 9. WATER HEATER (REFER TO BUILDING ENERGY ANALYSIS REPORT):
- A. ALL DOMESTIC HOT WATER PIPING SHALL BE INSULATED. (2022 CPC 609.12.1)
 - 1. PIPES UP TO 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN DIAMETER OF PIPE. (2022 CPC 609.12.2) 2. PIPES GREATER THAN 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN 2 INCHES. (2022 CPC 609.12.2)
 - EXCEPTIONS: 1. PIPING THAT PENETRATES FRAMING MEMBERS SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION FOR THE DISTANCE OF
- THE FRAMING PENETRATION. (2022 CPC 609.12.2) 2. HOT WATER PIPING BETWEEN THE FIXTURE CONTROL VALVE OR SUPPLY STOP AND THE FIXTURE OR APPLIANCE SHALL NOT BE REQUIRED TO BE INSULATED. (2022 CPC 609.12.2)
- B. PROVIDE A TEMPERATURE AND PRESSURE RELIEF VALVE WITH A FULL SIZE DRAIN OF GALVANIZED STEEL OR HARD DRAWN COPPER TO THE OUTSIDE OF THE BUILDING WITH THE END OF THE PIPE PROTRUDING 6" MINIMUM @ 2' MAX. ABOVE GRADE POINTING DOWNWARD TO THE TERMINATION - UNTHREADED.
- C. COMBUSTION AIR PER MANUFACTURE REQUIREMENTS.
- D. CLEARANCES PER MANUFACTURE REQUIREMENTS. 10. PLUMBING INSULATION PER 2022 CENC 150.0 (J) AND CBC 609.11
- A. DOMESTIC HOT WATER PIPING SHALL BE INSULATED.
- B. HOT WATER PIPE INSULATION SHALL HAVE A MINIMUM WALL THICKNESS OF NOT LESS THAN THE DIAMETER OF THE PIPE FOR A PIPE UP TO 2 INCHES (50 MM) IN DIAMETER. INSULATION WALL THICKNESS SHALL BE NOT LESS THAN 2 INCHES (51 MM) FOR A PIPE OF 2 INCHES (50 MM) OR MORE IN DIAMETER.
- 1. PIPING THAT PENETRATES FRAMING MEMBERS SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION FOR THE DISTANCE OF THE FRAMING PENETRATION. 2. HOT WATER PIPING BETWEEN THE FIXTURE CONTROL VALVE OR
- SUPPLY STOP AND THE FIXTURE OR APPLIANCE SHALL NOT BE REQUIRED TO BE INSULATED.
- C. SERVICE WATER HEATING SYSTEMS PIPING TO INCLUDE. **1.** RECIRCULATING SYSTEM PIPING, INCLUDING THE SUPPLY AND RETURN PIPING TO THE WATER HEATER.
- 2. THE FIRST 8 FEET OF HOT AND COLD OUTLET PIPING, INCLUDING PIPING BETWEEN A STORAGE TANK AND A HEAT TRAP, FOR A NON-RECIRCULATING STORAGE SYSTEM. 3. PIPES THAT ARE EXTERNALLY HEATED.
- SHALL BE INSULATED AS FOLLOWS: UP TO 1" PIPE DIAMETER TO HAVE 1.0 MIN THICKNESS OR R7/7
- RATING PER CENC TABLE 120.3A EXCEPTIONS:
- 1. FACTORY-INSTALLED PIPING WITHIN SPACE-CONDITIONING EQUIPMENT CERTIFIED UNDER SECTION 110.1 OR 110.2.
- 2. PIPING THAT PENETRATES FRAMING MEMBERS SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION FOR THE DISTANCE OF THE FRAMING PENETRATION, METAL PIPING THAT ENETRATES METAL FRAMING SHALL USE GROMMETS, PLUGS, WRAPPING OR OTHER INSULATING MATERIAL TO ASSURE THAT NO CONTACT IS MADE WITH THE METAL FRAMING.
- 3. PIPING INSTALLED IN INTERIOR OR EXTERIOR WALLS SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION IF ALL OF THE REQUIREMENTS ARE MET FOR COMPLIANCE WITH QUALITY INSULATION INSTALLATION (QII) AS SPECIFIED IN THE **REFERENCE RESIDENTIAL APPENDIX RA3.5.**
- **4.** PIPING SURROUNDED WITH A MINIMUM OF 1 INCH OF WALL INSULATION, 2 INCHES OF CRAWLSPACE INSULATION, OR 4 INCHES OF ATTIC INSULATION SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION

11. INSULATION PROTECTION. PIPE INSULATION SHALL BE PROTECTED FROM DAMAGE DUE TO SUNLIGHT, MOISTURE, EQUIPMENT MAINTENANCE AND WIND. PROTECTION SHALL, AT MINIMUM, INCLUDE THE FOLLOWING (2022 CEC SECTION 120.3(B)):

- A. PIPE INSULATION EXPOSED TO WEATHER SHALL BE PROTECTED BY A COVER SUITABLE FOR OUTDOOR SERVICE. THE COVER SHALL BE WATER RETARDANT AND PROVIDES SHIELDING FROM SOLAR RADIATION THAT CAN CAUSE DEGRADATION OF THE MATERIAL. ADHESIVE TAPE SHALL NOT BE USED TO PROVIDE THIS PROTECTION
- B. PIPE INSULATION COVERING CHILLED WATER PIPING AND REFRIGERANT SUCTION PIPING LOCATED OUTSIDE THE CONDITIONED SPACE SHALL INCLUDE, OR BE PROTECTED BY, A CLASS I OR CLASS II VAPOR RETARDER. ALL PENETRATIONS AND JOINTS SHALL BE SEALED. C. PIPE INSULATION BURIED BELOW GRADE MUST BE INSTALLED IN A WATER PROOF AND NONCRUSHABLE CASING OR SLEEVE.
- 12. PIPE INSULATION: REFER TO TITLE 24 MANDATORY MEASURES "SPACE CONDITIONING, WATER HEATING & PLUMBING SYSTEM MEASURES"
- 13. STRAPS AND HANGERS: PROVIDE AS NECESSARY TO INSURE A STABLE INSTALLATION. SEE TITLE-24 FOR WATER HEATER REQUIREMENTS.
- 14. ALL HOSE BIBS SHALL HAVE APPROVED BACK FLOW PREVENTION DEVICES
- **15.** PLUMBING FIXTURES (WATER CLOSETS) AND FITTINGS (FAUCETS AND SHOWERHEADS) SHALL MEET THE STANDARDS REFERENCED IN CALGREEN TABLE 4.303.3
- **16.** WATER HEATER SHALL BE PROVIDED WITH A TEMPERATURE AND PRESSURE RELIEF VALVE. PER [2022 CPC 505.2] THE RELIEF VALVE SHALL BE PROVIDED WITH A DRAIN LINE WHICH EXTENDS FROM THE VALVES TO THE
- OUTSIDE OF THE BUILDING. PER [2022 608.5 CPC] **17.** PER 2022 CPC 603.5.7 OUTLETS WITH HOSE ATTATCHMENTS. POTABLE WATER OUTLETS WITH HOSE ATTACHMENTS, OTHER THAN WATER HEATER DRAINS, BOILER DRAINS, AND CLOTHES WASHER CONNECTIONS, SHALL BE PROTECTED BY A NONREMOVABLE HOSE BIBB TYPE BACKFLOW PREVENTER, A NONREMOVABLE HOSE BIBB TYPE VACUMM BREAKER, OR BY AN ATMOSPHERE VACUUM BREAKER INSTALLED NOT LESS THAN 6 INCHES ABOVE THE HIGHEST POINT OF USAGE LOCATED ON THE DISCHARGE SIDE OF THE LAST VALVE. IN CLIMATES WHERE FREEZING TEMPERATURES OCCUR, A LISTED SELF DRAINING FROST-PROOF HOSE BIBB WITH AN INTEGRAL BACKFLOW PREVENTER OR VACUUM BREAKER SHALL BE USED.

- APPLICABLE CODES AND STANDARDS:
- 1.1. 2022 CALIFORNIA BUILDING CODE AND ITS APPENDICES AND STANDARDS. 1.2. 2022 CALIFORNIA PLUMBING CODE AND ITS APPENDICES AND STANDARDS.
- 1.3. 2022 CALIFORNIA MECHANICAL CODE AND ITS APPENDICES AND STANDARDS. 1.4. 2022 CALIFORNIA FIRE CODE AND ITS APPENDICES AND STANDARDS.
- 1.5. 2022 CALIFORNIA ELECTRICAL CODE AND ITS APPENDICES AND STANDARDS.
- 1.6. 2022 CALIFORNIA BUILDING ENERGY EFFICIENCY STANDARDS. 1.7 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE AND ITS APPENDICES
- AND STANDARDS. 1.8 CURRENT CITY OF CULVER CITY, CA MUNICIPAL CODE.
- ALL WORK DESCRIBED IN THE DRAWINGS SHALL BE VERIFIED FOR DIMENSION. 2 GRADE, EXTENT AND COMPATIBILITY WITH EXISTING SITE CONDITIONS. ANY DISCREPANCIES AND UNEXPECTED CONDITIONS THAT AFFECT OR CHANGE THE WORK DESCRIBED IN THE CONTRACT DOCUMENTS SHALL BE BROUGHT TO THE ARCHITECT'S ATTENTION IMMEDIATELY. DO NOT PROCEED WITH THE WORK IN THE AREA OF DISCREPANCIES UNTIL ALL SUCH DISCREPANCIES ARE RESOLVED. IF THE CONTRACTOR CHOOSES TO DO SO, HE/SHE SHALL BE PROCEEDING AT HIS/HER OWN RISK.
- DIMENSIONS SHOWN SHALL TAKE PRECEDENCE OVER DRAWING SCALE OR 3 PROPORTION. LARGER SCALE DRAWINGS SHALL TAKE PRECEDENCE OVER SMALLER SCALE DRAWINGS.
- IN THE EVENT OF THE UNFORESEEN ENCOUNTER OF MATERIALS SUSPECTED TO BE OF AN ARCHAEOLOGICAL OR PALEONTOLOGICAL NATURE, ALL GRADING AND EXCAVATION SHALL CEASE IN THE IMMEDIATE AREA AND THE THE CONTRACTOR SHALL NOTIFY THE OWNER. THE FIND SHALL BE LEFT UNTOUCHED UNTIL AN EVALUATION BY A QUALIFIED ARCHAEOLOGIST OR PALEONTOLOGIST IS MADE.
- CONTRACTOR IS TO BE RESPONSIBLE FOR BEING FAMILIAR WITH THESE 5. DOCUMENTS INCLUDING ALL CONTRACT REQUIREMENTS.
- GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS 6 REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
- SHOP WELDS MUST BE PERFORMED BY A LICENSED FABRICATOR'S SHOP. THE FOLLOWING ITEMS SHOWN ON THE DRAWINGS ARE OWNER PROVIDED, 8. OWNER INSTALLED. UTILITIES PROVIDED FOR THESE ITEMS WILL BE PROVIDED BY THE CONTRACTOR. CONTRACTOR TO COORDINATE INSTALLATION WITH OWNER.
- 8.1. TV/DVD SYSTEMS
- 8.2. ICE MACHINE 8.3. VENDING MACHINE
- 8.4. REFRIGERATOR
- 8.5. MICROWAVE
- OSHA PERMITS REQUIRED FOR VERTICAL CUTS 5' OR OVER. CONTRACTOR TO PROVIDE COMPLETE DETAILS OF ENGINEERED TEMPORARY 10. SHORING OR SLOT CUTTING PROCEDURES ON PLANS. CALL FOR INSPECTION
- BEFORE EXCAVATION BEGINS. 11. THE SOILS ENGINEER IS TO APPROVE THE KEY OR BOTTOM AND LEAVE A CERTIFICATE ON THE SITE FOR THE GRADING INSPECTOR. THE GRADING INSPECTOR IS TO BE NOTIFIED BEFORE ANY GRADING BEGINS, AND FOR BOTTOM INSPECTION, BEFORE FILL IS PLACED. FILL MAY NOT BE PLACED WITHOUT APPROVAL OF THE GRADING INSPECTOR.
- 12. CONTRACTOR TO REVIEW CALIFORNIA GREEN CODE REQUIREMENTS FOR CONTRACTOR REQUIREMENTS. 13. A SEPARATE OFFICER, ACCESS EASEMENT/AGREEMENT, AND/OR
- RECIPROCAL ACCESS EASEMENT/AGREEMENT MAY BE REQUIRED TO INSURE THAT THE PROPOSED PRIVATE ACCESS ROADWAY WILL REMAIN OPEN TO THROUGH TRAFFIC AND EMERGENCY VEHICLES PRIOR TO FINAL OF BUILDING PFRMIT

MECHANICAL NOTES

- 1. CONFORM WITH CURRENT ADOPTED CRC. CMC. SMACCNA, NFPA AND LOCAL REQUIREMENTS.
- 2. DUCTWORK: SMACCNA "LOW VELOCITY DUCT CONSTRUCTION" NFPA STANDARD #90A. ALL TRANSVERSE DUCT PLENUM AND FITTING JOINTS SHALL BE SEALED WITH PRESSURE SENSITIVE NON-CLOTH TAPE MEETING THE REQUIREMENTS OF UL181, 181A, OR 181B, OR MASTIC TO PREVENT AIR LOSS. DUCTS SHALL BE INSULATED AS REQUIRED BY THE UMC. SEE FLOOR PLAN FOR F.A.U. AND FIREPLACES. DUCTS PENETRATING A WALL OR FLOOR-CEILING BETWEEN GARAGE & DWELLING TO BE MINIMUM 26 GAUGE METAL WITHOUT OPENING IN GARAGE. FIRE DAMPER REQUIRED OTHERWISE
- 3. GRILLES AND REGISTERS, DIFFUSERS, ETC: SUBJECT TO OWNERS APPROVAL. "CARNES" OR EQUAL FANS: DIRECTLY VENTED TO OUTSIDE, BACK DRAFT DAMPERS ARE REQUIRED (PER TABLE 2-53V, TITLE 24 C.A.C.).
- LAUNDRY DRYER VENT TO EXTERIOR TO BE 14 FEET MAXIMUM, LESS 2 FEET PER 90 DEGREE TURN IN EXCESS OF 2 PER CMC 504.4.2.1. IF VENT IS OVER 14' AN APPROVED POWER ASSISTED DEVICE IS REQUIRED. DRYER EXHAUST DUCT POWER
- VENTILATORS SHALL BE LISTED AND LABELED IN ACCORDANCE WITH UL 705 AND INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS PER 2022 CMC, SECTION 504.2.2.3. SEE NOTE BELOW
- 5. BATHROOM EXHAUST FANS (BATHROOM APPLIES TO ROOMS CONTAINING BATHTUB, SHOWER, OR TUB/SHOWER COMBINATION) WHICH EXHAUST DIRECTLY FROM BATHROOMS SHALL COMPLY WITH THE FOLLOWING (2022 CGBSC SEC. 4.506.1):
- a. FANS SHALL BE ENERGY STAR COMPLIANT AND BE DUCTED TO TERMINATE OUTSIDE THE BUILDING MIN 3' FROM OPENINGS. b. UNLESS FUNCTIONING AS A COMPONENT OF A WHOLE HOUSE VENTILATION SYSTEM, FANS MUST BE CONTROLLED BY A HUMIDITY CONTROL.
- HUMIDITY CONTROLS SHALL BE CAPABLE OF ADJUSTMENT BETWEEN A RELATIVE HUMIDITY RANGE OF ≤ 50 PERCENT TO A MAXIMUM OF 80 PERCENT. A HUMIDITY CONTROL MAY UTILIZE MANUAL OR AUTOMATIC MEANS OF ADJUSTMENT. A HUMIDITY CONTROL MAY BE A
- SEPARATE COMPONENT TO EXHAUST FAN AND IS NOT REQUIRED TO BE INTEGRAL(I.E. BUILT IN) 6. BATHROOM EXHAUST FANS SHALL PROVIDE MINIMUM 50 CFM EXHAUST
- RATE (2022 CMC TABLE 403.7). 7. KITCHEN EXHAUST FANS SHALL PROVIDE MINIMUM 100 CFM EXHAUST RATE (2022 CMC TABLE 403.7)

- THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

DATE 01/03/2024 SHEET ∇^{-}

Ш

()

В

 \sim

S

Ζ

۲ ص

U N N

> z

N S

Ξ Δ Υ

N

ш

ш

2






| ABB | REVIATIONS |
|-------|------------------|
| A/C | AIR CONDITIONING |
| ABV | ABOVE |
| ACOUS | ACOUSTICAL |

| A/C ABV | AIR CONDITIONING ABOVE | FOIC | FURNISHED CONTRACTC |
|------------|--|---------------|----------------------------|
| | ACOUSTICAL | FOM | FACE OF MA |
| ACT | ACOUSTICAL CEILING TILE | FOS | FACE OF ST |
| ADA | AMERICANS WITH DISABILITIES ACT | FRP | FIBERGLASS |
| AFCI | ARC FAULT CIRCUIT INTERRUPTER | FT | FOOT OR FE |
| AFF | ABOVE FINISH FLOOR | FTG | FOOTING |
| AL | ALUMINUM | ga Galv | GAUGE, GAG |
| ALT | | GALV GB | GRAB BAR |
| ARCH BD | ARCHITECT(URAL) BOARD | GC | GENERAL CO |
| BDRM | BEDROOM | GFCI | GROUND FA |
| BET | BETWEEN | GWB | GYPSUM BO |
| BIT | BITUMINOUS | GYP | GYPSUM |
| | BUILDNG | HB | HOSE BIBB |
| | BLOCKING | HC | HOLLOW CO |
| BLW | BELOW | HDWD | HARDWOOD |
| BM | BEAM | HDWR | HARDWARE |
| BOT | BOTTOM | HGT | HEIGHT |
| BUR | BUILT UP ROOF | HM | HOLLOW ME HORIZONTAI |
| CB | | HORIZ HVAC | HEATING, VE |
| CBC CEM | CALIFORNIA BUILDING CODE CEMENT | ID | INSIDE DIAM |
| | CUBIC FEET PER MINUTE | IIC | IMPACT INSU |
| CIP | CAST IN PLACE | IN | INCH |
| CJ | CONTROL JOINT | INCAND | INCANDESCI |
| CL | CENTER LINE | INSUL | INSULATION |
| CLG | CEILING | INT | INTERIOR |
| CLO | CLOSET | JC | JANITORS C |
| CLR | CLEAR | JT | JOINT |
| CMU | CONCRETE MASONRY UNIT | LAM | LAMINATE |
| CO | CLEAN OUT | LAV | LAVATORY |
| COL | COLUMN | | POUNDS |
| CONC | CONCRETE | LEED | LEADERSHIF |
| | CONSTRUCTION CONTINUOUS | LF | LINEAR FEE |
| | CONTRACTOR | LIN | LINEN CLOSI |
| CPT | CARPET | LINO | LINOLEUM |
| CT | CERAMIC TILE | LT(G) | LIGHT(ING) |
| CTR | CENTER | LVL | LAMINATED |
| DBL | DOUBLE | LVT | LUXURY VIN |
| DF | DRINKING FOUNTAIN | LW | LIGHTWEIGH |
| DIA | DIAMETER, DIAPHRAGM | MAX | MAXIMUM |
| DIM | DIMENSION | MDF | MEDIUM DEN |
| DN | DOWN | MECH MEMB | MECHANICA MEMBRANE |
| DR | DOOR | MEP | MECHANICA |
| DS | DOWN SPOUT | MFR | MANUFACTU |
| DTL DW | DETAIL | MIN | MINIMUM |
| DWG | DISHWASHER DRAWING | MISC | MISCELLANE |
| (E) | EXISTING | МО | MASONRY O |
| E | EAST | MTD | MOUNTED |
| EA | EACH | MTL | METAL |
| EJ | EXPANSION JOINT | Ν | NORTH |
| EL, | ELEVATION | NIC | NOT IN CON |
| ELEV | | NO | NUMBER |
| | ELECTRIC | NOM NTS | NOMINAL NOT TO SCA |
| ENCL | ENCLOSURE | 0.P. | OVERFLOW |
| | EQUAL | OC OC | ON CENTER |
| EXH | EXHAUST | OD | OVERFLOW |
| EXP | | OFF | OFFICE |
| | EXTERIOR | ОН | OPPOSITE H |
| | FIRE ALARM CONTROL PANEL | OPG | OPENING |
| FAU | FORCED AIR UNIT | OPP | OPPOSITE |
| FAWP | FLUID APPLIED WATERPROOFING | (P) | PROPOSED |
| FD | FLOOR DRAIN | PERM | PERIMETER |
| FDC | FIRE DEPARTMENT CONNECTION | PERP | PERPENDICU |
| | FIRE EXTINGUISHER | PG PL | PAINT GRAD |
| | | PLAM | PLATE, PROI PLASTIC LAN |
| FF FG | FINISHED FLOOR ELEVATION FINISHED GRADE | PLAM | PLUMBING |
| | FIRE HYDRANT | | PLYWOOD |
| | FIRE HOSE CABINET | PNL | PANEL |
| FIN | FINISH | PP | POWER POL |
| | FIXTURE | PR | PAIR |
| | FLOOR | PRTN | PARTITION |
| FLUOR | FLOURESCENT | PSF | POUNDS PE |
| FND | FOUNDATION | PSI | POUNDS PE |
| | FACE OF | PSL | PARALLEL S |
| | | PT PTD | PRESSURE 1 PAINTED |
| FUF | FACE OF FINISH | טרי | |
| | | | |
| SVM | BOLS | | |

| | FURNISHED BY OWNER INSTALLED BY |
|---|---|
| | CONTRACTOR |
| | |
| | FACE OF MASONRY |
| | FACE OF STUD |
| | FIBERGLASS REINFORCED PANELS |
| | FOOT OR FEET |
| | FOOTING |
| | |
| | GAUGE, GAGE |
| | GALVANIZED |
| | GRAB BAR |
| | GENERAL CONTRACTOR |
| | GROUND FAULT CIRCUIT INTERRUPTER |
| | GYPSUM BOARD |
| | |
| | GYPSUM |
| | HOSE BIBB |
| | HOLLOW CORE |
| | HARDWOOD |
| | HARDWARE |
| | |
| | HEIGHT |
| | HOLLOW METAL |
| | HORIZONTAL |
| | HEATING, VENTILATION, A/C |
| | INSIDE DIAMETER |
| | |
| | IMPACT INSULATION CLASS |
| | INCH |
|) | INCANDESCENT |
| | INSULATION, INSULATED |
| | INTERIOR |
| | |
| | JANITORS CLOSET |
| | JOINT |
| | LAMINATE |
| | LAVATORY |
| | POUNDS |
| | |
| | LEADERSHIP IN ENERGY AND ENVIRONMENTAL DESIGN |
| | |
| | LINEAR FEET |
| | LINEN CLOSET |
| | LINOLEUM |
| | LIGHT(ING) |
| | LAMINATED VENEER LUMBER |
| | |
| | LUXURY VINYL TILE |
| | LIGHTWEIGHT |
| | |
| | MAXIMUM |
| | |
| | MEDIUM DENSITY FIBERBOARD |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD PANEL |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD PANEL POWER POLE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD PANEL |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD PANEL POWER POLE |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD PANEL POWER POLE PAIR PARTITION |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD PANEL POWER POLE PAIR PARTITION POUNDS PER SQUARE FOOT |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD PANEL POWER POLE PAIR PARTITION POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD PANEL POWER POLE PAIR PARTITION POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH PARALLEL STRAND LUMBER |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD PANEL POWER POLE PAIR PARTITION POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH PARALLEL STRAND LUMBER PRESSURE TREATED |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD PANEL POWER POLE PAIR PARTITION POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH PARALLEL STRAND LUMBER |
| | MEDIUM DENSITY FIBERBOARD MECHANICAL MEMBRANE MECHANICAL, ELECTRICAL, PLUMBING MANUFACTURER MINIMUM MISCELLANEOUS MASONRY OPENING MOUNTED METAL NORTH NOT IN CONTRACT NUMBER NOMINAL NOT TO SCALE OVERFLOW PIPE ON CENTER OVERFLOW DRAIN OFFICE OPPOSITE HAND OPENING OPPOSITE PROPOSED PERIMETER PERPENDICULAR PAINT GRADE PLATE, PROPERTY LINE PLASTIC LAMINATE PLUMBING PLYWOOD PANEL POWER POLE PAIR PARTITION POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH PARALLEL STRAND LUMBER PRESSURE TREATED |

| PV | |
|---|---|
| | PHOTO VOLTAIC |
| PVC | POLYVINYL CHLORIDE |
| | PAVEMENT |
| QTY | QUANTITY |
| R | RADIUS, RISER RUBBER BASE |
| RB RCP | |
| RD | ROOF DRAIN |
| REF | REFRIGERATOR |
| | REINFORCED |
| | REQUIRED |
| RH | RIGHT HAND |
| RM | ROOM |
| RO | ROUGH OPENING |
| RTU | ROOF TOP UNIT (MECH) |
| S | SOUTH |
| SAFB | SOUND ATTENUATION FIBER BATT |
| SAWP SC | SELF ADHEREING WATERPROOFING SCUPPER/SOLID CORE |
| | SCUPPER/SOLID CORE |
| SEAL | |
| SECT | SECTION |
| SF | SQUARE FOOT |
| SHT | SHEET |
| SHTHG | SHEATHING |
| SIM | SIMILAR |
| SM | SHEET METAL |
| SPEC | SPECIFICATION |
| SQ | SQURE |
| SS | SOLID SURFACE |
| SSTL STC | STAINLESS STEEL SOUND TRANSMISSION CLASS |
| STD | STANDARD |
| STL | STEEL |
| | STORAGE |
| STRUCT | STRUCTURAL |
| SUSP | SUPSPENDED |
| SV | SHEET VINYL |
| SYM | SYMMMETRICAL |
| T | |
| T&G | TONGUE & GROOVE |
| TEL TEMP | TELEPHONE TEMPERED |
| TER | TERRAZZO |
| THK | THICK |
| THR | THRESHOLD |
| TJI | TRUSS JOIST I-JOIST |
| ТО | TOP OF |
| TOS | TOP OF SLAB |
| TOW | TOP OF WALL |
| TRANS | |
| TV | TELEVISION |
| TYP UFAS | TYPICAL |
| | |
| | UNIFORM FEDERAL ACCESSIBILITY STANDARDS |
| UG | |
| | STANDARDS |
| UG UNFIN UNO | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE |
| UG UNFIN UNO UV | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET |
| UG UNFIN UNO UV VCT | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE |
| UG UNFIN UNO UV VCT VERT | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL |
| UG UNFIN UNO UV VCT VERT VIF | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD |
| UG UNFIN UNO UV VCT VERT VIF VTR | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE |
| UG UNFIN UNO UV VCT VERT VIF | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W W/ W/D W/O | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITHOUT |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W W/ W/D W/O W/O WC | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITHOUT WATERCLOSET |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W W/ W/D W/O WC WD | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITHOUT WATERCLOSET WOOD |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W W/D W/D W/O W/O WC WD WDW | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITH WASHER DRYER WITHOUT WATERCLOSET WOOD WINDOW |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W W/ W/D W/O W/O W/O WC WD WDW WH | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITHOUT WATERCLOSET WOOD WINDOW WATER HEATER |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W/W/O W/O W/O W/O W/O W/O W/O W/O W/O W | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITHOUT WATERCLOSET WOOD WINDOW WATER HEATER WROUGHT IRON |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W W/ W/D W/O W/O W/O WC WD WDW WH | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITHOUT WATERCLOSET WOOD WINDOW WATER HEATER WROUGHT IRON |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W/ W/O W/O W/O W/O W/O WC WD WD WDW WH WI WIN | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITHOUT WATERCLOSET WOOD WINDOW WATER HEATER WROUGHT IRON |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W W/D W/D W/D W/D W/D W/D W/D W/D W/D W | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITH WASHER DRYER WITHOUT WATERCLOSET WOOD WINDOW WATER HEATER WROUGHT IRON WINDOW WATERPROOF(ING) |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W/ W/O W/O W/O W/O W/O W/O W/O W/O W/O | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITHOUT WATERCLOSET WOOD WINDOW WATER HEATER WROUGHT IRON WINDOW WATERPROOF(ING) WEATHER RESISTIVE |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W W/D W/D W/D W/D W/D W/D W/D W/D W/D W | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITHOUT WATERCLOSET WOOD WINDOW WATER HEATER WROUGHT IRON WINDOW WATER PROOF(ING) WEATHER RESISTIVE WATER RESISTIVE BARRIER WAINSCOT WEIGHT |
| UG UNFIN UNO UV VCT VERT VIF VTR VWC W/ W/D W/O W/O W/O W/O W/O W/O W/O W/O W/O W/O | STANDARDS UNDERGROUND UNFINISHED ULNESS NOTED OTHERWISE UTRAVIOLET VINYL COMPOSITION TILE VERTICAL VERIFY IN FIELD VENT TERMINATION PIPE VINYL WALL COVERING WEST WITH WASHER DRYER WITHOUT WATERCLOSET WOOD WINDOW WATER HEATER WROUGHT IRON WINDOW WATER PROOF(ING) WEATHER RESISTIVE WATER RESISTIVE BARRIER WAINSCOT |

SYMBOLS

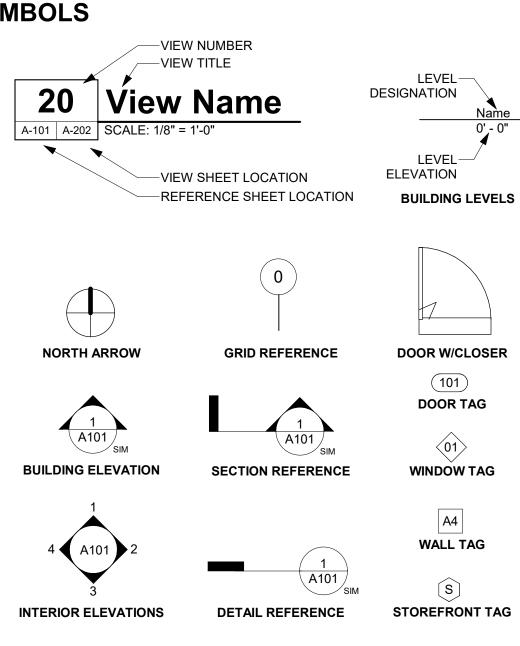

2 **REVISION TAG**

£ CENTERLINE

DOOR W/CLOSER (101)


DOOR TAG <u>(01)</u>


WINDOW TAG

A4 WALL TAG

S STOREFRONT TAG

> (P1) MATERIAL TAG

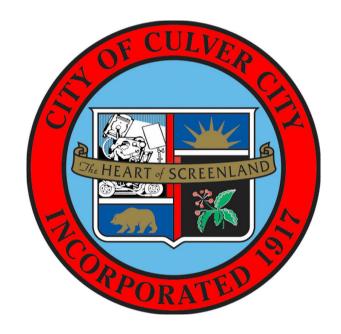

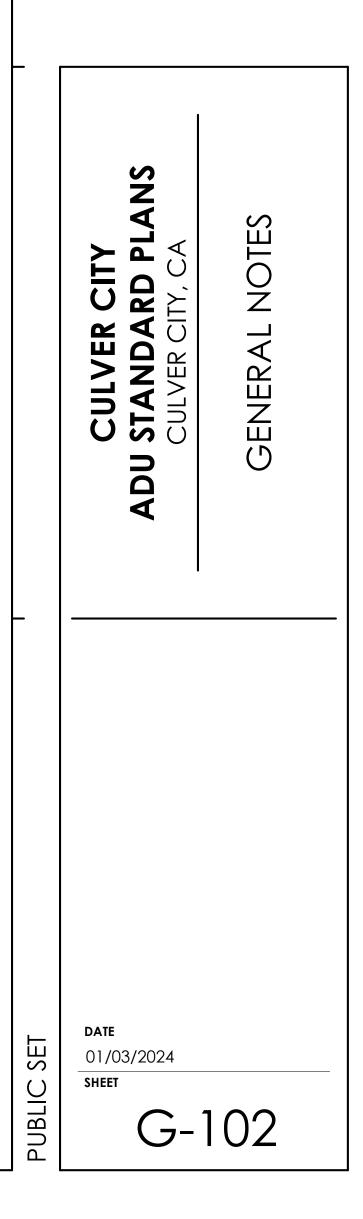

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE **RESIDENTIAL MANDATORY MEASURES, SHEET 1** (January 2023)

| | | | | | | | Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circu |
|---------------|--|-------|------------------|--|------|------------------|---|
| SPON. ARTY | CHAPTER 3 | Y NIA | RESPON. PARTY | | | RESPON. PARTY | |
| | GREEN BUILDING | | | 4.106.4.2 New multifamily dwellings, hotels and motels and new residential parking facilities. When parking is provided, parking spaces for new multifamily dwellings, hotels and motels shall meet the | | | 4.106.4.2.4 Identification. |
| 1 | SECTION 301 GENERAL | | | requirements of Sections 4.106.4.2.1 and 4.106.4.2.2. Calculations for spaces shall be rounded up to the nearest whole number. A parking space served by electric vehicle supply equipment or designed as a future EV charging | | | The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reser future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code. |
| | 301.1 SCOPE. Buildings shall be designed to include the green building measures specified as mandatory in the application checklists contained in this code. Voluntary green building measures are also included in the | | | space shall count as at least one standard automobile parking space only for the purpose of complying with any applicable minimum parking space requirements established by a local jurisdiction. See Vehicle Code Section 22511.2 | | | 4.106.4.2.5 Electric Vehicle Ready Space Signage. |
| | application checklists and may be included in the design and construction of structures covered by this code, but are not required unless adopted by a city, county, or city and county as specified in Section 101.7. | | | for further details. | | | Electric vehicle ready spaces shall be identified by signage or pavement markings, in compliance with Caltra Traffic Operations Policy Directive 13-01 (Zero Emission Vehicle Signs and Pavement Markings) or its |
| | 301.1.1 Additions and alterations. [HCD] The mandatory provisions of Chapter 4 shall be applied to | | | 4.106.4.2.1Multifamily development projects with less than 20 dwelling units; and hotels and motels with less than 20 sleeping units or guest rooms. | | | successor(s). |
| | additions or alterations of existing residential buildings where the addition or alteration increases the | | | The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to this section. | | | 4.106.4.3 Electric vehicle charging for additions and alterations of parking facilities serving existing multifamily buildings. |
| | building's conditioned area, volume, or size. The requirements shall apply only to and/or within the specific area of the addition or alteration. | | | 1.EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types | | | When new parking facilities are added, or electrical systems or lighting of existing parking facilities are adde altered and the work requires a building permit, ten (10) percent of the total number of parking spaces adder |
| | The mandatory provision of Section 4.106.4.2 may apply to additions or alterations of existing parking | | | of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical | | | altered shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE. |
| | facilities or the addition of new parking facilities serving existing multifamily buildings. See Section 4.106.4.3 for application. | | | system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all EVs at all required EV spaces at a minimum of 40 amperes. | | | Notes: |
| | Note: Repairs including, but not limited to, resurfacing, restriping and repairing or maintaining existing | | | The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved | | | 1. Construction documents are intended to demonstrate the project's capability and capacity for facilitating |
| | lighting fixtures are not considered alterations for the purpose of this section. | | | for future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code. | | | EV charging. |
| | Note: On and after January 1, 2014, residential buildings undergoing permitted alterations, additions, or improvements shall replace noncompliant plumbing fixtures with water-conserving plumbing fixtures. | | | Exceptions: | | | 2. There is no requirement for EV spaces to be constructed or available until EV chargers are installed for up |
| 1 | Plumbing fixture replacement is required prior to issuance of a certificate of final completion, certificate of occupancy or final permit approval by the local building department. See Civil Code Section 1101.1, | | | 1. When EV chargers (Level 2 EVSE) are installed in a number equal to or greater than the required number | | | DIVISION 4.2 ENERGY EFFICIENCY |
| | et seq., for the definition of a noncompliant plumbing fixture, types of residential buildings affected and other important enactment dates. | | | of EV capable spaces. | | | 4.201 GENERAL 4.201.1 SCOPE. For the purposes of mandatory energy efficiency standards in this code, the California Energy |
| | | | | 2.When EV chargers (Level 2 EVSE) are installed in a number less than the required number of EV capable spaces, the number of EV capable spaces required may be reduced by a number equal to the number of | | | Commission will continue to adopt mandatory standards. |
| | 301.2 LOW-RISE AND HIGH-RISE RESIDENTIAL BUILDINGS. [HCD] The provisions of individual sections of CALGreen may apply to either low-rise residential buildings high-rise residential | | | EV chargers installed. | | | DIVISION 4.3 WATER EFFICIENCY AND CONSERVATION |
| | buildings, or both. Individual sections will be designated by banners to indicate where the section applies | | | Notes: | | | 4.303 INDOOR WATER USE 4.303.1 WATER CONSERVING PLUMBING FIXTURES AND FITTINGS. Plumbing fixtures (water closets and |
| | specifically to low-rise only (LR) or high-rise only (HR). When the section applies to both low-rise and high-rise buildings, no banner will be used. | | | a.Construction documents are intended to demonstrate the project's capability and capacity for facilitating future EV charging. | | | urinals) and fittings (faucets and showerheads) shall comply with the sections 4.303.1.1, 4.303.1.2, 4.303 |
| | SECTION AND MIXED OCCURANCY DUIL DINOS | | | b. There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or | | | and 4.303.4.4. |
| - 1 | SECTION 302 MIXED OCCUPANCY BUILDINGS | | | EV chargers are installed for use. | | | Note: All noncompliant plumbing fixtures in any residential real property shall be replaced with water-com plumbing fixtures. Plumbing fixture replacement is required prior to issuance of a certificate of final |
| | 302.1 MIXED OCCUPANCY BUILDINGS. In mixed occupancy buildings, each portion of a building shall comply with the specific green building measures applicable to each specific occupancy. | | | 2.EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power | | | completion, certificate of occupancy, or final permit approval by the local building department. See Code Section 1101.1, et seq., for the definition of a noncompliant plumbing fixture, types of resider |
| | Exceptions: 1. [HCD] Accessory structures and accessory occupancies serving residential buildings shall | | | Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit. | | | buildings affected and other important enactment dates. |
| | comply with Chapter 4 and Appendix A4, as applicable. 2. [HCD] For purposes of CALGreen, live/work units, complying with Section 419 of the California | | | Exception: Areas of parking facilities served by parking lifts. | | | 4.303.1.1 Water Closets. The effective flush volume of all water closets shall not exceed 1.28 gallons p flush. Tank-type water closets shall be certified to the performance criteria of the U.S. EPA WaterSense |
| | Building Code, shall not be considered mixed occupancies. Live/Work units shall comply with Chapter 4 and Appendix A4, as applicable. | | | 4.106.4.2.2 Multifamily development projects with 20 or more dwelling units, hotels and motels with 20 or more | | | Specification for Tank-type Toilets. |
| | DIVISION 4.1 PLANNING AND DESIGN | | | sleeping units or guest rooms. The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to | | | Note: The effective flush volume of dual flush toilets is defined as the composite, average flush vo |
| | ABBREVIATION DEFINITIONS: | | | this section. | | | of two reduced flushes and one full flush. |
| | HCD Department of Housing and Community Development BSC California Building Standards Commission | | | 1.EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 | | | 4.303.1.2 Urinals. The effective flush volume of wall mounted urinals shall not exceed 0.125 gallons per The effective flush volume of all other urinals shall not exceed 0.5 gallons per flush. |
| | DSA-SS Division of the State Architect, Structural Safety | | | EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all | | | 4.303.1.3 Showerheads. |
| | OSHPD Office of Statewide Health Planning and Development LR Low Rise | | | system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all EVs at all required EV spaces at a minimum of 40 amperes. | | | 4.303.1.3.1 Single Showerhead. Showerheads shall have a maximum flow rate of not more than |
| | HR High Rise AA Additions and Alterations | | | The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV observice surpasses as "EV CARARI E" is according to with the California Electrical Cade | | | gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of the U.S. WaterSense Specification for Showerheads. |
| | N New | | | for future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code. | | | 4.303.1.3.2 Multiple showerheads serving one shower. When a shower is served by more than |
| | CHAPTER 4 | | | Exception: When EV chargers (Level 2 EVSE) are installed in a number greater than five (5) percent of parking spaces required by Section 4.106.4.2.2, Item 3, the number of EV capable spaces required may be | | | showerhead, the combined flow rate of all the showerheads and/or other shower outlets controlled a single valve shall not exceed 1.8 gallons per minute at 80 psi, or the shower shall be designed to |
| | RESIDENTIAL MANDATORY MEASURES | | | reduced by a number equal to the number of EV chargers installed over the five (5) percent required. | | | allow one shower outlet to be in operation at a time. |
| | | | | Notes: | | | Note: A hand-held shower shall be considered a showerhead. |
| | SECTION 4.102 DEFINITIONS 4.102.1 DEFINITIONS | | | a.Construction documents shall show locations of future EV spaces. | | | 4.303.1.4 Faucets. |
| | The following terms are defined in Chapter 2 (and are included here for reference) | | | b. There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or EV chargers are installed for use. | | | 4.303.1.4.1 Residential Lavatory Faucets. The maximum flow rate of residential lavatory faucet |
| | FRENCH DRAIN. A trench, hole or other depressed area loosely filled with rock, gravel, fragments of brick or similar pervious material used to collect or channel drainage or runoff water. | | | 2.EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power | | | not exceed 1.2 gallons per minute at 60 psi. The minimum flow rate of residential lavatory faucets not be less than 0.8 gallons per minute at 20 psi. |
| - 1 | WATTLES. Wattles are used to reduce sediment in runoff. Wattles are often constructed of natural plant materials | | | Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit. | | | 4.303.1.4.2 Lavatory Faucets in Common and Public Use Areas. The maximum flow rate of la |
| | such as hay, straw or similar material shaped in the form of tubes and placed on a downflow slope. Wattles are also used for perimeter and inlet controls. | | | Exception: Areas of parking facilities served by parking lifts. | | | faucets installed in common and public use areas (outside of dwellings or sleeping units) in resider buildings shall not exceed 0.5 gallons per minute at 60 psi. |
| | 4.106 SITE DEVELOPMENT | | | | | | 4.303.1.4.3 Metering Faucets. Metering faucets when installed in residential buildings shall not of |
| | 4.106.1 GENERAL. Preservation and use of available natural resources shall be accomplished through evaluation | | | 3.EV Chargers. Five (5) percent of the total number of parking spaces shall be equipped with Level 2 EVSE. Where common use parking is provided, at least one EV charger shall be located in the common use parking area and shall be available for use by all residents or quests. | | | more than 0.2 gallons per cycle. |
| 1 | and careful planning to minimize negative effects on the site and adjacent areas. Preservation of slopes, management of storm water drainage and erosion controls shall comply with this section. | | | area and shall be available for use by all residents or guests. | | | 4.303.1.4.4 Kitchen Faucets. The maximum flow rate of kitchen faucets shall not exceed 1.8 gal per minute at 60 psi. Kitchen faucets may temporarily increase the flow above the maximum rate, |
| | 4.106.2 STORM WATER DRAINAGE AND RETENTION DURING CONSTRUCTION. Projects which disturb less | | | When low power Level 2 EV charging receptacles or Level 2 EVSE are installed beyond the minimum required, an automatic load management system (ALMS) may be used to reduce the maximum required electrical | | | to exceed 2.2 gallons per minute at 60 psi, and must default to a maximum flow rate of 1.8 gallons minute at 60 psi. |
| 1 | than one acre of soil and are not part of a larger common plan of development which in total disturbs one acre or more, shall manage storm water drainage during construction. In order to manage storm water drainage | | | capacity to each space served by the ALMS. The electrical system and any on-site distribution transformers shall have sufficient capacity to deliver at least 3.3 kW simultaneously to each EV charging station (EVCS) | | | Note: Where complying faucets are unavailable, aerators or other means may be used to achieve |
| | during construction, one or more of the following measures shall be implemented to prevent flooding of adjacent property, prevent erosion and retain soil runoff on the site. | | | served by the ALMS. The branch circuit shall have a minimum capacity of 40 amperes, and installed EVSE shall have a capacity of not less than 30 amperes. ALMS shall not be used to reduce the minimum required electrical | | | reduction. |
| 1 | 1. Retention basins of sufficient size shall be utilized to retain storm water on the site. | | | capacity to the required EV capable spaces. | | | 4.303.1.4.5 Pre-rinse spray valves. When installed, shall meet the requirements in the California Code of Regulations, Title 20 (Applia) |
| 1 | Where storm water is conveyed to a public drainage system, collection point, gutter or similar disposal method, water shall be filtered by use of a barrier system, wattle or other method approved | | | 4.106.4.2.2.1 Electric vehicle charging stations (EVCS). Electric vehicle charging stations required by Section 4.106.4.2.2, Item 3, shall comply with Section 4.106.4.2.2.1. | | | Efficiency Regulations), Sections 1605.1 (h)(4) Table H-2, Section 1605.3 (h)(4)(A), and Section 1 (d)(7) and shall be equipped with an integral automatic shutoff. |
| | by the enforcing agency. Compliance with a lawfully enacted storm water management ordinance. | LN | | Exception: Electric vehicle charging stations serving public accommodations, public housing, motels and hotels | | | |
| | Note: Refer to the State Water Resources Control Board for projects which disturb one acre or more of soil, or | | | shall not be required to comply with this section. See California Building Code, Chapter 11B, for applicable requirements. | | | FOR REFERENCE ONLY: The following table and code section have been reprinted from the Cal Code of Regulations, Title 20 (Appliance Efficiency Regulations), Section 1605.1 (h)(4) and Section |
| | are part of a larger common plan of development which in total disturbs one acre or more of soil. | | | 4.106.4.2.2.1.1 Location. | | | 1605.3 (h)(4)(A). |
| | (Website: https://www.waterboards.ca.gov/water_issues/programs/stormwater/construction.html) | | | EVCS shall comply with at least one of the following options: | | | TABLE H-2 |
| | 4.106.3 GRADING AND PAVING. Construction plans shall indicate how the site grading or drainage system will manage all surface water flows to keep water from entering buildings. Examples of methods to manage surface | | | The charging space shall be located adjacent to an accessible parking space meeting the requirements of the California Building Code, Chapter 11A, to allow use of the EV charger from the accessible parking space. | | | |
| | water include, but are not limited to, the following: | | | | | | STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALUES MANUFACTURED ON OR AFTER JANUARY 28, 2019 |
| | 1. Swales 2. Water collection and disposal systems | | | The charging space shall be located on an accessible route, as defined in the California Building Code, Chapter 2, to the building. | | | , |
| | Water collection and disposal systems French drains Water relation participation | | | Exception: Electric vehicle charging stations designed and constructed in compliance with the California Building Code, Charter 11B, are not required to comply with Section 4.106.4.2.2.1.1 and Section | | | PRODUCT CLASS [spray force in ounce force (ozf)] MAXIMUM FLOW RATE (gpm) |
| | Water retention gardens Other water measures which keep surface water away from buildings and aid in groundwater | | | Building Code, Chapter 11B, are not required to comply with Section 4.106.4.2.2.1.1 and Section 4.106.4.2.2.1.2, Item 3. | | | |
| | recharge. | | | 4.106.4.2.2.1.2 Electric vehicle charging stations (EVCS) dimensions. | | | |
| | Exception: Additions and alterations not altering the drainage path. | | | The charging spaces shall be designed to comply with the following: | | | Product Class 2 (> 5.0 ozf and ≤ 8.0 ozf) 1.20 |
| | 4.106.4 Electric vehicle (EV) charging for new construction. New construction shall comply with Sections 4.106.4.1 or 4.106.4.2 to facilitate future installation and use of EV chargers. Electric vehicle supply | | | 1. The minimum length of each EV space shall be 18 feet (5486 mm). | | | Product Class 3 (> 8.0 ozf) 1.28 |
| | equipment (EVSE) shall be installed in accordance with the California Electrical Code, Article 625. | | | 2. The minimum width of each EV space shall be 9 feet (2743 mm). | | | Title 20 Section 1605.3 (h)(4)(A): Commercial prerinse spray values manufactured on or after Janu 1, 2006, shall have a minimum spray force of not less than 4.0 ounces-force (ozf)[113 grams-force |
| | Exceptions: 1. On a case-by-case basis, where the local enforcing agency has determined EV charging and | | | 3.One in every 25 charging spaces, but not less than one, shall also have an 8-foot (2438 mm) wide minimum aisle. A 5-foot (1524 mm) wide minimum aisle shall be permitted provided the minimum width of the EV space is | | | 4.303.2 Submeters for multifamily buildings and dwelling units in mixed-used residential/commercial |
| | infrastructure are not feasible based upon one or more of the following conditions: 1.1 Where there is no local utility power supply or the local utility is unable to supply adequate | | | 12 feet (3658 mm). | | | buildings. Submeters shall be installed to measure water usage of individual rental dwelling units in accordance wit |
| | power. 1.2 Where there is evidence suitable to the local enforcing agency substantiating that additional | | | a.Surface slope for this EV space and the aisle shall not exceed 1 unit vertical in 48 units horizontal (2.083 percent slope) in any direction. | | | California Plumbing Code. |
| | local utility infrastructure design requirements, directly related to the implementation of Section 4.106.4, may adversely impact the construction cost of the project. | | | 4.106.4.2.2.1.3 Accessible EV spaces. | | | 4.303.3 Standards for plumbing fixtures and fittings. Plumbing fixtures and fittings shall be installed in accordance with the California Plumbing Code, and shall meet the applicable standards referenced in Table |
| | Accessory Dwelling Units (ADU) and Junior Accessory Dwelling Units (JADU) without additional parking facilities. | | | 4.100.4.2.2.1.3 Accessible EV spaces. In addition to the requirements in Sections 4.106.4.2.2.1.1 and 4.106.4.2.2.1.2, all EVSE, when installed, shall comply with the accessibility provisions for EV chargers in the California Building Code, Chapter 11B. EV ready | | | 1701.1 of the California Plumbing Code. |
| | parning racinuda. | | | spaces and EVCS in multifamily developments shall comply with California Building Code, Chapter 11B, EV ready 1109A. | | | NOTE: THIS TABLE COMPILES THE DATA IN SECTION 4.303.1, AND IS INCLUDED AS A |
| | 4.106.4.1 New one- and two-family dwellings and townhouses with attached private garages. For each dwelling, unit install a listed recovery to accommodate a dedicated 208/240 welt branch circuit. The recovery | | | | | | CONVENIENCE FOR THE USER. |
| | dwelling unit, install a listed raceway to accommodate a dedicated 208/240-volt branch circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall originate at the main space or subsequences and shall terminate inter a listed applied they are the applied or the second shall be a listed applied to the second shall be applied to the second se | | | 4.106.4.2.3 EV space requirements. 1.Single EV space required. Install a listed raceway capable of accommodating a 208/240-volt dedicated branch size if the receiver shall be been than to be size 1 (capring) 1 installed installed. The receiver shall be been to be b | | | TABLE - MAXIMUM FIXTURE WATER USE |
| | service or subpanel and shall terminate into a listed cabinet, box or other enclosure in close proximity to the proposed location of an EV charger. Raceways are required to be continuous at enclosed, inaccessible or | | | circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall originate at the main service or subpanel and shall terminate into a listed cabinet, box or enclosure in close | | | FIXTURE TYPE FLOW RATE |
| | concealed areas and spaces. The service panel and/or subpanel shall provide capacity to install a 40-ampere 208/240-volt minimum dedicated branch circuit and space(s) reserved to permit installation of a branch circuit | | | proximity to the location or the proposed location of the EV space. Construction documents shall identify the raceway termination point, receptacle or charger location, as applicable. The service panel and/ or subpanel shall | | | SHOWER HEADS (RESIDENTIAL) 1.8 GMP @ 80 PSI |
| | overcurrent protective device. | | | have a 40-ampere minimum dedicated branch circuit, including branch circuit overcurrent protective device installed, or space(s) reserved to permit installation of a branch circuit overcurrent protective device. | | | LAVATORY FAUCETS (RESIDENTIAL) MAX. 1.2 GPM @ 60 PSI_MIN. 0.8 GPM @ 20 |
| | Exemption: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the proposed location of an EV charger at the time of original construction in | | | Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is | | | PSI PSI |
| | accordance with the California Electrical Code. | | | installed in close proximity to the location or the proposed location of the EV space, at the time of original construction in accordance with the California Electrical Code. | | | LAVATORY FAUCETS IN COMMON & PUBLIC 0.5 GPM @ 60 PSI USE AREAS 0.5 GPM @ 60 PSI |
| 1 | 4.106.4.1.1 Identification. The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging as "EV CAPABLE". The raceway termination | | | | | | KITCHEN FAUCETS 1.8 GPM @ 60 PSI |
| _ I. | protective device space(s) reserved for ruture EV charging as "EV CAPABLE". The raceway termination | | | 2.Multiple EV spaces required. Construction documents shall indicate the raceway termination point and the location of installed or future EV spaces, receptacles or EV chargers. Construction documents shall also provide information of installed or future et al. (1997). | | | METERING FAUCETS 0.2 GAL/CYCLE |
| | location shall be permanently and visibly marked as "EV CAPABLE". | | | intermention on approximate or second according on a 1921, second solitable to the ask as all as and | III. | | |
| | location shall be permanently and visibly marked as "EV CAPABLE". | | | information on amperage of installed or future receptacles or EVSE, raceway method(s), wiring schematics and electrical load calculations. Plan design shall be based upon a 40-ampere minimum branch circuit. Required raceways and related components that are planned to be installed underground, enclosed, inaccessible or in | | | WATER CLOSET 1.28 GAL/FLUSH |

California

SUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.

NOT APPLICABLE RESPONSIBLE PARTY (IN: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

RESPON, PARTY 4.304 OUTDOOR WATER USE 4.304.1 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS. Residential developments shall comply with a local water efficient landscape ordinance or the current California Department of Water Resources' Model Water Efficient Landscape Ordinance (MWELO), whichever is more stringent. NOTES: 1. The Model Water Efficient Landscape Ordinance (MWELO) is located in the California Code Regulations, Title 23, Chapter 2.7, Division 2. MWELO and supporting documents, including water budget calculator, are available at: https://www.water.ca.gov/ DIVISION 4.4 MATERIAL CONSERVATION AND RESOURCE EFFICIENCY 4.406 ENHANCED DURABILITY AND REDUCED MAINTENANCE 4.406.1 RODENT PROOFING. Annular spaces around pipes, electric cables, conduits or other openings in sole/bottom plates at exterior walls shall be protected against the passage of rodents by closing such openings with cement mortar, concrete masonry or a similar method acceptable to the enforcing agency. 4.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING -4.408.1 CONSTRUCTION WASTE MANAGEMENT. Recycle and/or salvage for reuse a minimum of 65 percent of the non-hazardous construction and demolition waste in accordance with either Section 4.408.2, 4.408.3 or 4.408.4, or meet a more stringent local construction and demolition waste management ordinance. Exceptions: Excavated soil and land-clearing debris. Alternate waste reduction methods developed by working with local agencies if diversion or recycle facilities capable of compliance with this item do not exist or are not located reasonably close to the jobsite. 3. The enforcing agency may make exceptions to the requirements of this section when isolated jobsites are located in areas beyond the haul boundaries of the diversion facility.

4.408.2 CONSTRUCTION WASTE MANAGEMENT PLAN. Submit a construction waste management plan in conformance with Items 1 through 5. The construction waste management plan shall be updated as necessary and shall be available during construction for examination by the enforcing agency.

- 1. Identify the construction and demolition waste materials to be diverted from disposal by recycling, reuse on the project or salvage for future use or sale.
- 2. Specify if construction and demolition waste materials will be sorted on-site (source separated) or bulk mixed (single stream).
- 3. Identify diversion facilities where the construction and demolition waste material collected will be 4. Identify construction methods employed to reduce the amount of construction and demolition waste
- Specify that the amount of construction and demolition waste materials diverted shall be calculated by weight or volume, but not by both.

.408.3 WASTE MANAGEMENT COMPANY. Utilize a waste management company, approved by the enforcing agency, which can provide verifiable documentation that the percentage of construction and

demolition waste material diverted from the landfill complies with Section 4.408.1. Note: The owner or contractor may make the determination if the construction and demolition waste materials will be diverted by a waste management company.

4.408.4 WASTE STREAM REDUCTION ALTERNATIVE [LR]. Projects that generate a total combined weight of construction and demolition waste disposed of in landfills, which do not exceed 3.4 lbs./sq.ft. of the building area shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1

4.408.4.1 WASTE STREAM REDUCTION ALTERNATIVE. Projects that generate a total combined weight of construction and demolition waste disposed of in landfills, which do not exceed 2 pounds per square foot of the building area, shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1

4.408.5 DOCUMENTATION. Documentation shall be provided to the enforcing agency which demonstrates compliance with Section 4.408.2, items 1 through 5, Section 4.408.3 or Section 4.408.4.

- 1. Sample forms found in "A Guide to the California Green Building Standards Code (Residential)" located at www.hcd.ca.gov/CALGreen.html may be used to assist in
- documenting compliance with this section. 2. Mixed construction and demolition debris (C & D) processors can be located at the California Department of Resources Recycling and Recovery (CalRecycle).

4.410 BUILDING MAINTENANCE AND OPERATION

- 4.410.1 OPERATION AND MAINTENANCE MANUAL. At the time of final inspection, a manual, compact disc, web-based reference or other media acceptable to the enforcing agency which includes all of the following shall be placed in the building:
- Directions to the owner or occupant that the manual shall remain with the building throughout the life cycle of the structure. Operation and maintenance instructions for the following:
 - a. Equipment and appliances, including water-saving devices and systems, HVAC systems, photovoltaic systems, electric vehicle chargers, water-heating systems and other major appliances and equipment.
- b. Roof and yard drainage, including gutters and downspouts. c. Space conditioning systems, including condensers and air filters.
- Landscape irrigation systems.
- Water reuse systems. Information from local utility, water and waste recovery providers on methods to further reduce
- resource consumption, including recycle programs and locations. Public transportation and/or carpool options available in the area.
- 5. Educational material on the positive impacts of an interior relative humidity between 30-60 percent
- and what methods an occupant may use to maintain the relative humidity level in that range. 6. Information about water-conserving landscape and irrigation design and controllers which conserve
- water.
- 7. Instructions for maintaining gutters and downspouts and the importance of diverting water at least 5 feet away from the foundation.
- Information on required routine maintenance measures, including, but not limited to, caulking,
- painting, grading around the building, etc. 9. Information about state solar energy and incentive programs available.
- A copy of all special inspections verifications required by the enforcing agency or this code. Information from the Department of Forestry and Fire Protection on maintenance of defensible space around residential structures.
- 12. Information and/or drawings identifying the location of grab bar reinforcements.

4.410.2 RECYCLING BY OCCUPANTS. Where 5 or more multifamily dwelling units are constructed on a building site, provide readily accessible area(s) that serves all buildings on the site and are identified for the depositing, storage and collection of non-hazardous materials for recycling, including (at a minimum) paper, corrugated cardboard, glass, plastics, organic waster, and metals, or meet a lawfully enacted local recycling ordinance, if more restrictive.

Exception: Rural jurisdictions that meet and apply for the exemption in Public Resources Code Section 42649.82 (a)(2)(A) et seq. are note required to comply with the organic waste portion of this section.

DIVISION 4.5 ENVIRONMENTAL QUALITY

SECTION 4.501 GENERAL 4.501.1 Scope

The provisions of this chapter shall outline means of reducing the quality of air contaminants that are odorous, irritating and/or harmful to the comfort and well being of a building's installers, occupants and neighbors.

SECTION 4.502 DEFINITIONS 5.102.1 DEFINITIONS

The following terms are defined in Chapter 2 (and are included here for reference)

AGRIFIBER PRODUCTS. Agrifiber products include wheatboard, strawboard, panel substrates and door cores, not including furniture, fixtures and equipment (FF&E) not considered base building elements.

COMPOSITE WOOD PRODUCTS. Composite wood products include hardwood plywood, particleboard and medium density fiberboard. "Composite wood products" does not include hardboard, structural plywood, structural panels, structural composite lumber, oriented strand board, glued laminated timber, prefabricated wood I-joists or finger-jointed lumber, all as specified in California Code of regulations (CCR), title 17, Section 93120.1.

DIRECT-VENT APPLIANCE. A fuel-burning appliance with a sealed combustion system that draws all air for combustion from the outside atmosphere and discharges all flue gases to the outside atmosphere.



THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

| | CULVER CITY ADU STANDARD PLANS CULVER CITY, CA | Cal Green Residential Requirements |
|-------|--|---------------------------------------|
| ()EI | DATE 01/03/2024 SHEET | |

G-20

PUBL

California

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE **RESIDENTIAL MANDATORY MEASURES, SHEET 2** (January 2023)

N/A RESPON PARTY PARTY TABLE 4.504. MAXIMUM INCREMENTAL REACTIVITY (MIR). The maximum change in weight of ozone formed by adding a compound to the "Base Reactive Organic Gas (ROG) Mixture" per weight of compound added, expressed to (Less Water and L hundredths of a gram (g O3/g ROC). SEALANTS Note: MIR values for individual compounds and hydrocarbon solvents are specified in CCR, Title 17, Sections 94700 and 94701. ARCHITECTURAL MOISTURE CONTENT. The weight of the water in wood expressed in percentage of the weight of the oven-dry wood. MARINE DECK PRODUCT-WEIGHTED MIR (PWMIR). The sum of all weighted-MIR for all ingredients in a product subject to this NONMEMBRANE article. The PWMIR is the total product reactivity expressed to hundredths of a gram of ozone formed per gram of ROADWAY product (excluding container and packaging). Note: PWMIR is calculated according to equations found in CCR, Title 17, Section 94521 (a). SINGLE-PLY ROC REACTIVE ORGANIC COMPOUND (ROC). Any compound that has the potential, once emitted, to contribute to OTHER ozone formation in the troposphere. SEALANT PRIME VOC. A volatile organic compound (VOC) broadly defined as a chemical compound based on carbon chains or rings ARCHITECTURAL with vapor pressures greater than 0.1 millimeters of mercury at room temperature. These compounds typically contain hydrogen and may contain oxygen, nitrogen and other elements. See CCR Title 17. Section 94508(a). NON-POROUS 4.503 FIREPLACES POROUS 4.503.1 GENERAL. Any installed gas fireplace shall be a direct-vent sealed-combustion type. Any installed woodstove or pellet stove shall comply with U.S. EPA New Source Performance Standards (NSPS) emission limits as MODIFIED BITUM applicable, and shall have a permanent label indicating they are certified to meet the emission limits. Woodstoves, MARINE DECK pellet stoves and fireplaces shall also comply with applicable local ordinances. OTHER 4.504 POLLUTANT CONTROL 4.504.1 COVERING OF DUCT OPENINGS & PROTECTION OF MECHANICAL EQUIPMENT DURING CONSTRUCTION. At the time of rough installation, during storage on the construction site and until final startup of the heating, cooling and ventilating equipment, all duct and other related air distribution component openings shall be covered with tape, plastic, sheet metal or other methods acceptable to the enforcing agency to reduce the amount of water, dust or debris which may enter the system. 4.504.2 FINISH MATERIAL POLLUTANT CONTROL. Finish materials shall comply with this section. **TABLE 4.50** 4.504.2.1 Adhesives, Sealants and Caulks. Adhesives, sealant and caulks used on the project shall meet the ARCHITEC requirements of the following standards unless more stringent local or regional air pollution or air quality management district rules apply: GRAMS OF VO COMPOUNDS 1. Adhesives, adhesive bonding primers, adhesive primers, sealants, sealant primers and caulks COATING CAT shall comply with local or regional air pollution control or air quality management district rules where applicable or SCAQMD Rule 1168 VOC limits, as shown in Table 4.504.1 or 4.504.2, as applicable. FLAT COATING Such products also shall comply with the Rule 1168 prohibition on the use of certain toxic compounds (chloroform, ethylene dichloride, methylene chloride, perchloroethylene and NON-FLAT COA tricloroethylene), except for aerosol products, as specified in Subsection 2 below. NONFLAT-HIGH 2. Aerosol adhesives, and smaller unit sizes of adhesives, and sealant or caulking compounds (in SPECIALTY CO units of product, less packaging, which do not weigh more than 1 pound and do not consist of more than 16 fluid ounces) shall comply with statewide VOC standards and other requirements, including ALUMINUM RC prohibitions on use of certain toxic compounds, of California Code of Regulations, Title 17, commencing with section 94507. BASEMENT SP 4.504.2.2 Paints and Coatings. Architectural paints and coatings shall comply with VOC limits in Table 1 of **BITUMINOUS** the ARB Architectural Suggested Control Measure, as shown in Table 4.504.3, unless more stringent local limits apply. The VOC content limit for coatings that do not meet the definitions for the specialty coatings categories BITUMINOUS F listed in Table 4.504.3 shall be determined by classifying the coating as a Flat, Nonflat or Nonflat-High Gloss BOND BREAKE coating, based on its gloss, as defined in subsections 4.21, 4.36, and 4.37 of the 2007 California Air Resources Board, Suggested Control Measure, and the corresponding Flat, Nonflat or Nonflat-High Gloss VOC limit in CONCRETE CL Table 4.504.3 shall apply. CONCRETE/M/ 4.504.2.3 Aerosol Paints and Coatings. Aerosol paints and coatings shall meet the Product-weighted MIR DRIVEWAY SE Limits for ROC in Section 94522(a)(2) and other requirements, including prohibitions on use of certain toxic compounds and ozone depleting substances, in Sections 94522(e)(1) and (f)(1) of California Code of DRY FOG COA Regulations, Title 17, commencing with Section 94520; and in areas under the jurisdiction of the Bay Area Air Quality Management District additionally comply with the percent VOC by weight of product limits of Regulation FAUX FINISHIN Rule 49. FIRE RESISTIN 4.504.2.4 Verification. Verification of compliance with this section shall be provided at the request of the OOR COAT enforcing agency. Documentation may include, but is not limited to, the following: FORM-RELEAS . Manufacturer's product specification. Field verification of on-site product containers. GRAPHIC ARTS HIGH TEMPER/ INDUSTRIAL M TABLE 4.504.1 - ADHESIVE VOC LIMIT_{1.2} LOW SOLIDS C (Less Water and Less Exempt Compounds in Grams per Liter) MAGNESITE CI ARCHITECTURAL APPLICATIONS VOC LIMIT MASTIC TEXTL 50 INDOOR CARPET ADHESIVES METALLIC PIGN CARPET PAD ADHESIVES 50 MULTICOLOR 150 OUTDOOR CARPET ADHESIVES PRETREATMEN 100 WOOD FLOORING ADHESIVES PRIMERS, SEA RUBBER FLOOR ADHESIVES 60 REACTIVE PEN 50 SUBFLOOR ADHESIVES RECYCLED CO CERAMIC TILE ADHESIVES 65 ROOF COATING 50 VCT & ASPHALT TILE ADHESIVES RUST PREVEN DRYWALL & PANEL ADHESIVES 50 SHELLACS 50 COVE BASE ADHESIVES CLEAR 70 MULTIPURPOSE CONSTRUCTION ADHESIVE OPAQUE STRUCTURAL GLAZING ADHESIVES 100 SPECIALTY PR 250 SINGLE-PLY ROOF MEMBRANE ADHESIVES UNDERCOATE OTHER ADHESIVES NOT LISTED 50 STAINS STONE CONSC SPECIALTY APPLICATIONS 510 SWIMMING PC PVC WELDING TRAFFIC MARK CPVC WELDING 490 325 TUB & TILE REI ABS WELDING PLASTIC CEMENT WELDING 250 WATERPROOF 550 WOOD COATIN ADHESIVE PRIMER FOR PLASTIC 80 WOOD PRESE CONTACT ADHESIVE 250 ZINC-RICH PRI SPECIAL PURPOSE CONTACT ADHESIVE 140 GRAMS OF STRUCTURAL WOOD MEMBER ADHESIVE EXEMPT COMP TOP & TRIM ADHESIVE 250 2. THE SPECIF SUBSTRATE SPECIFIC APPLICATIONS ARE LISTED IN 3. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY METAL TO METAL 30 THE CALIFORNIA AIR RESOURCES BOARD, ARCHITECTURAL COATINGS 50 PLASTIC FOAMS SUGGESTED CONTROL MEASURE, FEB. 1, 2008. MORE INFORMATION IS AVAILABLE FROM THE AIR RESOURCES BOARD. POROUS MATERIAL (EXCEPT WOOD) 50 30 WOOD 80 FIBERGLASS 1. IF AN ADHESIVE IS USED TO BOND DISSIMILAR SUBSTRATES TOGETHER, THE ADHESIVE WITH THE HIGHEST VOC CONTENT SHALL BE ALLOWED. 2. FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THIS TABLE, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 1168.

| 4.2 - SEALANT VOC LIMIT | | | | | | | | |
|-------------------------------|---------------|--|--|--|--|--|--|--|
| Less Exempt Compounds in Grar | ns per Liter) | | | | | | | |
| | VOC LIMIT | | | | | | | |
| NL. | 250 | | | | | | | |
| | 760 | | | | | | | |
| EROOF | 300 | | | | | | | |
| | 250 | | | | | | | |
| OF MEMBRANE | 450 | | | | | | | |
| | 420 | | | | | | | |
| ERS | | | | | | | | |
| NL. | | | | | | | | |
| s | 250 | | | | | | | |
| | 775 | | | | | | | |
| MINOUS | 500 | | | | | | | |
| | 760 | | | | | | | |
| | 750 | | | | | | | |
| | | | | | | | | |

| | SS WATER & LESS EXEMPT |
|--------------------------|------------------------|
| EGORY | VOC LIMIT |
| 38 | 50 |
| ATINGS | 100 |
| H GLOSS COATINGS | 150 |
| DATINGS | 100 |
| OF COATINGS | 400 |
| PECIALTY COATINGS | 400 |
| ROOF COATINGS | 50 |
| ROOF PRIMERS | 350 |
| ERS | 350 |
| JRING COMPOUNDS | 350 |
| ASONRY SEALERS | 100 |
| ALERS | 50 |
| TINGS | 150 |
| NG COATINGS | 350 |
| E COATINGS | 350 |
| NGS | 100 |
| SE COMPOUNDS | 250 |
| S COATINGS (SIGN PAINTS) | 500 |
| | |
| ATURE COATINGS | 420 |
| | 250 |
| COATINGS1 | 120 |
| EMENT COATINGS | 450 |
| JRE COATINGS | 100 |
| MENTED COATINGS | 500 |
| COATINGS | 250 |
| NT WASH PRIMERS | 420 |
| LERS, & UNDERCOATERS | 100 |
| NETRATING SEALERS | 350 |
| DATINGS | 250 |
| GS | 50 |
| ITATIVE COATINGS | 250 |
| | |
| | 730 |
| | 550 |
| RIMERS, SEALERS & | 100 |
| | 250 |
| OLIDANTS | 450 |
| OL COATINGS | 340 |
| KING COATINGS | 100 |
| FINISH COATINGS | 420 |
| FING MEMBRANES | 250 |
| NGS | 275 |
| RVATIVES | 350 |
| | 340 |
| IMERS | |

| | - | | <u> (oundury 2020)</u> | | | | |
|------|--------------|------------------|--|--|-----------|-----|---------|
| Y | N/A | RESPON. PARTY | | | Ľ | N/A | PARTY |
| | | | | | | | |
| | | | TABLE 4.504.5 - FORMALDEHYDE LIMITS | | | | |
| | | | MAXIMUM FORMALDEHYDE EMISSIONS IN PARTS PER MILLION | | | | |
| | | | PRODUCT CURRENT LIN HARDWOOD PLYWOOD VENEER CORE 0.05 | | 回 | ╡ | |
| | | | HARDWOOD PLYWOOD COMPOSITE CORE 0.05 | | | | |
| | | | PARTICLE BOARD 0.09 | | | | |
| | | | MEDIUM DENSITY FIBERBOARD 0.11 | | | | |
| | | | THIN MEDIUM DENSITY FIBERBOARD ₂ 0.13 1. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIE | D | | | |
| | | | BY THE CALIF. AIR RESOURCES BOARD, AIR TOXICS CONTROL MEASURE FOR COMPOSITE WOOD AS TESTED IN ACCORDANC | E | \square | | |
| | | | WITH ASTM E 1333. FOR ADDITIONAL INFORMATION, SEE CALIF CODE OF REGULATIONS, TITLE 17, SECTIONS 93120 THROUGH | f | Ħ | ╘ | |
| | | | 93120.12. | | | | |
| | | | THIN MEDIUM DENSITY FIBERBOARD HAS A MAXIMUM THICKNESS OF 5/16" (8 MM). | | | | |
| | | | DIVISION 4.5 ENVIRONMENTAL QUALITY (conti | nued) | | | |
| | | | 4.504.3 CARPET SYSTEMS. All carpet installed in the building interior shall meet the req | uirements of the California | | | |
| | | | Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emissi California Specification 01350) | | | | |
| | | | See California Department of Public Health's website for certification programs and testing | labs. | | | |
| | | | https://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx. | | | | |
| _ | | | 4.504.3.1 Carpet cushion. All carpet cushion installed in the building interior shall r | | | | |
| | _ | | California Department of Public Health, "Standard Method for the Testing and Evalu Chemical Emissions from Indoor Sources Using Environmental Chambers," Version (Emission testing method for California Specification 01350) | ation of Volatile Organic 1.2, January 2017 | | | |
| | | | See California Department of Public Health's website for certification programs and | testing labs. | | | |
| | | | https://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx. | | | | |
| | | | 4.504.3.2 Carpet adhesive. All carpet adhesive shall meet the requirements of Tab | | | | |
| _ | _ | | 4.504.4 RESILIENT FLOORING SYSTEMS. Where resilient flooring is installed, at least resilient flooring shall meet the requirements of the California Department of Public Health Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Version 1.2, January 2017 (Emission testing method for California Specification 01350) | "Standard Method for the | | = | |
| | | | See California Department of Public Health's website for certification programs and testing | labs. | | | |
| | | | hhtps://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx. | | | | |
| | | | 4.504.5 COMPOSITE WOOD PRODUCTS. Hardwood plywood, particleboard and mediu composite wood products used on the interior or exterior of the buildings shall meet the re- | quirements for | | | |
| | | | formaldehyde as specified in ARB's Air Toxics Control Measure for Composite Wood (17 o by or before the dates specified in those sections, as shown in Table 4.504.5 | CR 93120 et seq.), | | | |
| | | | 4.504.5.1 Documentation. Verification of compliance with this section shall be pro- | vided as requested | | | |
| | | | by the enforcing agency. Documentation shall include at least one of the following: 1. Product certifications and specifications. | | | | |
| | | | Chain of custody certifications. Product labeled and invoiced as meeting the Composite Wood Products in | egulation (see | | | |
| | | | CCR, Title 17, Section 93120, et seq.).4. Exterior grade products marked as meeting the PS-1 or PS-2 standards of | of the Engineered | | | |
| | | | Wood Association, the Australian AS/NZS 2269, European 636 3S stands 0121, CSA 0151, CSA 0153 and CSA 0325 standards. | ards, and Canadian CSA | | | |
| | | | Other methods acceptable to the enforcing agency. | | | | |
| | | | 4.505 INTERIOR MOISTURE CONTROL | | | | |
| | | | 4.505.1 General. Buildings shall meet or exceed the provisions of the California Building | | | | |
| | | | 4.505.2 CONCRETE SLAB FOUNDATIONS. Concrete slab foundations required to have California Building Code, Chapter 19, or concrete slab-on-ground floors required to have a California Residential Code, Chapter 5, shall also comply with this section. | | | | |
| | | | 4.505.2.1 Capillary break. A capillary break shall be installed in compliance with a | t least one of the | | | |
| | | | following: | | | | |
| | | | A 4-inch (101.6 mm) thick base of 1/2 inch (12.7mm) or larger clean aggre a vapor barrier in direct contact with concrete and a concrete mix design, | which will address bleeding, | | | |
| | | | shrinkage, and curling, shall be used. For additional information, see Am ACI 302.2R-06. | erican Concrete Institute, | | | |
| | | | Other equivalent methods approved by the enforcing agency. A slab design specified by a licensed design professional. | | | | |
| - | | | 4.505.3 MOISTURE CONTENT OF BUILDING MATERIALS. Building materials with visit shall not be installed. Wall and floor framing shall not be enclosed when the framing member and the shall not be enclosed when the framing member of the shall not be enclosed when the framing member of the shall not be enclosed when the framing member of the shall not be enclosed when the framing member of the shall not be enclosed when the framing member of the shall not be enclosed when the framing member of the shall not be enclosed when the framing member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the frame member of the shall not be enclosed when the shall not be enclosed when the frame member of the shall not be enclosed when the shall | | | | |
| | | | moisture content. Moisture content shall be verified in compliance with the following: | | | | |
| | | | Moisture content shall be determined with either a probe-type or contact-type me moisture verification methods may be approved by the enforcing agency and shall be approved by the enforcence agency agency | | | | |
| | | | found in Section 101.8 of this code. Moisture readings shall be taken at a point 2 feet (610 mm) to 4 feet (1219 mm) of each piece verified. | from the grade stamped end | | | |
| | | | At least three random moisture readings shall be performed on wall and floor fra acceptable to the enforcing agency provided at the time of approval to enclose to | | | | |
| | | | Insulation products which are visibly wet or have a high moisture content shall be replaced | or allowed to dry prior to | | | |
| | | | enclosure in wall or floor cavities. Wet-applied insulation products shall follow the manufa- recommendations prior to enclosure. | cturers' drying | | | |
| _ | _ | | 4.506 INDOOR AIR QUALITY AND EXHAUST 4.506.1 Bathroom exhaust fans. Each bathroom shall be mechanically ventilated and sh | all comply with the | | | |
| | | | following: | an compry man me | | | |
| | | | Fans shall be ENERGY STAR compliant and be ducted to terminate outside the Unless functioning as a component of a whole house ventilation system, fans m humidity control. | | | | |
| | | | a. Humidity controls shall be capable of adjustment between a relative humi equal to 50% to a maximum of 80%. A humidity control may utilize manu | | | | |
| | | | adjustment. b. A humidity control may be a separate component to the exhaust fan and i | | | | |
| | | | integral (i.e., built-in) | | | | |
| | | | Notes: 1. For the purposes of this section, a bathroom is a room which contains a b | athtub shower or | | | |
| | | | Lighting integral to bathroom exhaust fans shall comply with the California | | | | |
| - | | | 4.507 ENVIRONMENTAL COMFORT 4.507.2 HEATING AND AIR-CONDITIONING SYSTEM DESIGN. Heating and air conditionsized, designed and have their equipment selected using the following methods: | oning systems shall be | | | |
| | | | The heat loss and heat gain is established according to ANSI/ACCA 2 Manual J Load Calculation), ASHRAE handbooks or other equivalent design software or r | | | | |
| | | | Duct systems are sized according to ANSI/ACCA 1 Manual D - 2014 (Residential ASHRAE handbooks or other equivalent design software or methods. | | | | |
| | | | Select heating and cooling equipment according to ANSI/ACCA 3 Manual S - 20 Equipment Selection), or other equivalent design software or methods. | 14 (Residential | | | |
| | | | Exception: Use of alternate design temperatures necessary to ensure the system | functions are | | | |
| | | | acceptable. | | | | |
| | | PELICE | | | | | HARR - |
| 1 IS | . <i>E</i> C | une ⊔SEľ | ED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE I | WARKER AND AND FUS THE END US | - 14 A | aSI | m = S A |

NOT APPLICABLE RESPONSIBLE PARTY (in: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.) RESPON PARTY

CHAPTER 7 INSTALLER & SPECIAL INSPECTOR QUALIFICATIONS 702 QUALIFICATIONS

702.1 INSTALLER TRAINING. HVAC system installers shall be trained and certified in the proper installation of HVAC systems including ducts and equipment by a nationally or regionally recognized training or certification program. Uncertified persons may perform HVAC installations when under the direct supervision and esponsibility of a person trained and certified to install HVAC systems or contractor licensed to install HVAC systems. Examples of acceptable HVAC training and certification programs include but are not limited to the following:

- State certified apprenticeship programs. Public utility training programs.
- 3. Training programs sponsored by trade, labor or statewide energy consulting or verification organizations. 4. Programs sponsored by manufacturing organizations. 5. Other programs acceptable to the enforcing agency.

702.2 SPECIAL INSPECTION [HCD]. When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition to other certifications or qualifications acceptable to the enforcing agency, the following certifications or education may be considered by the enforcing agency when evaluating the qualifications of a special inspector:

- 1. Certification by a national or regional green building program or standard publisher. 2. Certification by a statewide energy consulting or verification organization, such as HERS raters, building
- performance contractors, and home energy auditors. Successful completion of a third party apprentice training program in the appropriate trade. 4. Other programs acceptable to the enforcing agency.

- Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.
- 2. HERS raters are special inspectors certified by the California Energy Commission (CEC) to rate homes in California according to the Home Energy Rating System (HERS).

[BSC] When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition, the special inspector shall have a certification from a recognized state, national or international association, as determined by the local agency. The area of certification shall be closely related to the primary job function, as determined by the local agency.


Note: Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.

703 VERIFICATIONS


703.1 DOCUMENTATION. Documentation used to show compliance with this code shall include but is not limited to, construction documents, plans, specifications, builder or installer certification, inspection reports, or other methods acceptable to the enforcing agency which demonstrate substantial conformance. When specific documentation or special inspection is necessary to verify compliance, that method of compliance will be specified in the appropriate section or identified applicable checklist.



THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

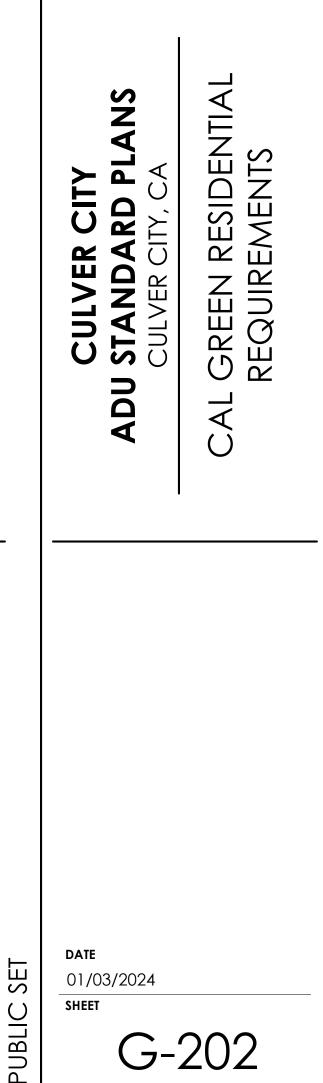

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE CALIFORNIA GREEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.

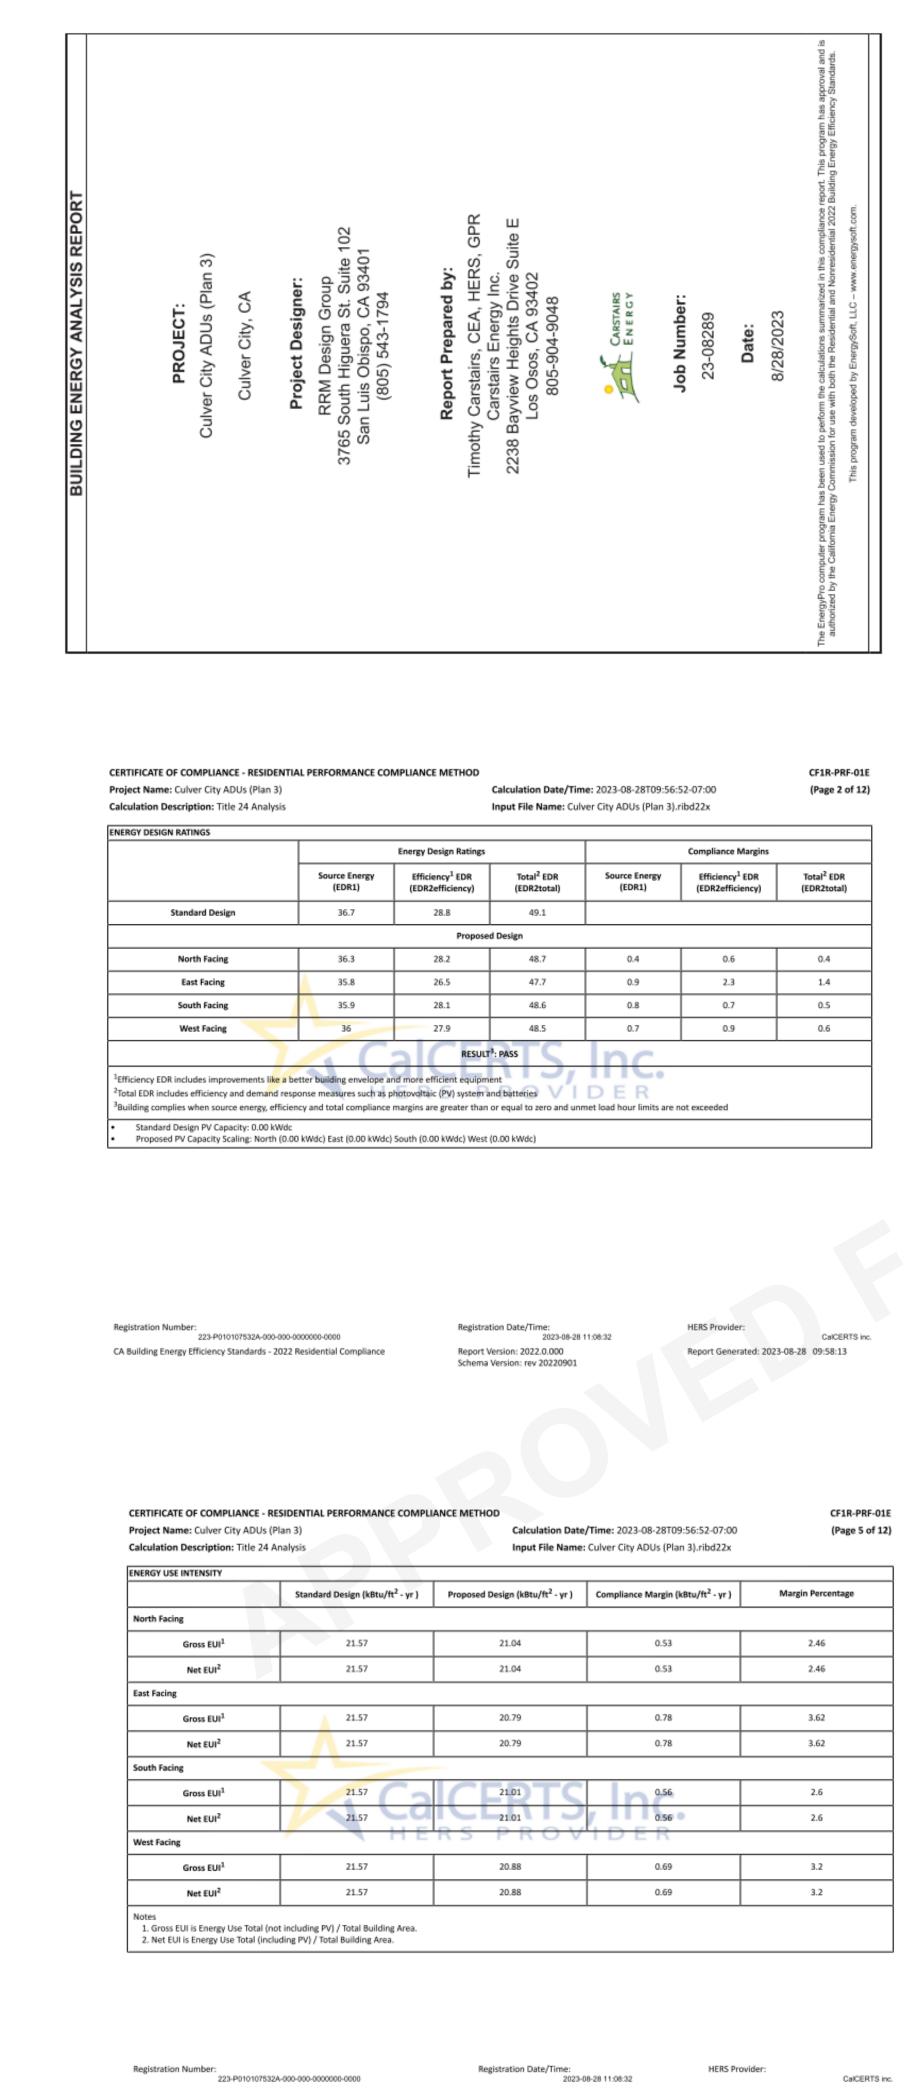

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000 Schema Version: rev 20220901 Report Generated: 2023-08-28 09:58:13

| CONTENTS | 1 npliance 2 mary 15 nary 21 | |
|-------------------|---|--|
| TABLE OF CONTENTS | Cover Page Table of Contents Form CF1R-PRF-01-E Certificate of Compliance Form RMS-1 Residential Measures Summary Form MF1R Mandatory Measures Summary Room Load Summary | |

Project Name: Culver City ADUs (Plan 3) Calculation Description: Title 24 Analysis

| GENER | AL INFORMATION | | | | | | | | | |
|-------|--|--|--------------------------|--|-----------------------------|--|--|--|--|--|
| 01 | Project Name | Culver City ADUs (Plan 3) | Jiver City ADUs (Plan 3) | | | | | | | |
| 02 | Run Title | Title 24 Analysis | | | | | | | | |
| 03 | Project Location | - | | | | | | | | |
| 04 | City | Culver City | 05 | Standards Version | 2022 | | | | | |
| 06 | Zip code | | 07 | Software Version | EnergyPro 9.2 | | | | | |
| 08 | Climate Zone | 8 | 09 | Front Orientation (deg/ Cardinal) | All orientations | | | | | |
| 10 | Building Type | Single family | 11 | Number of Dwelling Units | 1 | | | | | |
| 12 | Project Scope | Newly Constructed | 13 | Number of Bedrooms | 2 | | | | | |
| 14 | Addition Cond. Floor Area (ft ²) | 0 | 15 | Number of Stories | 1 | | | | | |
| 16 | Existing Cond. Floor Area (ft ²) | n/a | 17 | Fenestration Average U-factor | 0.3 | | | | | |
| 18 | Total Cond. Floor Area (ft ²) | 806 | 19 | Glazing Percentage (%) | 14.52% | | | | | |
| 20 | ADU Bedroom Count | n/a | 21 | ADU Conditioned Floor Area | n/a | | | | | |
| 22 | Fuel Type | All electric | 23 | Occupancy U: | No | | | | | |
| | | | 1 | | | | | | | |
| COMPL | IANCE RESULTS | HERSP | R | OVIDER | | | | | | |
| | 01 Building Complies with Computer | Performance | | | | | | | | |
| | 02 This building incorporates feature | s that require field testing and/or verification | by a c | ertified HERS rater under the supervision of a | CEC-approved HERS provider. | | | | | |
| | 03 This building incorporates one or | more Special Features shown below | | | | | | | | |

Registration Number: 223-P010107532A-000-000-0000000-0000 CA Building Energy Efficiency Standards - 2022 Residential Compliance

| roject Name: Culver C | ity ADUs (Plan 3) | | Calculation Date/Time | : 2023-08-28T09:56:52-07:00 | | (Page 4 of 12 |
|--|--|---|--|---|-----------------------------|-----------------------------|
| alculation Description | : Title 24 Analysis | | Input File Name: Culve | r City ADUs (Plan 3).ribd22x | | |
| NERGY USE SUMMARY | | | | | | |
| Energy Use | Standard Design Source Energy (EDR1) (kBtu/ft ² -yr) | Standard Design TDV Energy (EDR2) (kTDV/ft ² -yr) | Proposed Design Source Energy (EDR1) (kBtu/ft ² -yr) | Proposed Design TDV Energy (EDR2) (kTDV/ft ² -yr) | Compliance Margin (EDR1) | Compliance Margin (EDR2) |
| Space Heating | 0.07 | 0.47 | 0.71 | 5.15 | -0.64 | -4.68 |
| Space Cooling | 1.28 | 29.17 | 1.01 | 29.08 | 0.27 | 0.09 |
| IAQ Ventilation | 0.45 | 4.7 | 0.45 | 4.7 | 0 | 0 |
| Water Heating | 2.21 | 23.31 | 1.54 | 17.31 | 0.67 | 6 |
| Self Utilization/Flexibility Credit | ٨ | | | 0 | | 0 |
| South Facing Efficiency Compliance Total | 4.01 | 57.65 | 3.71 | 56.24 | 0.3 | 1.41 |
| Space Heating | 0.07 | 0.47 | 0.76 | 5.58 | -0.69 | -5.11 |
| Space Cooling | 1.28 | H ^{29:17} R S | P R 0.98 V 1 | DE R ^{28.15} | 0.3 | 1.02 |
| IAQ Ventilation | 0.45 | 4.7 | 0.45 | 4.7 | 0 | 0 |
| Water Heating | 2.21 | 23.31 | 1.54 | 17.35 | 0.67 | 5.96 |
| Self Utilization/Flexibility Credit | | | | 0 | | 0 |
| West Facing Efficiency Compliance Total | 4.01 | 57.65 | 3.73 | 55.78 | 0.28 | 1.87 |

Registration Number: 223-P010107532A-000-000-0000000-0000 CA Building Energy Efficiency Standards - 2022 Residential Compliance

| CERTIFICATE OF C | OMPLIANCE - R | RESIDENTIAL PERFORMA | NCE COMPLIANCE M | ETHOD | | | | | | c | F1R-PRF-01 |
|--|-------------------|--|-----------------------------|------------------------|-----------|------------------|---------------|----------------------|----------------------------|----------------------|------------------------------|
| Project Name: Cu | | | | | | | | 09:56:52-07:0 | | (8 | Page 6 of 12 |
| Calculation Description: Title 24 Analysis Input File Name: Culver City ADUs (Plan 3).ribd22x | | | | | | | | | | | |
| REQUIRED PV SYST | EMS | | | | | | | | | | |
| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 10 | 11 | 12 |
| DC System Size (kWdc) | Exception | Module Type | Array Type | ower Electronics | CFI | Azimuth (deg) | Tilt Input | Array Angle (deg) | Tilt: (x in 12) | Inverter Eff. (%) | Annual Solar Acces (%) |
| 0 | | Standard (14-17%) | Fixed | none | true | n/a | n/a | n/a | n/a | n/a | |
| REQUIRED SPECIAL | FEATURES | | | | | | | | | | |
| The following are fe | satures that must | be installed as condition for | r meeting the modeled | energy performance for | or this c | computer anal | vsis. | | | | |
| | ummary of the fe | atures that must be field-ver les below. Registered CF2Rs | | | | | eled ener | gy performanc | e for this com | puter analysis. | Additional |
| Indoor air quality ventilation Kitchen range hood Verified Refrigerant Charge Airflow in habitable rooms (SC3.1.4.1.7) Verified heat pump rated heating capacity Wall-mounted thermostat in zones greater than 150 ft2 (SC3.4.5) Ductless indoor units located entirely in conditioned space (SC3.1.4.1.8) | | | | | | | | | | | |
| BUILDING - FEATUR | RES INFORMATIO | N | | | | | | | | | |
| 01 | | 02 | 03 | 04 | | 05 | | | 06 | | 07 |
| Project Na | ime Co | nditioned Floor Area (ft ²) | Number of Dwelling Units | Number of Bedroo | ms | Number of | Zones | | f Ventilation s Systems | | r of Water g Systems |
| | | | | | | | | | | | |

Registration Number: 223-P010107532A-000-000-000000-0000 CA Building Energy Efficiency Standards - 2022 Residential Compliance Registration Date/Time: 2023-08-28 11:08:32 Report Version: 2022.0.000 Schema Version: rev 20220901

HERS Provider: CalCERTS inc. Report Generated: 2023-08-28 09:58:13

| Project Name: Culver City ADUs (Plan 3) Calculation Description: Title 24 Analysis | | | | | | Calculation Date/Time: 2023-08-28T09:56:52-07:00 Input File Name: Culver City ADUs (Plan 3).ribd22x | | | | | | | | (Page 7 of 1 | | |
|---|---------------|------------------|-------------|--------------------------|---------------|--|-----------------------|----------------------------|----------|-----------|---------------------------|-------------------------|-------------------|-----------------|---------------|--|
| | | 2 + Filler Joint | | | | | | | er carre | in only i | 1005(11011) | IN BOLLS | | | | |
| ONE INFORMATION | | | | | | | | | | | | | | | | |
| 01 | \rightarrow | 02 | | 03 | | 04 | | | | 05 | | 06 | | | 07 | |
| Zone Name | | Zone Type | HVAC | System Nam | e z | one Floor | Area (ft ³ | 2) | Avg. Ce | eiling H | eight W | ater Heating S | ystem 1 | | Status | |
| Living Area | | Conditioned | HV | /AC System1 | | 80 | 6 | | | 8 | | DHW Sys | 1 | | New | |
| PAQUE SURFACES | | | | | | | | | | | | | | | | |
| 01 | | 02 | 0 | 3 | | 04 | | 05 | | | 06 | 0 | 7 | | 08 | |
| Name | | Zone | Constr | uction | A | imuth | Or | ientatio | n | Gross | s Area (ft ²) | Window Area | and Door (ft2) | | Tilt (deg) | |
| Front Wall | | Living Area | R21 | Wall | | 0 | | Front | | | 208 | 6 | 0 | | 90 | |
| Left Wall | | Living Area | R21 | Wall | | 90 | | Left | | 248 | | 37 | | 90 | | |
| Rear Wall | | Living Area | R21 | Wall | | 180 | | Back | | | 208 | (| 0 | | 90 | |
| Right Wall | | Living Area | R21 | Wall | | 270 | | Right 248 | | 4 | 40 | | 90 | | | |
| Roof | | Living Area | R-30 Ro | of Attic | | n/a | | n/a | ı/a 806 | | 806 | n/a | | | n/a | |
| | | | | | | | | | · | | I | | | | | |
| 01 | | 02 | | 3HE | R S | P | R | 05 | <u>~</u> | | 06 | | - | | | |
| | + | | | - | □ ⊃ 04 F | | Deed | | | | | 07 e Radiant Barrier | | 08 Cool Roof | | |
| Name | - | onstruction | | Type Roof Rise (x in 12) | |) ROOT | Roof Reflectance | | | | | | | | | |
| Attic Living Area | Attic | RoofLiving Area | Venti | llated | | 4 | | 0.1 | | | 0.85 | N | 0 | No | | |
| ENESTRATION / GLAZ | ING | | | | | | | | | | | | | | | |
| 01 | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 1 | 10 | 11 | 12 | 13 | | 14 | |
| Name | Туре | Surface | Orientation | Azimuth | Width (ft) | Height (ft) | Mult. | Area (ft ²) | U-fa | octor | U-factor Source | SHGC | SHGC So | urce | Exterior Shad | |
| 11 W | indow | Front Wall | Front | 0 | | | 1 | 20 | 0. | .3 | NFRC | 0.23 | NFRC | - | Bug Screen | |
| 10 W | indow | Front Wall | Front | 0 | | | 1 | 20 | 0 | .3 | NFRC | 0.23 | NFRC | 5 | Bug Screen | |
| 12 W | indow | Left Wall | Left | 90 | | | 1 | 9 | 0 | .3 | NFRC | 0.23 | NFRC | | Bug Screen | |

Registration Number: 223-P010107532A-000-000-0000000-0000 CA Building Energy Efficiency Standards - 2022 Residential Compliance

| NERGY USE SUMMARY | | | | | | - |
|--|--|---|--|---|-----------------------------|----------------------------|
| Energy Use | Standard Design Source Energy (EDR1) (kBtu/ft ² -yr) | Standard Design TDV Energy (EDR2) (kTDV/ft ² -yr) | Proposed Design Source Energy (EDR1) (kBtu/ft ² -yr) | Proposed Design TDV Energy (EDR2) (kTDV/ft ² -yr) | Compliance Margin (EDR1) | Compliance Margin (EDR2 |
| Space Heating | 0.07 | 0.47 | 0.88 | 6.51 | -0.81 | -6.04 |
| Space Cooling | 1.28 | 29.17 | 0.99 | 27.98 | 0.29 | 1.19 |
| IAQ Ventilation | 0.45 | 4.7 | 0,45 | 4.7 | 0 | 0 |
| Water Heating | 2.21 | 23.31 | 1.55 | 17.37 | 0.66 | 5.94 |
| Self Utilization/Flexibility Credit | | | | 0 | | 0 |
| North Facing Efficiency Compliance Total | 4.01 | 57,65 | | 56.56 | 0.14 | 1.09 |
| Space Heating | 0.07 | 0.47 | 0.77 | 5.55 | -0.7 | -5.08 |
| Space Cooling | 1.28 | H 29.17 R S | PROVI | D E R _{25.42} | 0.38 | 3.75 |
| IAQ Ventilation | 0.45 | 4.7 | 0.45 | 4.7 | 0 | 0 |
| Water Heating | 2.21 | 23.31 | 1.55 | 17.35 | 0.66 | 5.96 |
| Self Utilization/Flexibility Credit | | | | 0 | | O |
| East Facing Efficiency Compliance Total | 4.01 | 57.65 | 3.67 | 53.02 | 0.34 | 4.63 |

Calculation Date/Time: 2023-08-28T09:56:52-07:00

| gistration Number: | |
|--|--|
| 223-P010107532A-000-000-0000000-0000 | |
| A Building Energy Efficiency Standards - 2022 Residential Compliance | |

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Culver City ADUs (Plan 3)

Registration Date/Time: 2023-08-28 11:08:32 Report Version: 2022.0.000 Schema Version: rev 20220901

HERS Provider: CalCERTS inc. Report Generated: 2023-08-28 09:58:13

CF1R-PRF-01E

(Page 3 of 12)

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD Calculation Date/Time: 2023-08-28T09:56:52-07:00 Input File Name: Culver City ADUs (Plan 3).ribd22x

CF1R-PRF-01E (Page 1 of 12)

Registration Date/Time: 2023-08-28 11:08:32 Report Version: 2022.0.000 Schema Version: rev 20220901

HERS Provider: CalCERTS inc. Report Generated: 2023-08-28 09:58:13

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Registration Date/Time: 2023-08-28 11:08:32 Report Version: 2022.0.000 Schema Version: rev 20220901

HERS Provider: CalCERTS inc. Report Generated: 2023-08-28 09:58:13


CF1R-PRF-01E

Registration Date/Time: 2023-08-28 11:08:32 Report Version: 2022.0.000 Schema Version: rev 20220901

HERS Provider:

CalCERTS inc. Report Generated: 2023-08-28 09:58:13



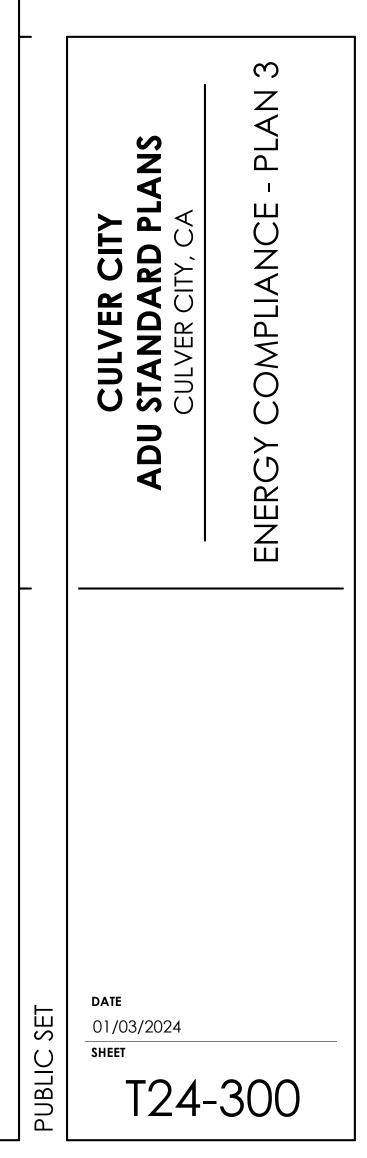

| | s://2927-01_CU22_ADU_Culver_City/2927-01_Culver City ADUs.rvt |
|------------|---|
| | er_City/2927-01_Culv |
| | _Culver_(|
| | |
| | CU22_ADU |
| 1:05 | Docs://2927-01 |
| 1/3/2024 1 | Autodesk |

| 10 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | The second state of the second of the second state of the second s |
|--|--|
| used. Review the re (04/2022) Building Envelope: | used. Review the respective section for more information. (04/2022) uilding Envelope: |
| § 110.6(a)1: | Air Leakage. Manufactured fenestration, exterior doors, and exterior pet doors must limit air leakage to 0.3 CFM per square foot or less when tested per NFRC-400. ASTM E283, or AAMA/WDMA/CSA 101/LS.2/A440-2011. |
| § 110.6(a)5: | Labeling. Fenestration products and exterior doors must have a label meeting the requirements of § 10-111(a). |
| § 110.6(b): | Field fabricated exterior doors and fenestration products must use U-factors and solar heat gain coefficient (SHGC) values from Tables 110.6-A, 110.6-B, or JA4.5 for exterior doors. They must be caulked and/or weather-stripped. |
| § 110.7: | Air Leakage. All joints, penetrations, and other openings in the building envelope that are potential sources of air leakage must be caulked, gaskeled, or weather stripped. |
| § 110.8(a): | Insulation Certification by Manufacturers. Insulation must be certified by the Department of Consumer Alfairs, Bureau of Household Goods and Services (BHGS). |
| § 110.8(g): | Insulation Requirements for Heated Stab Floors. Heated stab floors must be insulated per the requirements of § 110.8(g). |
| § 110.8(i); | Roofing Products Solar Reflectance and Thermal Emittance. The thermal emittance and aged solar reflectance values of the roofing makerial must meet the requirements of § 110.8(i) and be labeled per §10-113 when the installation of a cool roof is specified on the CF1R. |
| § 110.8(j): | Radiant Barrier. When required, radiant barriers must have an emittance of 0.05 or less and be cartified to the Department of Consumer Affairs. |
| § 150.0(a): | Roof Deck, Ceiling and Rafter Roof Insulation. Roof decks in rewly constructed attics in climate zones 4 and 8-16 area-weighted average U-factor not exceeding U-0.184. Ceiling and rafter roofs minimum R-32 insulation in wood-frame ceiling; or area-weighted average U-factor must not exceed 0.043. Rafter roof attentions minimum R-19 or area-weighted average U-factor of 0.054 or less. Aftte access U-factor must not exceed 0.043. Rafter roof attentions minimum R-19 or area-weighted average U-factor of 0.054 or less. Aftte access U-factor must not exceed 0.043. Rafter roof attentions minimum R-19 or area-weighted average U-factor of 0.054 or less. Aftte access doors must have permanently attached insulation using adhesive or mochanical fasteners. The attact access must be gasketed to prevent at leskage. Insulation must be installed in direct contact with a roof or ceiling which is sealed to limit influence and exittration as specified in § 110.7, including but not limited to placing insulation either above or blow whe roof de drivall ceiling. |
| § 150.0(b): | Loose-fill Insulation. Loose fill insulation must meet the manufacturer's required density for the labeled R-value. |
| § 150.0(c): | Wall Insulation. Minimum R-13 insulation in 2x4 inch wood framing wall or have a U-factor of 0.102 or less, or R-20 in 2x6 inch wood framing or have a U-factor of 0.071 or less. Opeque non-framed assemblies must have an overall assembly U-factor not exceeding 0.102. Measonry walls must meet Tables 150.1-A or B. ² |
| § 150.0(d): | Raised-floor Insulation. Minimum R-19 insulation in raised wood framed floor or 0.037 maximum U-factor.* |
| § 150.0(f): | Slab Edge insulation. Stab edge insulation must meet all of the following: have a water absorption rate, for the insulation material atone without facings, no greater than 0.3 percent; have a water vapor permeance no greater than 2.0 perm per inch; be protected from physical damage and UV light deterioration; and, when installed as part of a heated stab floor, meet the requirements of § 110.8(g). |
| § 150.0(g)1: | Vapor Retarder. In climate zones 1 through 16, the earth floor of unvented crawl space must be covered with a Class I or Class II vapor retarder. This requirement also applies to controlled ventilation crawl space for buildings complying with the exception to §150.0(d). |
| § 150.0(g)2: | Vapor Retarder. In climate zones 14 and 16, a Class I or Class II vapor retarder must be installed on the conditioned space side of all insulation in all exterior walls, vented attics, and unvented attics with air-permeable insulation. |
| § 150.0(q): | Fenestration Products. Fenestration, including skylights, separating conditioned space from unconditioned space or outdoors must have a maximum U-factor of 0.45; or area-weighted average U-factor of all fenestration must not exceed 0.45. |
| Fireplaces, Decor | Decorative Gas Appliances, and Gas Log: |
| § 110.5(e) | Pilot Light. Continuously burning pilot lights are not allowed for indoor and outdoor freplaces. |
| § 150.0(e)1: | Closable Doors. Masonry or factory-built freplaces must have a closable metal or glass door covering the entire opening of the frebox. |
| § 150.0(e)2: | Combustion intake. Masonry or factory-built inteplaces must have a combustion outside air intake, which is at least six square inches in area and is equipped with a readity accessible, operable, and tight-fitting damper or combustion-air control device. |
| § 150.0(e)3: | Fiue Damper. Masonry or factory-built freplaces must have a fibe damper with a readily accessible control.* |
| Space Conditioni | Space Conditioning, Water Heating, and Plumbing System: |
| § 110.0-§ 110.3: | Certification. Healing, ventilation, and air conditioning (HVAC) equipment, water heaters, showerheads, faucets, and all other regulated appliances must be certified by the manufacturer to the California Energy Commission. |
| § 110.2(a): | HVAC Efficiency. Equipment must meet the applicable efficiency requirements in Table 110.2-A through Table 110.2-N. Controls for Heat Pumps with Supplementary Electric Resistance Heaters. Heat pumps with supplementary electric resistance |
| § 110.2(b): | healers must have controls that prevent supplementary healer operation when the healing load can be met by the heat pump alone, and in which the out-on temperature for compression healing is higher than the out-on temperature for supplementary healing, and the cut-off temperature for compression healing is higher than the cut-off temperature for supplementary healing. |
| § 110.2(c): | Thermostats. All heating or cooling systems not controlled by a central energy management control system (EMCS) must have a setheric thermostat.** |
| \$ 110.3(c)3: | Insulation. Unified service water heater storage tanks and solar water-heating backup tanks must have adequate insulation, or tank surface heat loss rating. |
| | Isolation Valves. Instantaneous water heaters with an input rating greater than 6.8 kBtu per hour (2 kW) must have isolation valves with |

| Project Name: Culv | er City ADUs | (Plan 3 | 3) | | | Calcula | tion Date/Time: | 2023 | -08-28T09: | 56:52-07 | :00 | | (Page 11 of 12) |
|-------------------------------|--|----------|-----------------------------|-----------------------------|------------------|--------------------------------------|--|------|---|-------------------------------------|--------------|----------------------------------|---|
| Calculation Descrip | tion: Title 24 | 4 Analy: | sis | | | Input F | ile Name: Culver | City | ADUs (Plan | 3).ribd2 | 2x | | |
| VARIABLE CAPACITY | HEAT PUMP C | OMPLIA | NCE OPTI | ON - HERS V | ERIFICATION | | | | | | | | |
| 01 | | | 02 | 03 | 04 | 05 | 06 | | 07 | 08 | 3 | 09 | 10 |
| Name | | Low | tified -Static System | Airflow Habitab Rooms | le in Conditione | Wall Mount | Air Filter Sizing & Pressure Drop Rating | Cor | w Leakage Ducts in nditioned Space | Minin Airflov RA3.3 SC3.3. | w per and | Certified non-continuo Fan | Indoor Fan not Running Continuously |
| Heat Pump Sys | Heat Pump System 1 Not required Required Required Required Not required Not required Not required Not required | | | | | | Not required | | | | | | |
| INDOOR AIR QUALITY (IAQ) FANS | | | | | | | | | | | | | |
| 01 | 02 | | | 03 | 04 | 05 | 06 | | 07 | , | | 08 | 09 |
| Dwelling Unit | Airflow (C | FM) | | Efficacy (CFM) | IAQ Fan Type | Includes Heat/Energy Recovery? | IAQ Recove Effectiveness - | | Include: Indicator | | HERS | Verification | Status |
| SFam IAQVentRpt | 46 | 7 | 0 | .35 | Exhaust | No | n/a / n/a | | No |) | | Yes | |
| | | | | 1 | CalC | ER 5 PR | S , | | IC. | | | | |

Registration Date/Time: 2023-08-28 11:08:32

Report Version: 2022.0.000

Schema Version: rev 20220901

| CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD |
|---|
| Project Name: Culver City ADUs (Plan 3) |

HERS Provider:

Report Generated: 2023-08-28 09:58:13

HERS Provider:

| Na | me | Side of I | Building | | Are | a (ft ²) | | U-factor | | | |
|------------------------------|----------------|-------------------------|-------------------|-----------|-----------------------------|--|----------|-----------------|--|--|--|
| D | 01 7 | Front | Wall | D | | 20 | | 0 | .2 | | |
| | | | | | | | | | | | |
| SLAB FLOORS | | | | | | | | | | | |
| 01 | 02 | 03 | C 04 P | K | 05 | 06 | | 07 | 08 | | |
| Name | Zone | Area (ft ²) | Perimeter (ft) | - | Insul. R-value and Depth | Edge Insul. R-va and Depth | lue Ca | rpeted Fraction | Heated | | |
| Slab | Living Area | 806 | 114 | | none | 0 | | 80% | No | | |
| | | | | | | | | | | | |
| OPAQUE SURFACE CONSTRUCTIONS | | | | | | | | | | | |
| 01 | 02 | 03 | 04 | | 05 | 06 | 07 | | 08 | | |
| Construction Name | Surface Type | Construction Type | Framing | | Total Cavity R-value | Interior / Exterior Continuous R-value | U-factor | Asser | nbly Layers | | |
| R21 Wall | Exterior Walls | Wood Framed Wall | 2x6 @ 16 in. O. (| n. 171 | R-21 | None / None | 0.069 | Cavity / Fr | h: Gypsum Board ame: R-21 / 2x6 ish: 3 Coat Stucco | | |

05 06 07 08 09

Width Height (ft) (ft) Mult. (ft²)

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

03

Surface

Left Wall

04

Left

Left

Right 270

Right 270

Azimuth

90

90

02

Project Name: Culver City ADUs (Plan 3)

Calculation Description: Title 24 Analysis

02

Type

Window

15 Window Right Wall

01

Window Left Wall

Window Right Wall

FENESTRATION / GLAZING

01

Name

13

14

16

OPAQUE DOORS

Registration Number: 223-P010107532A-000-000-0000000-0000 CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Number: 223-P010107532A-000-000-0000000-0000

CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-08-28 11:08:32 Report Version: 2022.0.000 Schema Version: rev 20220901

Calculation Date/Time: 2023-08-28T09:56:52-07:00

Input File Name: Culver City ADUs (Plan 3).ribd22x

11

U-factor

Source

NFRC

NFRC

NFRC

NFRC

12

SHGC

0.23

0.23

0.23

0.23

13

NFRC

NFRC

NFRC

NFRC

04

Report Generated: 2023-08-28 09:58:13

10

U-factor

0.3

0.3

0.3

0.3

03

Area

8

1 20

1 20

1 20

CF1R-PRF-01E (Page 8 of 12)

14

Bug Screen

Bug Screen

Bug Screen

Bug Screen

CalCERTS inc.

CF1R-PRF-01E

CalCERTS inc.

SHGC Source Exterior Shading

| Requireme | |
|---------------|--|
| Mandatory | |
| Residential | |
| Single-Family | |
| 2022 | |

| | 2022 Single-Family Residential Mandatory Requirements Summary |
|-----------------|---|
| § 110.5: | Pliot Lights. Continuously burning pitot lights are prohibited for natural gas: fan-type central furmaces; household cooking appliances (except appliances without an electrical supply voltage connection with pitot lights that consume less than 150 Btu per hour); and pool and spa heatens. |
| § 150.0(h)1: | Building Cooling and Heating Loads. Heating and/or cooling loads are calculated in accordance with the ASHRAE Handbook, Equipment Volume, Applications Volume, and Fundamentals Volume; the SMACNA Residential Comfort System Installation Standards Manual; or the ACCA Manual J using design conditions specified in § 150.0(h)2. |
| § 150.0(h)3A: | Clearances. Air conditioner and heat pump outdoor condensing units must have a clearance of at least five feet from the outlet of any dryer. |
| § 150.0(h)3B: | Liquid Line Drier. Air conditioners and heat pump systems must be equipped with liquid line filter driers if required, as specified by the manufacturer's instructions. |
| § 150.0[]/1: | Water Piping, Solar Water-heating System Piping, and Space Conditioning System Line Insulation. All domestic hot waker piping must be insulated as specified in § 609.11 of the California Plumbing Code.* |
| § 150.0[]2: | Insulation Protection. Fiping insulation must be protacted from damage, including that due to sunlight, moisture, equipment' maintenance, and wind as required by §120.3(b). Insulation exposed to weather must be water relardant and protected from UV light (no adhesive lapes). Insulation covering chilled water piping and refigiparant suction piping located outside the conditioned space must include, or be protected by, a Class I vapor retarder. Pipe insulation buried below grade must be installed in a waterproof and inch-cushable casing or sheeve. |
| § 150.0(n)1: | Gas or Propane Water Heating Systems. Systems using gas or propane water heaters to serve individual dweling units must designate a space at least 2.5' x 7' suitable for the future installation of a heat pump water heater, and meet electrical and plumbing requirements, based on the distance between this designated space and the water heater location; and a condensate drain no more than 2' higher than the base of the water heater |
| § 150.0(n)3: | Solar Water-heating Systems. Solar water-heating systems and collectors must be certified and rated by the Solar Rating and Certification Corporation (SRCC), the International Association of Plumbing and Mechanical Officials, Research and Testing (IAPMO R&T), or by a listing agency that is approved by the executive director. |
| Ducts and Fans: | |
| § 110.8(d)3: | Ducts. Insulation installed on an existing space-conditioning duct must comply with § 604.0 of the California Mechanical Code (CMC). If a contractor installs the insulation, the contractor must certify to the customer, in writing, that the insulation meets this requirement. |
| 6.150.0(m)1- | CMC Compliance. All air-distribution system ducts and plenums must meet CMC §§ 601.0-605.0 and ANSI/SMACNA-006-2006 HVAC Duct Construction Standards Metal and Flexible 3rd Edition. Portions of supply-air and return-air ducts and plenums must be insulated to R-6.0 or higher, ducts located entirely in conditioned space as confirmed through field verification and diagnostic testing (RA3.1.4.3.8) do not require insulation. Connections of metal ducts and inner core of flexible ducts must be mechanically fastened. Openings must be sealed with mestic, tape, or other duct-closure system that meets the applicable UL requirements, or sensol sealent that meets UL 723. |
| fuileoor 2 | The combination of master and either mesh of rape must be used to seal openings greater than %. If master of tape is used. Building cavities, air handler support platforms, and plenums designed or constructed with materials ofter than sealed sheet metal, duct board or fielded duct must not be used to convey conditioned air. Building cavities and support platforms may contain ducts; ducts installed in these scaces must not be commessed. |
| § 150.0(m)2: | Factory-Fabricated Duct Systems. Factory-fabricated duct systems must comply with applicable requirements for duct construction, connections, and closures; joints and seams of duct systems and their components must not be sealed with cloth back rubber adhesive duct tapes unless such tape is used in combination with mastic and draw bands. |
| § 150.0(m)3: | Field-Fabricated Duct Systems. Field-fabricated duct systems must comply with applicable requirements for: pressure-sensitive tapes, mastics, sealants, and other requirements specified for duct construction. |
| § 150.0(m)7: | Backdraft Damper. Fan systems that exchange air between the conditioned space and outdoors must have backdraft or automatic dampers. |
| § 150.0(m)8: | Gravity Ventilation Dampers. Gravity ventilating systems serving conditioned space must have either automatic or readily accessible, manually operated dampers in all openings to the outside, except combustion intel and outlet air openings and efevator shaft vents. |
| § 150.0(m)9: | Protection of Insulation. Insulation must be protected from damage due tosunlight, moisture, equipment maintenance, and wind. Insulation exposed to weather must be suitable for outdoor service (e.g., protected by aluminum, sheet metal, painted carvas, or plastic cover). Cellular foam insulation must be protected as above or painted with a water retardant and solar radiation-resistant coating. |
| § 150.0(m)10: | Porous Inner Core Flex Duct. Porous inner cores of flex ducts must have a non-porous layer or air barrier between the inner core and outer vapor barrier. |
| § 150.0(m)111: | Duct System Sealing and Leakage Test. When space conditioning systems use forced air duct systems to supply conditioned air to an occupiable space, the ducts must be sealed and duct leakage tested, as confirmed through field verification and diagnostic testing, in accordance with Reference Residential Appendix RA3.1. |
| § 150.0(m)12: | Air Filtration. Space conditioning systems with ducts exceeding 10 feet and the supply side of ventilation systems must have MERV 13 or equivalent filters. Filters for space conditioning systems must have a two inch depth or can be one inch if sized per Equation 150.0-A. Clean-filter pressure drop and labeling must meet the requirements in §150.0(m)12. Filters must be accessible for regular service. Filter recks or grilles must use gaskets, sealing, or other means to close gaps around the inserted filters to and prevents air from bypassing the filter. |

| | covery. Cellular roam insulation must be protected as above or painteo with a water relargant and solar radiation-resistant coating |
|-----------|--|
| 0.0(m)10: | Porous Inner Core Flex Duct. Porous inner cores of flex ducts must have a non-porous layer or air betrier between the inner con |
| | outer vapor barrier. |
| | Duct System Sealing and Leakage Test. When space conditioning systems use forced air duct systems to supply conditioned a |
| 0.0(m)11: | occuptable space, the ducts must be sealed and duct leakage tested, as confirmed through field verification and diagnostic testing |
| | accordance with Reference Residential Appendix RA3.1. |
| | Air Filtration. Space conditioning systems with ducts exceeding 10 feet and the supply side of ventilation systems must have ME |
| 0.0(m)12: | or equivalent filters. Filters for space conditioning systems must have a two inch depth or can be one inch if sized per Equation 15 |
| | Place files excertes des and labellae must must incention and its zon incention of the Clines must be accessible for sources |

HERS Provider

| | Air Fiitration, Space conditioning systems with ducts exceeding 10 teet and the supply side (|
|--------|---|
| (m)12: | or equivalent filters. Filters for space conditioning systems must have a two inch depth or can |
| | Clean-filter pressure drop and labeling must meet the requirements in §150.0(m)12. Filters m |
| | racks or grilles must use gaskets, sealing, or other means to close gaps around the inserted t |
| | filter. * |
| | |

| 612 | ¢ | 5 | ų |
|-----|---|---|---|
| g | ŝ | Ì | 4 |
| | ş | ļ | 2 |

| 6 | 2 |
|---|---|
| | l |
| | 5 |

| Registration Number: | Registration Date/Time: |
|--------------------------------------|-------------------------|
| 223-P010107532A-000-000-0000000-0000 | 2023-08-28 11:08:32 |

CA Building Energy Efficiency Standards - 2022 Residential Compliance

City/State/Zip: San Luis Obispo, CA 94301

Digitally signed by CalCERTS. This digital signature is provided in order to secure the content of this registered document, and in no way implies Registration Provider responsibility for the accuracy of the information.

Report Generated: 2023-08-28 09:58:13

CalCERTS inc.

CF1R-PRF-01E

(Page 9 of 12)

CalCERTS inc.

08

Assembly Layers

Roofing: Light Roof (Asphalt Shingle)

Roof Deck: Wood

Siding/sheathing/decking

Cavity / Frame: no insul. / 2x4

| " | ്ര | | j ů | õ |
|------------------------------|---|---|----------------|------------------|
| | /Alteration | Addition n/a | | |
| | Single Family Addition Alone Multi Family Existing+ Addition/Alteration | Total Cond. Floor Area 806 | aaial Easturaa | opecial reatures |
| | Single Family Multi Family | | | |
| × | | alifornia Energy Climate Zone CA Climate Zone 08 | Area | |
| MMAR | Building Type | Californic CA C | Caulture | Cavity |
| WIAL MEASURES SUMMARY | | | | |
| ASURE | | | | |
| VL ME/ | 4DUs (Plan 3) | | Tuno | ion iype |
| ITIA | ADUs | | N S | 5 |

| RTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD | CF1R-PRF-01E |
|---|--|
| oject Name: Culver City ADUs (Plan 3) | Calculation Date/Time: 2023-08-28T09:56:52-07:00 (Page 12 of 12) |
| Iculation Description: Title 24 Analysis | Input File Name: Culver City ADUs (Plan 3).ribd22x |
| OCUMENTATION AUTHOR'S DECLARATION STATEMENT | |
| I certify that this Certificate of Compliance documentation is accurate and complete. | |
| cumentation Author Name: | Documentation Author Signature: |
| Timothy Carstairs | Timothy Carstairs |
| mpany: | Signature Date: |
| Carstairs Energy Inc. | 2023-08-28 10:56:29 |
| dress: | CEA/ HERS Certification Identification (If applicable): |
| 238 Bayview Heights Drive, Suite E | r160610042 |
| y/State/Zip: | Phone: |
| los Osos, CA 93402 | 805-904-9048 |
| SPONSIBLE PERSON'S DECLARATION STATEMENT | |
| | compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations. e are consistent with the information provided on other applicable compliance documents, worksheets, |
| sponsible Designer Name: | Responsible Designer Signature: R.R. |
| RRM Design Group | Date Signed: 2023-08-28 11:08:32 |
| dress: | License: |
| 765 S. Higuera Street, Suite 102 | na |
| | |

Phone: 805-543-1794

Report Version: 2022.0.000 Schema Version: rev 20220901

| 01 | 02 | 03 | | 04 | 0 | 5 | 06 | | 07 | | 08 | 09 |
|--------------------|-----------------------------|----------------------|---------|------------------|----------|-----------------------------|------------------------|---------|-------------------------|------|--------------------|--------------------------|
| Name | System Type | Distribution Type | Water H | leater Name | Number | of Units | Solar Hea System | ~ | Compact Distribution | , | HERS Verification | Water Heater Name (#) |
| DHW Sys 1 | Domestic Hot Water (DHW) | Standard | DHW | Heater 1 | 1 | 1 | n/a | | None | | n/a | DHW Heater 1 (1) |
| | | | | | | | | | | | | |
| TER HEATERS - NE | EA HEAT PUMP | | | | | | | | | | | |
| 01 | 02 | 03 | | 04 | | | 05 | | 06 | | 07 | 08 |
| Name | # of Units | Tank Vol. (į | gal) | NEEA Hea Bran | | | leat Pump Iodel | Tar | nk Location | Duct | Inlet Air Source | Duct Outlet Air Source |
| DHW Heater 1 | 1 | 50 | | Rhee | m | | 0H22U0 (50 , JA13) | | Outside | | Living Area | Living Area |
| sistration Number | 223-P010107532A-000- | 000-000000-0000 | | | Registra | tion Date/T | ïme: 2023-08-28 1 | 1:08:32 | | HERS | S Provider: | CalCERTS in |
| Building Energy El | fficiency Standards - 2 | 022 Residential Comp | liance | | | /ersion: 202 Version: re | 22.0.000 v 20220901 | | | Repo | ort Generated: 202 | 3-08-28 09:58:13 |
| | | | | | | | | | | | | |

04

Framing

2x4 @ 24 in. O. C.

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

03

Construction Type

Wood Framed

Ceiling

02

Surface Type

Attic Roofs

Project Name: Culver City ADUs (Plan 3)

Calculation Description: Title 24 Analysis

OPAQUE SURFACE CONSTRUCTIONS

01

Construction Name

Attic RoofLiving Area

Regi

CA B

| R-30 Roof Attic | Ceilings (I attic | | Wood Fra Ceilin | | 2x4 @ | 24 in. O. C. | | R-30 | None | / None | 0.032 | Cavity / Fr | loists: R-20.9 insul. ame: R-9.1 / 2x4 h: Gypsum Board |
|-------------------------|-----------------------------|-----------|--------------------|-------------|------------------|--------------|-----------|-----------------------|----------------|-------------|----------------|----------------------|--|
| BUILDING ENVELOPE - | HERS VERIFICATION | DN | | | | | | | | | | | |
| 01 | | _ | 02 | | - | 03 | | | | 04 | | | 05 |
| Quality Insulation Inst | allation (QII) | High R-va | lue Spray Foan | n Insulatio | on Build | ding Envelop | e Air Lea | kage | | CFM50 | | | CFM50 |
| Not Require | ed | | Not Required | | JIC | N/A | ۲T | Э, | | n/a | | | n/a |
| WATER HEATING SYSTE | MS | | | H | ERS | ; P | RC | > √″ | -D- | ER | | | |
| 01 | 02 | | 03 | | 04 | 05 | | o | 6 | C | 7 | 08 | 09 |
| Name | System Type | Distr | ibution Type | Water H | eater Name | Number o | f Units | | leating tem | | pact oution | HERS Verification | Water Heater Name (#) |
| DHW Sys 1 | Domestic Hot Water (DHW) | | Standard | DHW | Heater 1 | 1 | | n | /a | No | ne | n/a | DHW Heater 1 (1) |
| WATER HEATERS - NEEA | HEAT PUMP | | | | | | | | | | | | |
| 01 | 02 | | 03 | | 04 | | | 05 | | 06 | | 07 | 08 |
| Name | # of Units | 5 | Tank Vol. (į | gal) | NEEA Hea Bran | | | ieat Pump Iodel | Ta | nk Locatior | Du | ect Inlet Air Source | Duct Outlet Air Source |
| DHW Heater 1 | 1 | | 50 | | Rhee | m | | 0H22U0 (50 , JA13) | | Outside | | Living Area | Living Area |
| | | | | | | | | | | | | | |

Calculation Date/Time: 2023-08-28T09:56:52-07:00

Input File Name: Culver City ADUs (Plan 3).ribd22x

Total Cavity Interior / Exterior

R-value

R-0

05 06 07

None / 0

Continuous U-factor R-value

0.644

| Name | | Pipe Ins | ulation | 1 |
|-----------------------------------|--------|----------------------------|--------------------|------------|
| DHW Sys 1 - 1/1 | | Not Re | quired | |
| SPACE CONDITIONIN | G SYST | TEMS | | |
| 01 | | 02 | 03 | |
| Name | 5 | ystem Type | Heating Un | it Name |
| HVAC System1 | | leat pump ating cooling | Heat Pump 1 | System |
| HVAC - HEAT PUMPS | | | | - |
| 01 | | 02 | 03 | |
| Name | Sy | stem Type | Number of Units | Effic T |
| Heat Pump System 1 | VC | HP-ductless | 1 | н |
| HVAC HEAT PUMPS - | HERS | VERIFICATION | | |
| 01 | | 02 | 03 | |
| Name | Ver | ified Airflow | Airflow 1 | arget |
| Heat Pump System 1-hers-htpump | N | ot Required | 0 | |

Registration Number:

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD Project Name: Culver City ADUs (Plan 3) Calculation Description: Title 24 Analysis


01 02

WATER HEATING - HERS VERIFICATION

| -0 CL -0 | 31/0/0/021 | dwelling unit ventilation airflow required per §150.0(o)1C. A motorized damper(s) must be installed on the ventilation duct(s) that prevents all airflow through the space conditioning duct system when the damper(s) is closed andcontrolled per §150.0(o)1Bitkiv. CFI ventilation systems must have controls that track outdoor air ventilation run time, and either open or close the motorized damper(s) for commissione with \$150.0(o)1C. | |
|---------------|-----------------|--|------------------------------------|
| § 150.0 | § 150.0(o)1C: | with the second se | FENES Orienta |
| § 150.1 | § 150.0(o)1G: | Local Mechanical Exhaust. Kitchens and bathrooms must have local mechanical exhaust, nonenclosed kitchens must have demand- controlled exhaust system meeting requirements of §150.0(o)1Gii,enclosed kitchens and bathrooms can use demand-controlled or continuous exhaust meeting §150.0(o)1Gii+iv. Airflow must be measured by the installer per §150.0(o)1Gv, and rated for sound per §150.0(o)1Gvi.* | Front (N) Left (E) Right (W) |
| § 150.1 | § 150.0(o)1H&I: | Airflow Measurement and Sound Ratings of Whole-Dwelling Unit Ventilation Systems. The airflow required per § 150.0(o)1C must be measured by using a flow hood, flow grid, or other airflow measuring device at the fan's inlet or outlet terminals grilles per Reference Residential Appendix RA3.7. Whole-Dwelling unit ventilation systems must be rated for sound per ASHRAE 62.2 §7.2 at no less than the minimum airflow rate required by §150.0(o)1C. | |
| § 150.0(o)2 | 0(o)2: | Field Verification and Diagnostic Testing. Whole-Dwelling Unit ventilation airflow, vented range hood airflow and sound rating, and HRV and ERV fan efficacy must be verified in accordance with Reference Residential Appendix RA3.7. Vented range hoods must be verified per Reference Residential Appendix RA3.7.4.3 to confirm if it is rated by HVI or AHAM to comply with the airflow rates and sound requirements per §150.0(o)10 | |
| Pool an | id Spa Systi | Pool and Spa Systems and Equipment: | |
| § 110.4(a) | 4(a): | Certification by Manufacturers. Any pool or spa heating system or equipment must be certified to have all of the following: compliance with the Appliance Efficiency Regulations and listing in MAEDbS, an on-off switch mounted outside of the heater that allows shutting off the heater withhout adjusting the thermostat setting; a permanent weatherproof plate or card with operating instructions; and must not use electric resistance heating. | |
| § 110.4(b)1: | 4(b)1: | Piping. Any pool or spa heating system or equipment must be installed with at least 36 inches of pipe between the fitter and the heater, or dedicated suction and return lines, or built-in or built-up connections to allow for future solar heating. | HVAC |
| § 110.4(b)2 | 4(b)2: | Covers. Ouldcor pools or spas that have a heat pump or gas heater must have a cover. | oty. |
| § 110.4(b)3: | 4(b)3: | Directional Inlets and Time Switches for Pools. Pools must have directional inlets that adequately mix the pool water, and a time switch that will allow all pumps to be set or programmed to run only during off-peak electric demand periods. | + |
| § 110.5: | 5: | Pilot Light. Natural gas pool and spa heaters must not have a continuously burning pilot light. | |
| § 150.0(p): | 0(p): | Pool Systems and Equipment Installation. Residential pool systems or equipment must meet the specified requirements for pump sizing, flow rate, piping, filters, and valves. | HVAC |
| Lighting: | | | Locatio |
| § 110.9: | 6 | Lighting Controls and Components. All lighting control devices and systems, ballasts, and luminaires must meet the applicable requirements of § 110.9. [*] | HVAC Syst |
| § 150.1 | § 150.0(k)1A: | Luminaire Efficacy. All installed luminaires must meet the requirements in Table 150.0-A, except lighting integral to exheust fans, kitchen range boods, bath vanity mirrors, and garage door openers; navigation fighting less than 5 watts; and fighting internal to drawers, cabinets, and linen dosets with an efficacy of at least 45 lumens per watt. | WATE |
| § 150.0(k)1B: | (k)1B: | Screw based luminaires. Screw based luminaires must contain lamps that comply with Reference Joint Appendix JA8.* | otv. |
| § 150.4 | § 150.0(k)1C: | Recessed Downlight Luminalres in Cellings. Luminaires recessed into cellings must not contain screw based sockets, must be airtight, and must be sealed with a gasket or caulk. California Electrical Code § 410.116 must also be met. | - |
| § 150. | § 150.0(k)1D: | Light Sources in Enclosed or Recessed Luminaires. Lamps and other separable light sources that are not compliant with the JAB elevated temperature requirements, including marking requirements, must not be installed in enclosed or recessed luminaires. | |
| 8 1501 | \$ 150 0001E- | Blank Electrical Boxes. The number of electrical boxes that are more than five feet above the finished floor and do not contain a | |

| | | ID: 23-08289 | | |
|----------|--|-----------------------|---|--|
| Standard | | | _ | |
| 3.20 | | | | |
| 50 | | oft User Number: 6249 | | |
| | | 송 | | |

THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

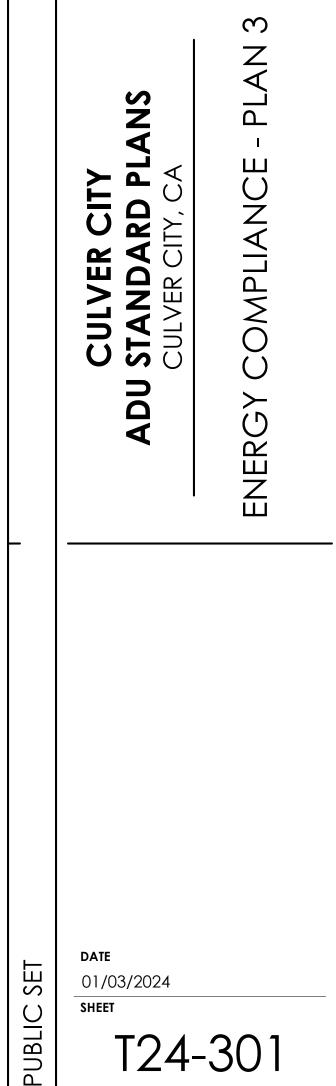

| | | | | | | Inpu | t File | Name: | Culver City | y ADUs (P | lan 3).ribd2 | 2x | | | | | | |
|----------|----------------|------------|----------------------|--------|-------------------|-----------------|--------|-------|----------------------|-----------|--------------|-----------------|-----------------|----------------------------------|-----------------|--|---|------------------|
| | | | | | | | | | | | | | | | | | | |
| Т | | 03 | 3 | Т | | 04 | | | 05 | | | 06 | | 07 | | | | |
| T | Pa | rallel | Piping | Т | Comp | pact Distrib | ution | Co | mpact Dist Type | ribution | Recircula | tion Control | Show | er Drain Water Hea Recovery | | | | |
| I | N | ot Reo | quired | | N | lot Require | d | | None | | Not F | lequired | | Not Required | | | | |
| | | | | | | | | | | | | | | | | | | |
| 03 | | | 04 | | | 05 | | | 06 | | 07 | 08 | | 09 | | | | |
| Unit | t Name | Heat | ting Equipm Count | nent | Coo | ling Unit N | ame | | ; Equipment Count | t Fa | n Name | Distribution N | lame | Required Thermostat Type | | | | |
| np: 1 | System | | 1 | | Hea | t Pump Sys 1 | tem | | 1 | | n/a | n/a | | Setback | | | | |
| _ | _ | _ | _ | | | | _ | | | _ | | | | | | | | |
| 1 | 04 | C | 05 | 0 | 16 | 07 | T | 08 | 09 | 10 | 11 | 12 | | 13 | | | | |
| | | | Heatin | ng | | | | | Cooling | | | 1 | | | | | | |
| of | Efficie Typ | ncy HSPF / | ency HSPF | ency H | HSPF / HSPF2 / | 5 | Ľ. | i S | 9 47 | Cap 17 | | iciency Type | SEER / SEER2 | EER / EER / CEER | Controlled Type | | н | ERS Verification |
| | HSP | ۴ | 8.2 | 25 | 000 | 20000 | EE | RSEER | 14 | 11 | Not Zonal | Single Speed | | eat Pump System 1-hers-htpump | | | | |
| | | | | | | | | | | | | | | | | | | |
| 3 | | | 04 | | | 05 | | | 06 | | 07 | 08 | | 09 | | | | |
| _ | | | | | | | | | | | | | | | | | | |

Calculation Date/Time: 2023-08-28T09:56:52-07:00

Verified Verified Refrigerant SEER/SEER2 Charge Verified HSPF/HSPF2 Verified Heating Verified Heating Target Verified EER/EER2 Cap 47 Yes No Yes Not Required Not Required Registration Date/Time: 2023-08-28 11:08:32

223-P010107532A-000-000-0000000-0000 CA Building Energy Efficiency Standards - 2022 Residential Compliance

Report Version: 2022.0.000 Schema Version: rev 20220901

HERS Provider: CalCERTS inc. Report Generated: 2023-08-28 09:58:13

Cap 17

Yes

CF1R-PRF-01E (Page 10 of 12)


1/3/2024 11:05:36 AM Autodesk Docs://2927-01_CU22_ADU_Culver_City/2927-01_Culver City ADUs.rvt


| § 150.0(k)1G: § 150.0(k)1H: | |
|--------------------------------|---|
| 150.0(k)1H: | Screw based luminaires. Screw based luminaires must contain lamps that comply with Reference Joint Appendix JA8." Light Sources in Enclosed or Recessed Luminaires. Lamps and other separable light sources that are not compliant with the JA8 |
| | elevated temperature requirements, including marking requirements, must not be installed in enclosed or recessed luminaires. |
| § 150.0(k)11: | Light Sources in Drawers, Cabinets, and Linen Closets. Light sources internal to drawers, cabinetry or linen closets are not required to comply with Table 150.0-A or be controlled by vacancy sensors provided that they are rated to consume no more than 5 watts of power, emit no more than 150 lumens, and are equipped with controls that automatically turn the lighting off when the drawer, cabinet or linen closet is closed. |
| § 150.0(k)2A: | Interior Switches and Controls. All forward phase cut dimmers used with LED light sources must comply with NEMA SSL 7A |
| § 150.0(k)2B: | |
| § 150.0(k)2A: | Accessible Controls. Lighting must have readily accessible wall-mounted controls that allow the lighting to be manually turned on and off. * |
| § 150.0(k)2B: | Multiple Controls. Controls must not bypass a dimmer, occupant sensor, or vacancy sensor function if the dimmer or sensor is installed to comply with § 150.0(k). |
| § 150.0(k)2C: | Mandatory Requirements. Lighting controls must comply with the applicable requirements of § 110.9. |
| § 150.0(k)2D: | Energy Management Control Systems. An energy management control system (EMCS) may be used to comply with dimming, occupancy, and control requirements if it provides the functionality of the specified control per § 110.9 and the physical controls specified in § 150.0[k)2A. |
| § 150.0(k)2E: | Automatic Shutoff Controls. In bathrooms, garages, laundry rooms, utility rooms and walk-in closets, at least one installed luminaire must be controlled by an occupancy or vacancy sensor providing automatic-off functionality. Lightling inside drawers and cabinets with opeque fronts or doors must have controls that turn the light off when the drawer or door is closed. |
| § 150.0(k)2F: | Dimmers. Lighting in habitable spaces (e.g., living rooms, dining rooms, kitchens, and bedrooms) must have readily accessible wall- mounted dimming controls that allow the lighting to be manually adjusted up and down. Forward phase out dimmers controlling LED light sources in these spaces must comply with NEMA SSL 7A. |
| § 150.0(k)2K: | Independent controls. Integrated lighting of exhaust fans shall be controlled independently from the fans. Lighting under cabinets or shelves, lighting in display cabinets, and switched outlets must be controlled separately from celling-installed lighting. |
| § 150.0(k)3A: | Residential Outdoor Lighting. For single-family residential buildings, outdoor lighting permanently mounted to a residential building, or to other buildings on the same lot, must have a manual on/off switch and either a photocell and motion sensor or automatic time switch control) or an astronomical time clock. An energy management control system that provides the specified control functionality and meets all applicable requirements may be used to meet these requirements. Internally illuminated address signs, Internally illuminated address signs, Internally illuminated address signs. |
| § 150.0(k)4: | watts of power. |
| § 150.0(k)5: | Residential Garages for Eight or More Vehicles. Lighting for residential parking garages for eight or more vehicles must comply with the applicable requirements for nonresidential garages in §§ 110.9, 130.0, 130.1, 130.4, 140.6, and 141.0. |
| olar Readiness | |
| § 110.10(a)1: | Single-family Residences. Single-family residences located in subdivisions with 10 or more single-family residences and where the application for a tentative subdivision map for the residences has been deemed complete and approved by the enforcement agency, which do not have a photovoltaic system installed, must comply with the requirements of § 110.10(b)-(e). |
| §110.10(b)1A: | Minimum Solar Zone Area. The solar zone must have a minimum total area as described below. The solar zone must comply with access, pathway, smoke ventilation, and spacing requirements as specified in Title 24. Part 9 or other parts of Title 24 or in any requirements adopted by a local jurisdiction. The solar zone total area must be comprised of areas that have no dimension less than 5 feet and are no less than 80 square feet each for buildings with roof areas less than or equal to 10,000 square feet or no less than 160 square feet each for buildings with roof areas greater than 10,000 square feet. For single-family residences, the solar zone must be located on the roof or overhang of the building and have a total area no less than 250 square feet. [*] |
| § 110.10(b)2: | Azimuth. All sections of the solar zone located on steep-sloped roofs must have an azimuth between 90-300° of true north. |
| § 110.10(b)3A: | Shading. The solar zone must not contain any obstructions, including but not limited to: vents, chimneys, architectural features, and roof mounted equipment. |
| § 110.10(b)3B: | Shading. Any obstruction located on the roof or any other part of the building that projects above a solar zone must be located at least twice the horizontal distance of the height difference between the highest point of the obstruction and the horizontal projection of the nearest point of the solar zone, measured in the vertical plane. |
| § 110.10(b)4: | Structural Design Loads on Construction Documents. For areas of the roof designated as a solar zone, the structural design loads for roof dead load and roof live load must be clearly indicated on the construction documents. |
| § 110.10(c): | Interconnection Pathways. The construction documents must indicate: a location reserved for inverters and metering equipment and a pathway reserved for routing of conduit from the solar zone to the point of interconnection with the electrical service; and for single-family residences and central water-heating systems, a pathway reserved for routing plumbing from the solar zone to the water-heating system. |
| § 110.10(d): | Documentation. A copy of the construction documents or a comparable document indicating the information from § 110.10(b)-(c) must be provided to the occupant. |
| § 110.10(e)1: | Main Electrical Service Panel. The main electrical service panel must have a minimum busbar rating of 200 amps. |
| § 110.10(e)2: | Main Electrical Service Panel. The main electrical service panel must have a reserved space to allow for the installation of a double pole circuit breaker for a future solar electric installation. The reserved space must be permanently marked as "For Future Solar Electric." |

5122

| 2022 Single-Family Residential Mandatory Requirements Summary | Energy Storage System (ESS) Ready. All single-family residences must meet all of the following: Either ESS-ready interconnection equipment with backed up capacity of 60 amps or more and four or more ESS supplied branch circuits. Or a dedicated raceway from the main service to a subparied that supplies the branch circuits in § 150.0%; at least four branch circuits. Or a dedicated raceway from the source collocated at a single parelboard suitable to be supplied by the ESS, with one circuit supplying the refrigerator, one lighting circuit near the primary exit, and one circuit supplying a sleeping room receptacle outlet, main panelboard must have a minimum busbar rating of 225 amps; sufficient space must be reserved to allow future installation of a system isolation equipment/transfer switch within 3' of the main | panelboard, with raceways installed between the panelboard and the switch location to allow the connection of backup power source. Heat Pump Space Heater Ready. Systems using gas or propane fumaces to serve individual dwelling units must include: A dedicated unobstructed 240V branch circuit wring installed within 3 of the fumace with circuit conductors rated at least 30 amps with the blank cover identified as "40V ready," and a reserved main electrical service panel space to allow for the installation of a double pole circuit breaker | permanently marked as For Fluture 240V use. Electric Cooktop Ready. Systems using gas or propare cooktop to serve individual dwelling units must include: A dedicated unobstructed 240V branch circuit wiring installed with 3° of the cooktop with circuit conductors rated at least 50 amps with the blank cover identified as "240V branch circuit are a reserved main electrical service panel space to allow for the installation of a double pole circuit breaker permanently monocod as ⁶ Cor chrue 3400 use. | Instruct as for route 2007 use. Electric Clothes Dryer Ready, Clothes dryer locations with gas or propene plumbing to serve individual dwelling units must include: A dedicated unobstructed 240V branch circuit wining installed within 3° of the dryer location with circuit conductors rated at least 30 amps with the blank cover identified as "240V ready," and a reserved main electrical service panel space to allow for the installation of a double pole circuit breaker permanently marked as "For Future 240V use." | vay apply. | | | | Project Name Date 2000 LOAD SUMMARY | Floor | ROOM COOLING PEAK COIL COOLING PEAK COIL COOLING PEAK COI COOLING PEAK COI COOLING PEAK COIL COOLING PEAK COIL COOLING PEAK COIL COIL COOLING PEAK COIL COIL COOLING PEAK COIL COIL <th>1st Floor 1 306 6,574 523 306 6,574 523 200</th> <th></th> | 1st Floor 1 306 6,574 523 306 6,574 523 200 | |
|---|--|--|---|--|-----------------------|--|--|--------|-------------------------------------|------------------------|---|---|--|
| Ċ | § 150.0(s) | § 150.0(t) | § 150.0(u) | § 150.0(v) | Exceptions may apply. | | | 5/6/22 | Project Culture | System HVAC ROON | | Living A | |
| | | | | | | | | | | | | | |

| • | | | |
|---|--|--|-------|
| Image: constraint of the state of the s | | | |
| Image: constraint of the state of the st | | | |
| Image: state | | | |
| Image: constraint of the state of the st | | | |
| Image: 1 Image: 1 <td< td=""><td></td><td></td><td></td></td<> | | | |
| Image: state stat | | | |
| Image: 1 Image: 1 <td< td=""><td></td><td></td><td></td></td<> | | | |
| Image: state stat | | | |
| Image: constraint of the state of the st | | | |
| Image: constraint of the state of the st | | | |
| Image: constraint of the state of the st | | | |
| Image: Sector | | | |
| Image: Control of the state | | | |
| Page Total 306 6,574 523 200 | | | |
| Page Total 306 6,574 523 200 | | | |
| Page Total 306 6,574 523 200 | | | |
| M I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I I | | | |
| Image: constraint of the state of the st | | | |
| Image: constraint of the state of the st | | | |
| Image: constraint of the state of the st | | | |
| Image: Section of the section of t | | | |
| Image: Section of the section of t | | | |
| Image: Constraint of the state of the st | | | |
| Image: Constraint of the state of the st | | | |
| Image: Constraint of the state of the st | | | |
| PAGE TOTAL 306 6,574 523 200 TOTAL 306 6,574 523 200 | | | |
| Page ToTAL 306 6,574 523 200 TOTAL 306 6,574 523 200 | | | |
| PAGE TOTAL 306 6,574 523 200 TOTAL * 306 6,574 523 200 | | | |
| PAGE TOTAL TOTAL 306 6.574 523 200 TOTAL 306 6.574 523 200 | | | |
| PAGE TOTAL 306 6.574 523 200 TOTAL * 306 6.574 523 200 | | | |
| PAGE TOTAL TOTAL * 306 6,574 523 200 | | | |
| TOTAL * 306 6,574 523 200 | | | 7,956 |
| * Total includes vertilation load for zonal systems. | | | 7,956 |
| | Total includes ventilation load for zonal systems. | | |

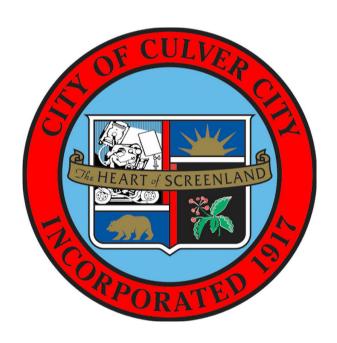

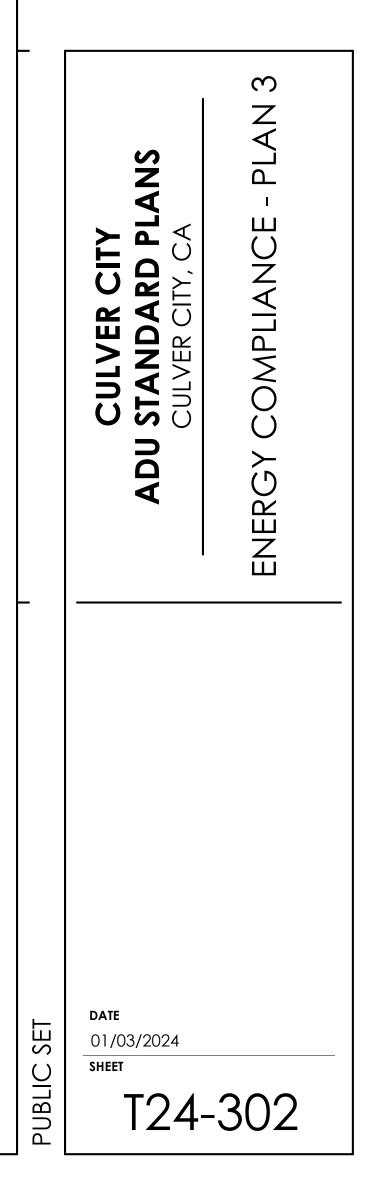






SITE PLAN CHECKLIST


| IS (N) ADU 5' - 0" (| YES; IF YES, FIF | PPERTY LINE AND/OR IS (N) ADU 10' RE RATED WALL & ROOF REQUIRED |
|-------------------------|---|---|
| | *NOTE: WHERE TABLE 302.1(1) | OCKING IS REQUIRED IN PROJECTI 1-HR FIRE-RESISTANCE RATED PR A. THE FIRE-RESISTANCE RATING S IS PROVIDED FROM THE WALL TOF |
| ELECTRICAL PAN | NEL: OPTION 1 | |
| | PROPOSED ADU BUILI BUILDINGS ONSITE. TH | ND PROPOSED BUILDINGS DING FOOTPRINT ALONG WITH ANY HIS INCLUDES ALL STRUCUTRES / PO ERED PATIO IS SELECTED, PLEASE |
| | EXISTING BUILDING THE SQUARE FOOTAG | E OF THE EXISTING HOUSE. |
| | T OF PROPOSED ADU LEGEND FOR FOOTPP | |
| | SHOULD BE DRAWN T | TO A MEASURABLE SCALE. |
| | | JSING DASHED LINE IN LEGEND. INE E PROPERTY LINE. |
| LABEL YAF | ONT, REAR, SIDE YARD | DS, AS WELL AS DRIVEWAYS, PATHV |
| DIMENSION WELL AS B | S N THE DISTANCE BETV | WEEN BUILDINGS AND PROPOERTY STRUCTURES. SETBACKS TO SIDE A NIMUM OF (4' - 0"). |
| | LEGEND. MUST INCLU | JDE ALL APPLICABLE EASEMENTS. F TH EASEMENT REQUIREMENTS. |
| | | DERS AIN AWAY FROM THE PROPERTY LIN |
| | SCAPE AREA. REETS & SIDEWALKS | |
| | - | SITE PLAN. EXACT LAYOU |
| | | |
| | | (E) S1 |
| | | |
| | XX' - XX" | |
| (E) SIDEWALK EXAMPLE | | PROPERTY LINE |
| | | |
| | | |
| | (E) SETE | Mart E SHOWN |
| | | MILLEX MILLEX |
| | (DISTANC | |
| AME | XX'-XX" (DISTANCE) NXX° XX'X"W (E) FENCE EXAMPLE | |
| (E) STREET NAME | | |
|) STRI | P.U.E./ | |
| | | ".XX - 'XX |
| | | |
| | ROPER */ | |
| | | XX' - XX" |
| | | (E) SETBACK |
| | L | |
| | XX' - XX" | XX' - XX" |
| _ | SETBACK | x x |
| | | AN EXAMPLE |
| AS-101 | SCALE: 1" = 20'-0" | |




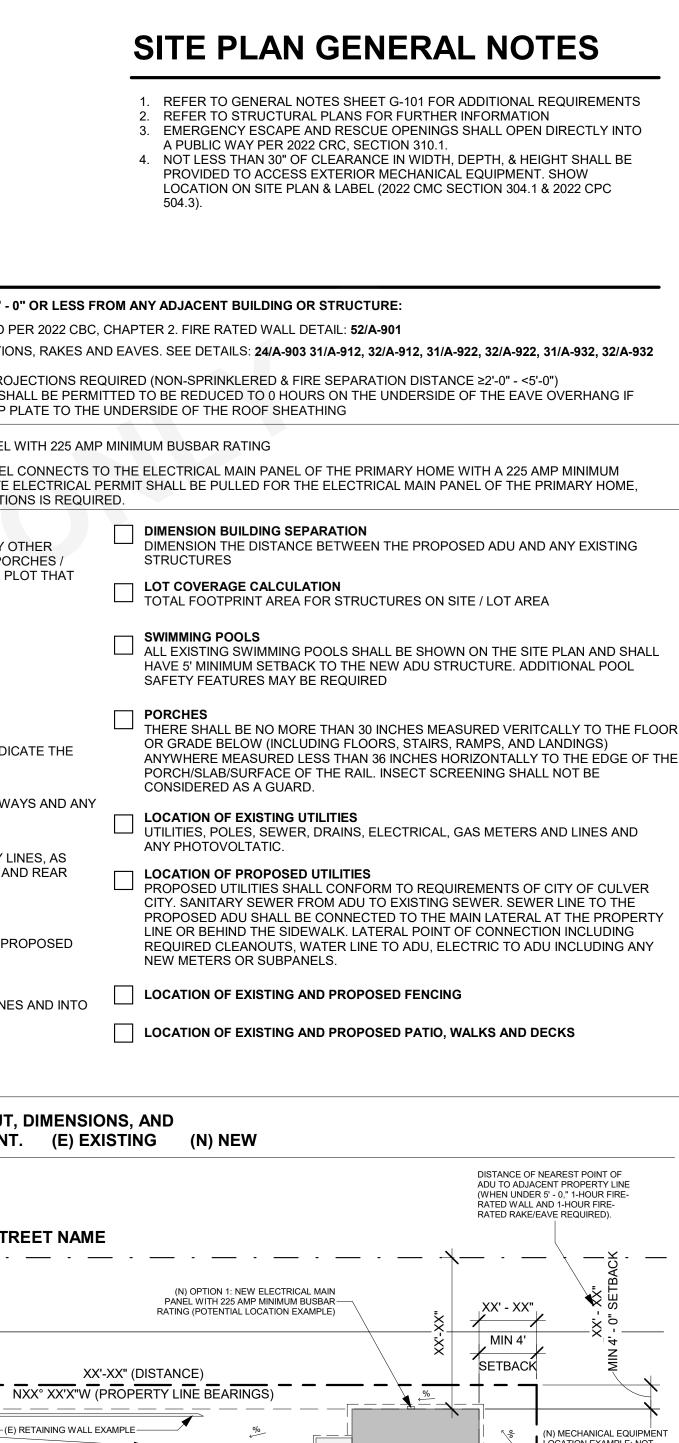

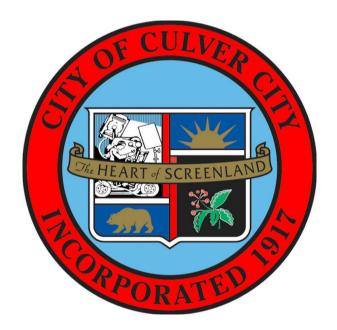

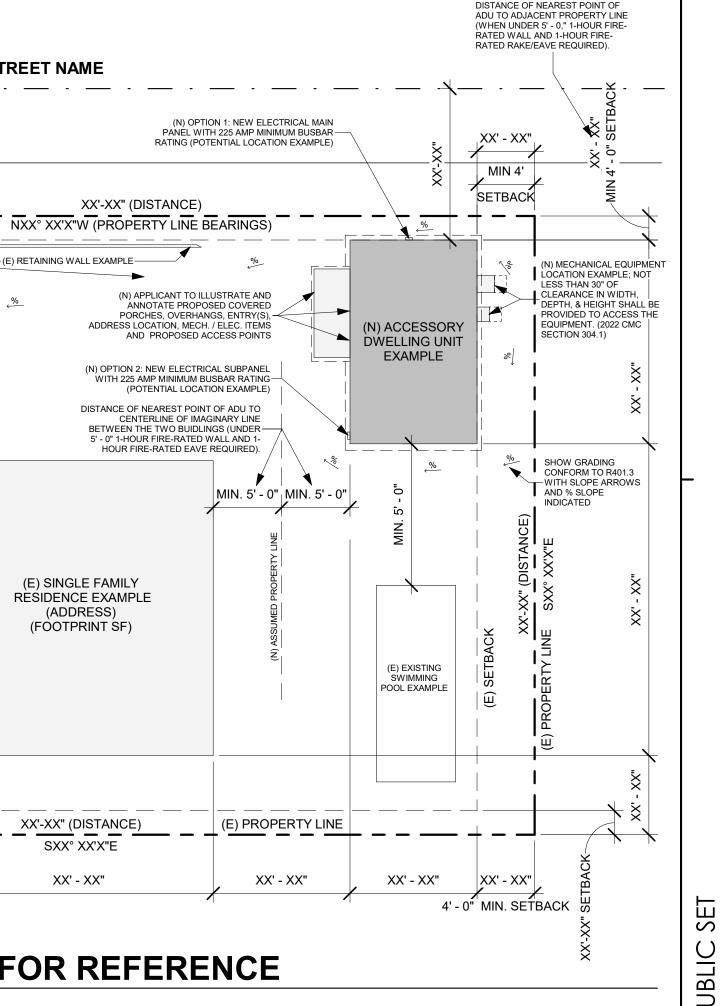

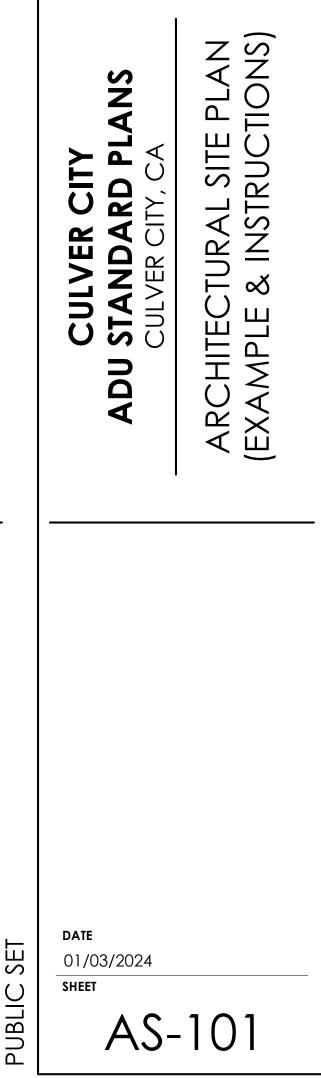

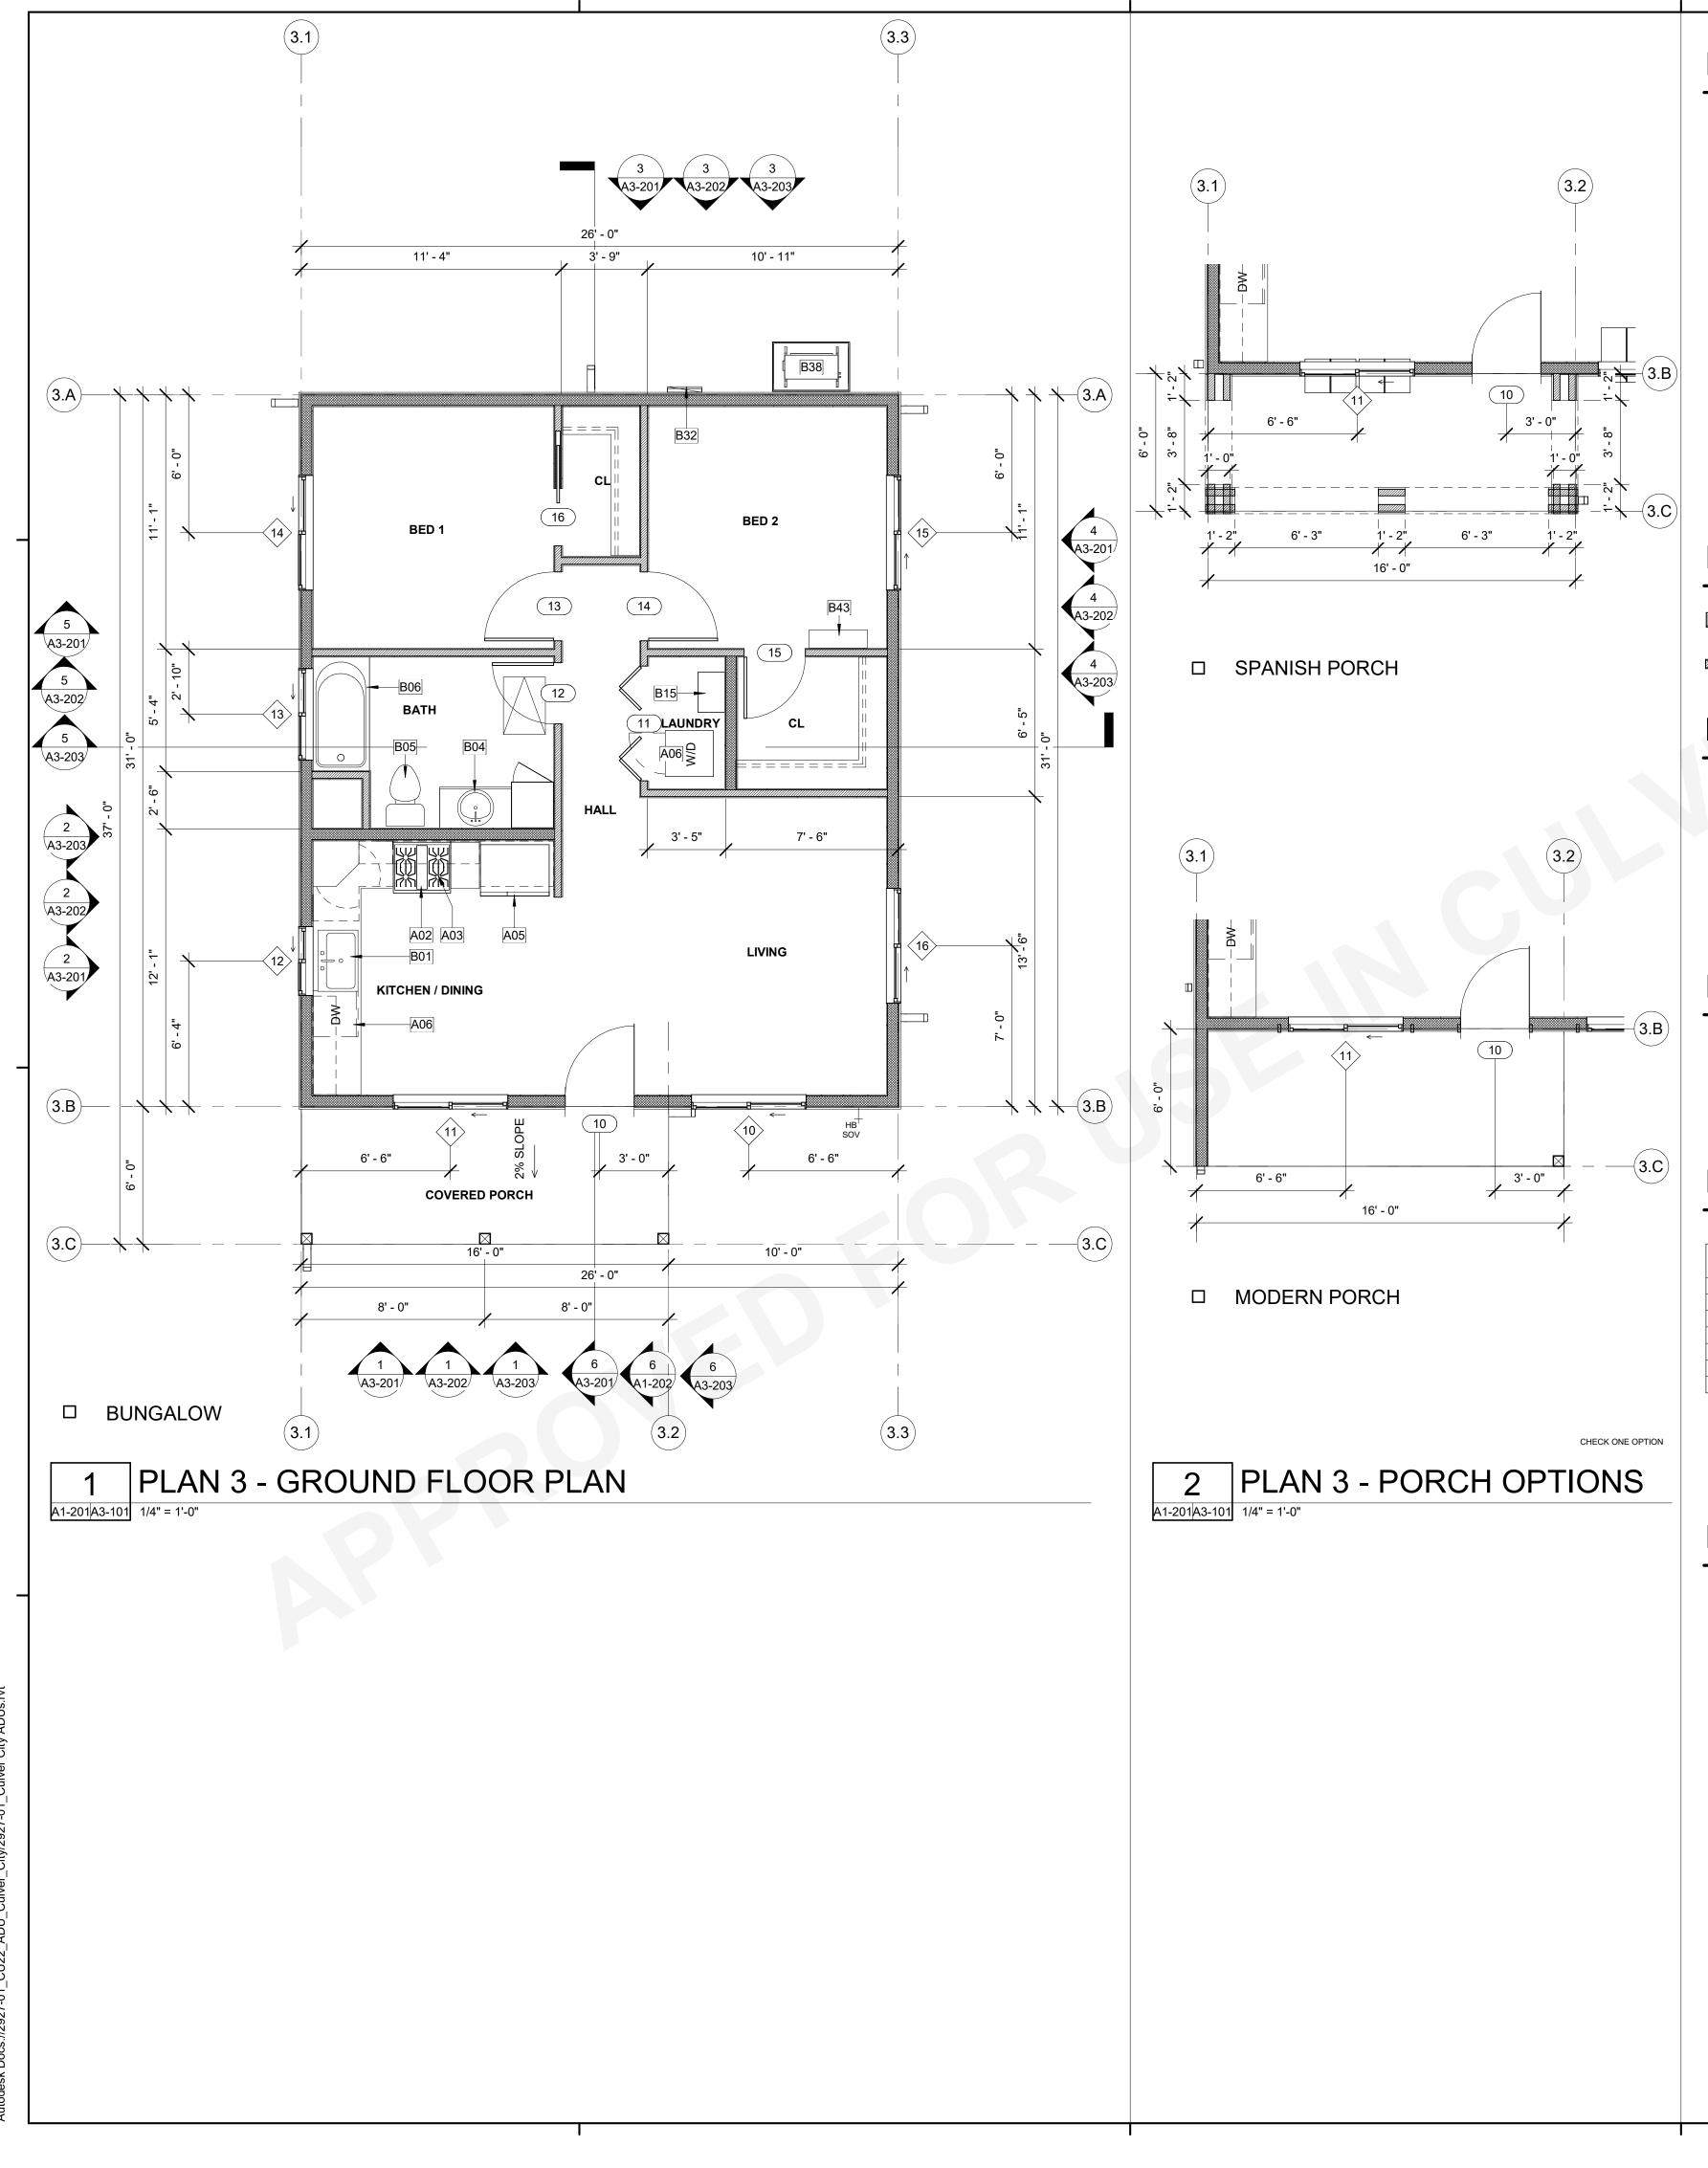

FLOOR PLAN GENERAL NOTES

- 1. REFER TO GENERAL NOTES SHEET G-101 AND G-102 FOR ADDITIONAL REQUIREMENTS.
- REFER TO STRUCTURAL PLANS FOR FURTHER INFORMATION. REFER TO ELECTRICAL PLANS FOR FURTHER INFORMATION IF PROVIDED.
- REFER TO MECHANICAL PLANS, DRAWINGS OR REPORTS FOR FURTHER INFORMATION.
- 5. ALL FURNITURE AND EQUIPMENT IS BY OWNER AND IS SHOWN FOR COORDINATION PURPOSES ONLY.
- 6. DIMENSIONS ARE TO FACE OF FRAMING UNLESS SPECIFICALLY NOTED OTHERWISE. PROVIDE ADEQUATE BLOCKING IN WALLS FOR CABINETS AND OTHER WALL
- MOUNTED ACCESSORIES INCLUDING BUT NOT LIMITED TO HANDRAILS. SHELVING AND BATHROOM FIXTURES. PROVIDE FIREBLOCKING FOR WALL CAVITIES THAT EXCEED 2022 CBC 8.
- HEIGHT LIMITATIONS. DOOR AND WINDOW DIMENSIONS ARE CENTERED AT OPENINGS.
-). WHERE DOOR IS LOCATED WITHOUT DIMENSION AT THE CORNER OF A ROOM IT SHALL BE 4" FROM FACE OF FRAMING OF ADJACENT WALL TO ROUGH DOOR OPENING. 11. ALL DWELLING UNITS CONTAINING A LAUNDRY CONNECTION SHALL HAVE A
- MINIMUM OF ONE PLUMBING FIXTURE CONSTRUCTED TO DIVERT GRAY WATER ONTO THE SUBJECT PROPERTY IN FULL COMPLIANCE WITH CHAPTER 15 OF THE CPC THE PLUMBING FIXTURE(S) CONNECTED TO THE GRAY WATER DISCHARGE SYSTEM MAY BE ANY FIXTURE(S) ALLOWED TO DISCHARGE GRAY WATER UNDER THE CPC. THE GRAY WATER MAY BE UTILIZED FOR LANDSCAPE IRRIGATION OR FOR PERCOLATION INTO SOIL (4.305.2, CCMC 15.02.1125)

FLOOR PLAN LEGEND

EXTERIOR - 2x6 WOOD STUD W/ PLYWOOD SHEATHING SIDING PER ELEVATIONS, ONE LAYER GYPSUM WALL BOARD INTERIOR. INTERIOR - 2x4 WOOD STUD W/ONE LAYER GYPSUM WALL BOARD EACH SIDE.

DOOR GENERAL NOTES

- REFER TO GENERAL NOTES SHEET G-102 FOR ADDITIONAL REQUIREMENTS REFER TO PLANS FOR LOCATION OF DOORS. VERIFY ROUGH OPENING SIZE WITH DOOR MANUFACTURER SPECIFICATIONS
- PRIOR TO CONSTRUCTION. CONTRACTOR TO VERIFY ACTUAL DOOR SIZE TO FIT FINISH OPENING PRIOR
- TO FABRICATION OF DOOR AND FINISH OPENING. GLAZING IN DOORS SHALL BE TEMPERED PER SECTION R308.4.1.
- EGRESS DOORS SHALL BE READILY OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT.


DOOR REMARKS


- PROVIDE 100 SQ INCHES OF VENTING IN DOOR OR BY OTHER APPROVED MEANS
- GLAZING IN DOOR. TEMPERED (BOTH PANES) REFER TO GENERAL NOTE #5 PROVIDE DOOR WITH OPTIONAL WALL.


DOOR SCHEDULE

| | | D | DOR | | |
|------|-----------|---------|---------|---------------|-----|
| MARK | TYPE | WIDTH | HEIGHT | | 5 |
| | | | | | |
| 10 | A | 3' - 0" | 6' - 8" | 2 | 0.2 |
| 11 7 | C) | 5' - 0" | 6' - 8" | 1 | |
| 13 | $A \prec$ | 3' - 0" | 6' - 8" | \rightarrow | |
| 14 (| A | 3' - 0" | 6' - 8" | | |
| 15 📐 | В | 2' - 8" | 6' - 8" | | |
| 16 | D | 2' - 6" | 6' - 8" | | |

DOOR LEGEND











BUNGALOW Α.

SOLID CORE WOOD EXTERIOR








DOUBLE BIFOLD

SPANISH

INTERIOR POCKET DOOR





SINGLE HOLLOW CORE INTERIOR WINDOW GENERAL NOTES

- 1. REFER TO GENERAL NOTES ON SHEET G-101 FOR ADDITIONAL
- REQUIREMENTS REFER TO FLOOR PLANS FOR WINDOW LOCATIONS.
- 3. CONTRACTOR TO VERIFY EXACT ROUGH OPENING SIZES WITH WINDOW MANUFACTURER SPECIFICATIONS PRIOR TO FABRICATION OF ROUGH OPENINGS.
- 4. CONTRACTOR TO VERIFY ACTUAL WINDOW SIZES TO FIT FINISH OPENING PRIOR TO FABRICATION OF WINDOW AND FINISH OPENING. HEAD HEIGHT MEASURED FROM FF UNLESS NOTED OTHERWISE.
- REFER TO ENERGY COMPLIANCE REPORTS FOR U-FACTOR, SHGC AND ADDITIONAL WINDOW REQUIREMENTS. 7. ALL GLAZING IS DOUBLE PANE UNLESS OTHERWISE NOTED.
- PROVIDE SHOP DRAWINGS FOR ALL WINDOW UNITS
- REFER TO WINDOW TYPES LEGEND FOR GLAZING. 10. REFER TO WINDOW SCHEDULE AND WINDOW TYPES LEGEND FOR FURTHER INFORMATION.
- 11. WINDOWS BETWEEN CONDITIONED AND UNCONDITIONED SPACES SHALL BE CAULKED, GASKETED, WEATHER-STRIPPED OR OTHERWISE SEALED. 12. SAFETY GLAZING NOTATED WITH "T"


WINDOW REMARKS

- THE MINIMUM NET CLEAR OPENING HEIGHT DIMENSION SHALL BE 24 INCHES. THE MINIMUM NET CLEAR OPENING WIDTH DIMENSION SHALL BE 20 INCHES . THE NET CLEAR OPENING DIMENSIONS SHALL BE THE RESULT OF NORMAL
- OPERATION OF THE OPENING. PER CRC 2022 SEC. 312.2 SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT GREATER THAN 44
- INCHES MEASURED FROM THE FLOOR. PER CRC 2022 SEC. 310.2.3 3. TEMPERED / SAFETY GLAZING.


WINDOW SCHEDULE

| | | 5 | SIZE | HEAD | | | |
|-----|------|---------|---------|---------|---------|------|----------|
| NO. | TYPE | WIDTH | HEIGHT | HEIGHT | REMARKS | SHGC | U-Factor |
| | | | | | | | |
| 10 | A | 5' - 0" | 4' - 0" | 6' - 8" | 3 | 0.23 | 0.3000 |
| 11 | A | 5' - 0" | 4' - 0" | 6' - 8" | 3 | 0.23 | 0.3000 |
| 12 | A | 3' - 0" | 3' - 0" | 6' - 8" | 3 | 0.23 | 0.3000 |
| 13 | A | 4' - 0" | 2' - 0" | 6' - 8" | 3 | 0.23 | 0.3000 |
| 14 | A | 5' - 0" | 4' - 0" | 6' - 8" | | 0.23 | 0.3000 |
| 15 | A | 5' - 0" | 4' - 0" | 6' - 8" | | 0.23 | 0.3000 |
| 16 | A | 5' - 0" | 4' - 0" | 6' - 8" | | 0.23 | 0.3000 |

WINDOW LEGEND









SLIDER.



DOUBLE HUNG.

KEYNOTES

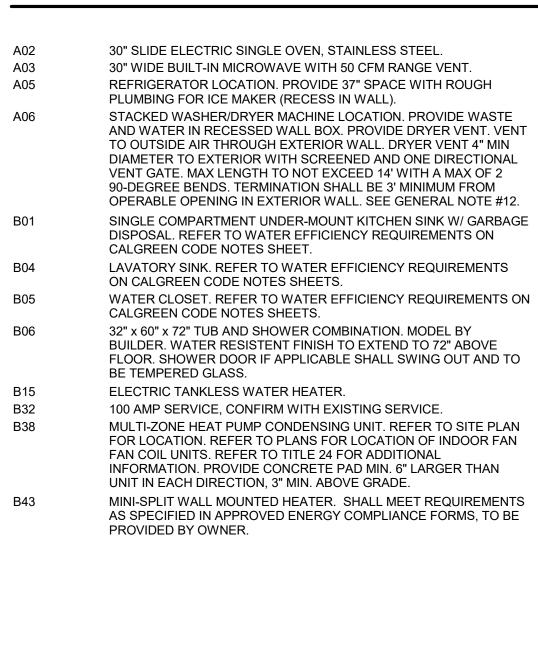

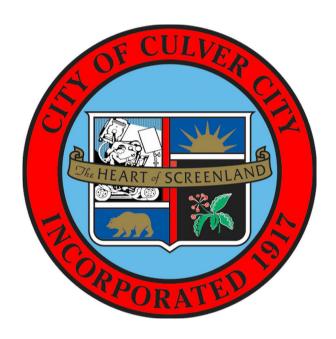


THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.


 \mathcal{O} S Ζ 1 Δ **CIT RD** \mathcal{S} 2 Ζ ΠÖ CULV STANI CULVFP \mathcal{L} \bigcap DATE

SET \bigcirc o UBLI(

01/03/2024 SHEET A3-10






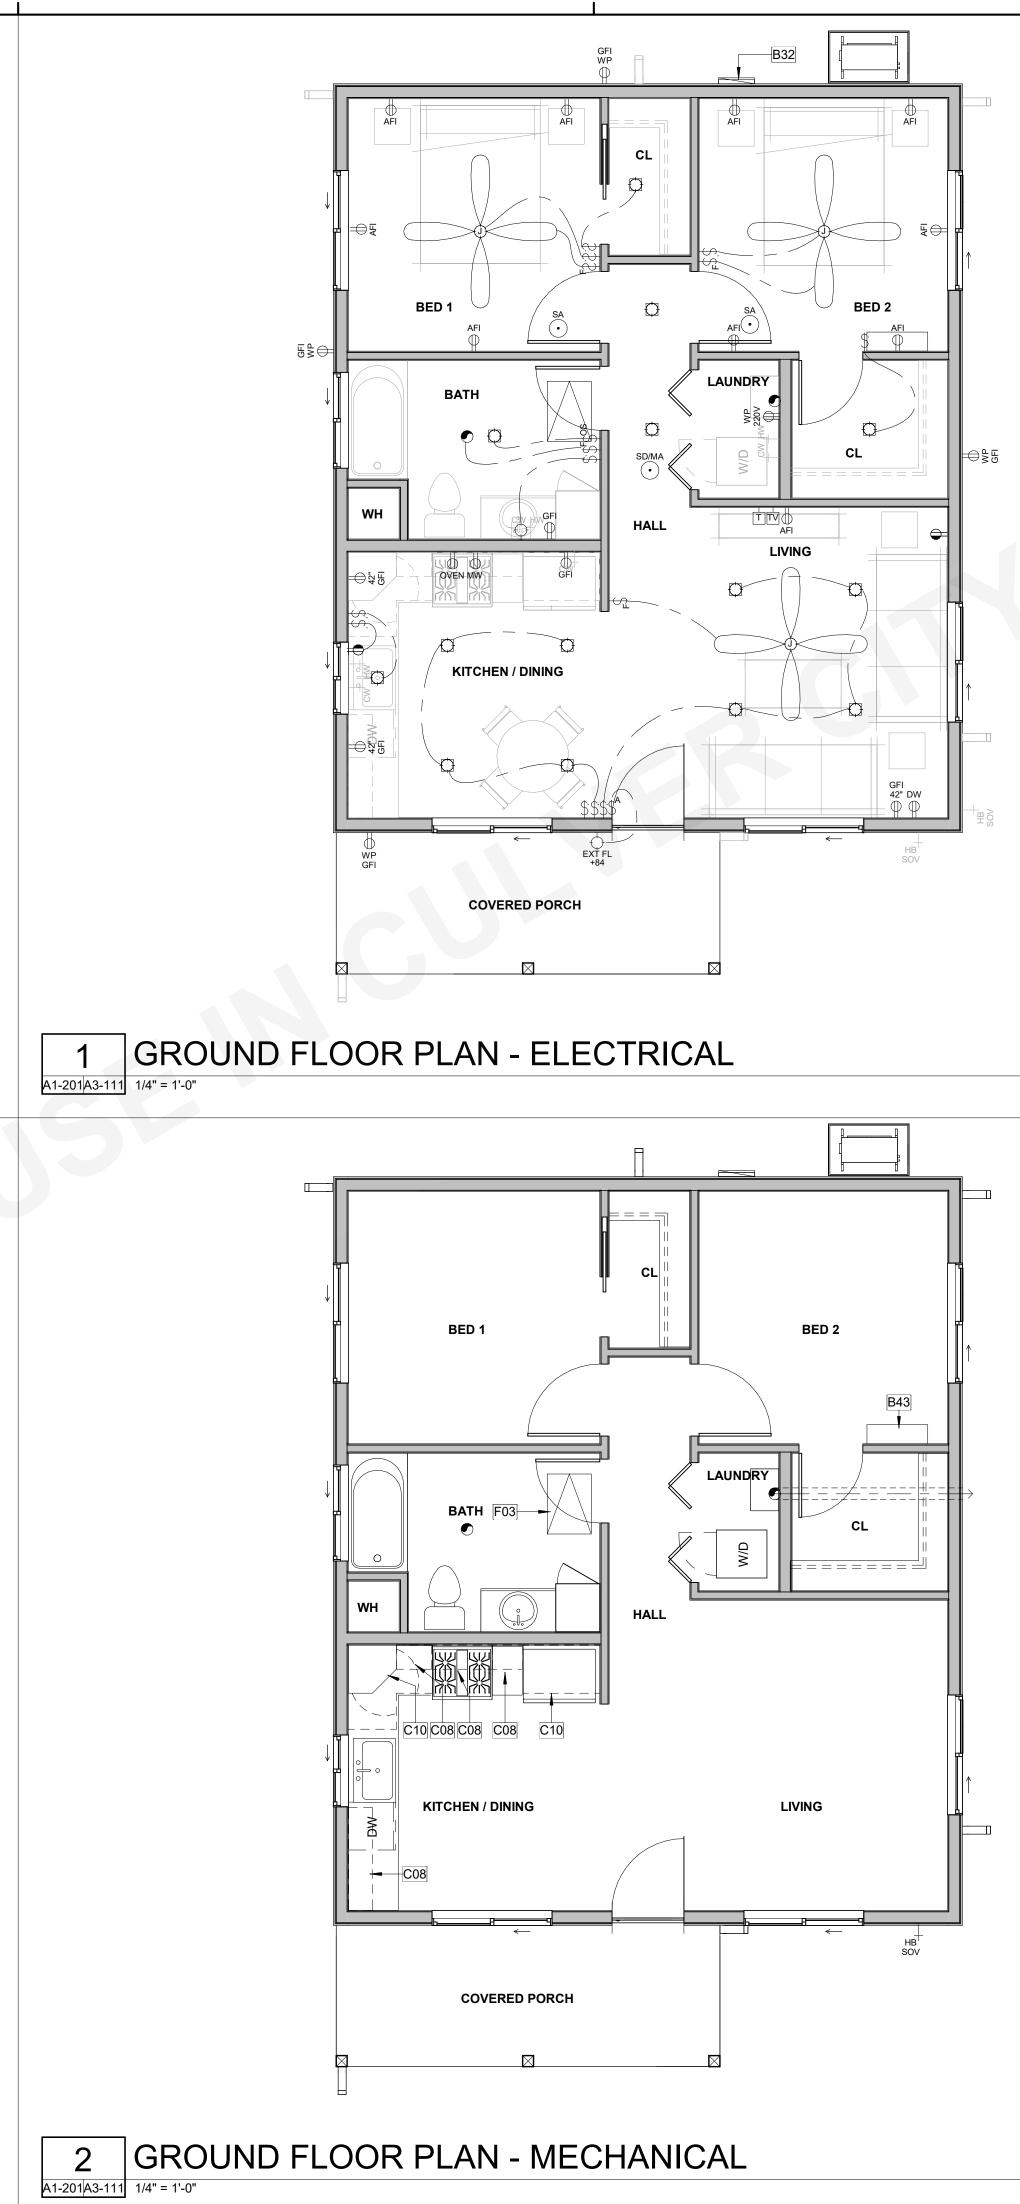

GENERAL MEP NOTES

- 1. REFER TO ELECTRICAL NOTES ON SHEET G-101. REFER TO MECHANICAL NOTES ON SHEET G-101.
- REFER TO PLUMBING NOTES ON SHEET G-101. REFER TO TITLE 24 COMPLIANCE NOTES ON SHEET G-101.
- EXTERNALLY MOUNTED HEATING/COOLING UNITS SHALL BE SCREENED IF THEY ARE VISIBLE FROM A PUBLIC STREET. SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE
- BUILDING WIRING AND BE PROVIDED WITH A BATTERY BACK-UP. ALL SMOKE DETECTORS SHALL BE INTERCONNECTED. ALL SMOKE DETECTORS SHALL MAINTAIN A MINIMUM 3 FOOT CLEARANCE TO HVAC SUPPLY OR RETURN AIR REGISTERS. 7. CARBON MONOXIDE ALARMS SHALL BE INTERCONNECTED.

LEGEND

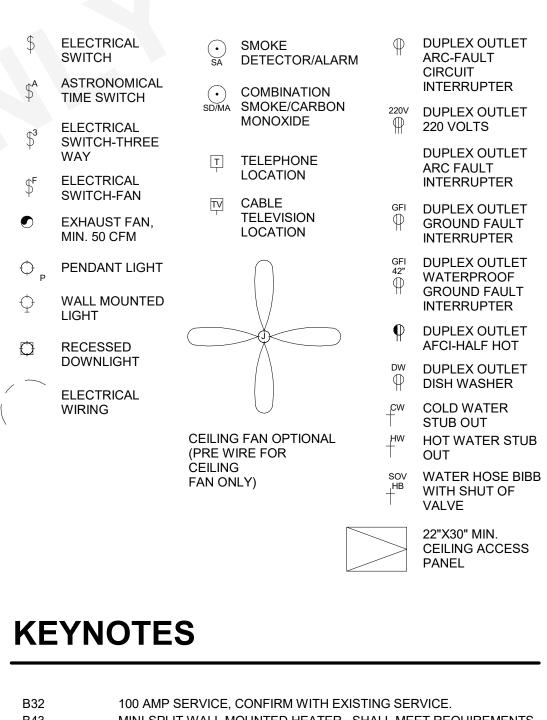

B43 MINI-SPLIT WALL MOUNTED HEATER. SHALL MEET REQUIREMENTS AS SPECIFIED IN APPROVED ENERGY COMPLIANCE FORMS, TO BE PROVIDED BY OWNER. C08 12" DEEP UPPER CABINET 24" DEEP UPPER CABINET. C10 30" X 30" MIN. ATTIC ACCESS. PROVIDED SWITCH AND OUTLET AT F03 ATTIC FOR FAU. PERMANENTLY ATTACH R-38 OR GREATER INSULATION TO ATTIC ACCESS DOOR USING ADHESIVE OR MECHANICAL FASTENERS CEnC 150.0 (a)1. PROVIDE GASKETED

VENTILATION SUMMARIES

PER ASHRAE Standard 62.2, Table 7.1 (Perscriptive Duct Sizing Requirements) (Table 7.1 Assumes no elbows. Deduct 15-feet of allowable duct length for each turn, elbow or fitting. Fan rating cfm @ 0.25 in w.g., and rated at less than one sone.)


ATTIC ACCESS TO PREVENT AIR LEAKAGE CEnC 150.0 (a)1.


LOCAL VENTILATION RATE SUMMARY - BATHROOM(S) Bathroom Minimum Fan Flow (cfm) = 50 cfm per table 7.1, duct size = 4" diameter; Flex Duct

Maximun Allowable Duct Lenghth (ft) =70'

| LOCAL VENTILATION RATE SUMMARY - KITCHEN Kitchen Minimum Fan Flow (cfm) = Per Table 150.0-G | | | | | | | | |
|---|-----------------------|-----|------|------|--|--|--|--|
| TABLE 150.0-G | | | | | | | | |
| DWELLING UNIT FLOOR HOOD OVER AREA (ft2) ELECTRIC RANGE HOOD OVER NATURAL GA | | | | | | | | |
| <750 | <750 150 CFM 280 CFM | | | | | | | |
| | TABLE 150.0-H | | | | | | | |
| FAN AIRFLOW, CFM AT MI 0.25IN. WATER | NIMUM STATIC PRESSU | JRE | <175 | <350 | | | | |
| MINIMUM DUCT DIAMETEI | R, IN. FOR RIGID DUCT | | 7 | 9 | | | | |
| MINIMUM DUCT DIAMETEI | R, IN FOR FLEX DUCT | | 7 | 9 | | | | |
| Maximun Allowable Duct Le | nghth (ft) = 85 Feet | | | | | | | |
| LOCAL VENTILATION RATE SUMMARY - INDOOR AIR QUALITY Per ASHRAE Standard 62.2, CEC Equation 150.0-B TOTAL REQUIRED VENTILATION RATE Qcfm = .03(floor area) + 7.5 (# of bedrooms + 1) STUDIO Qcfm = .03(205) + 7.5 (0 + 1) Qcfm = 13.65 DUCT SIZE PER ASHRAE TABLE 7.1 REFER TO LEGEND FOR INDOOR AIR QUALITY FAN (IAQ) | | | | | | | | |
| CONTINOUS FAN FLOW (CFM) = 50 CFM MINIMUM | | | | | | | | |
| Per Table 7.1, Duct Size= 4" Diameter; Smooth duct Maximun Allowable Duct Lenghth (ft) = 35' OR Per Table 7.1, Duct Size= 5" Diameter; FLEX DUCT Maximun Allowable Duct Lenghth (ft) = 70' | | | | | | | | |
| | | | | | | | | |



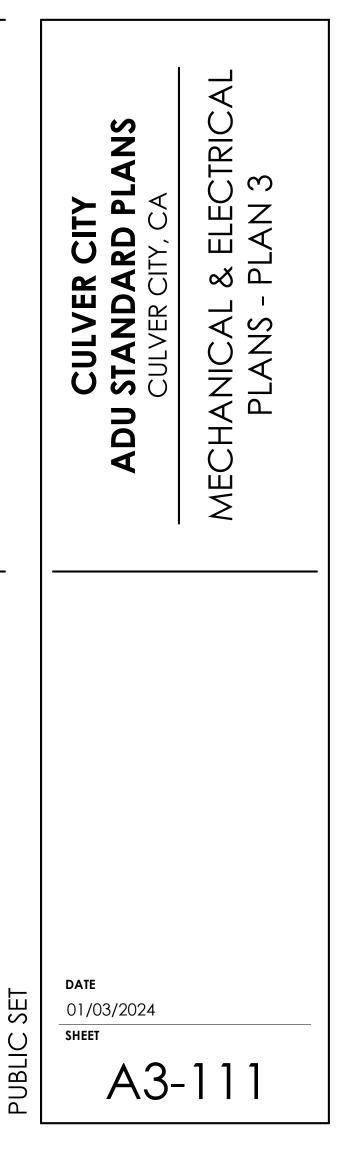

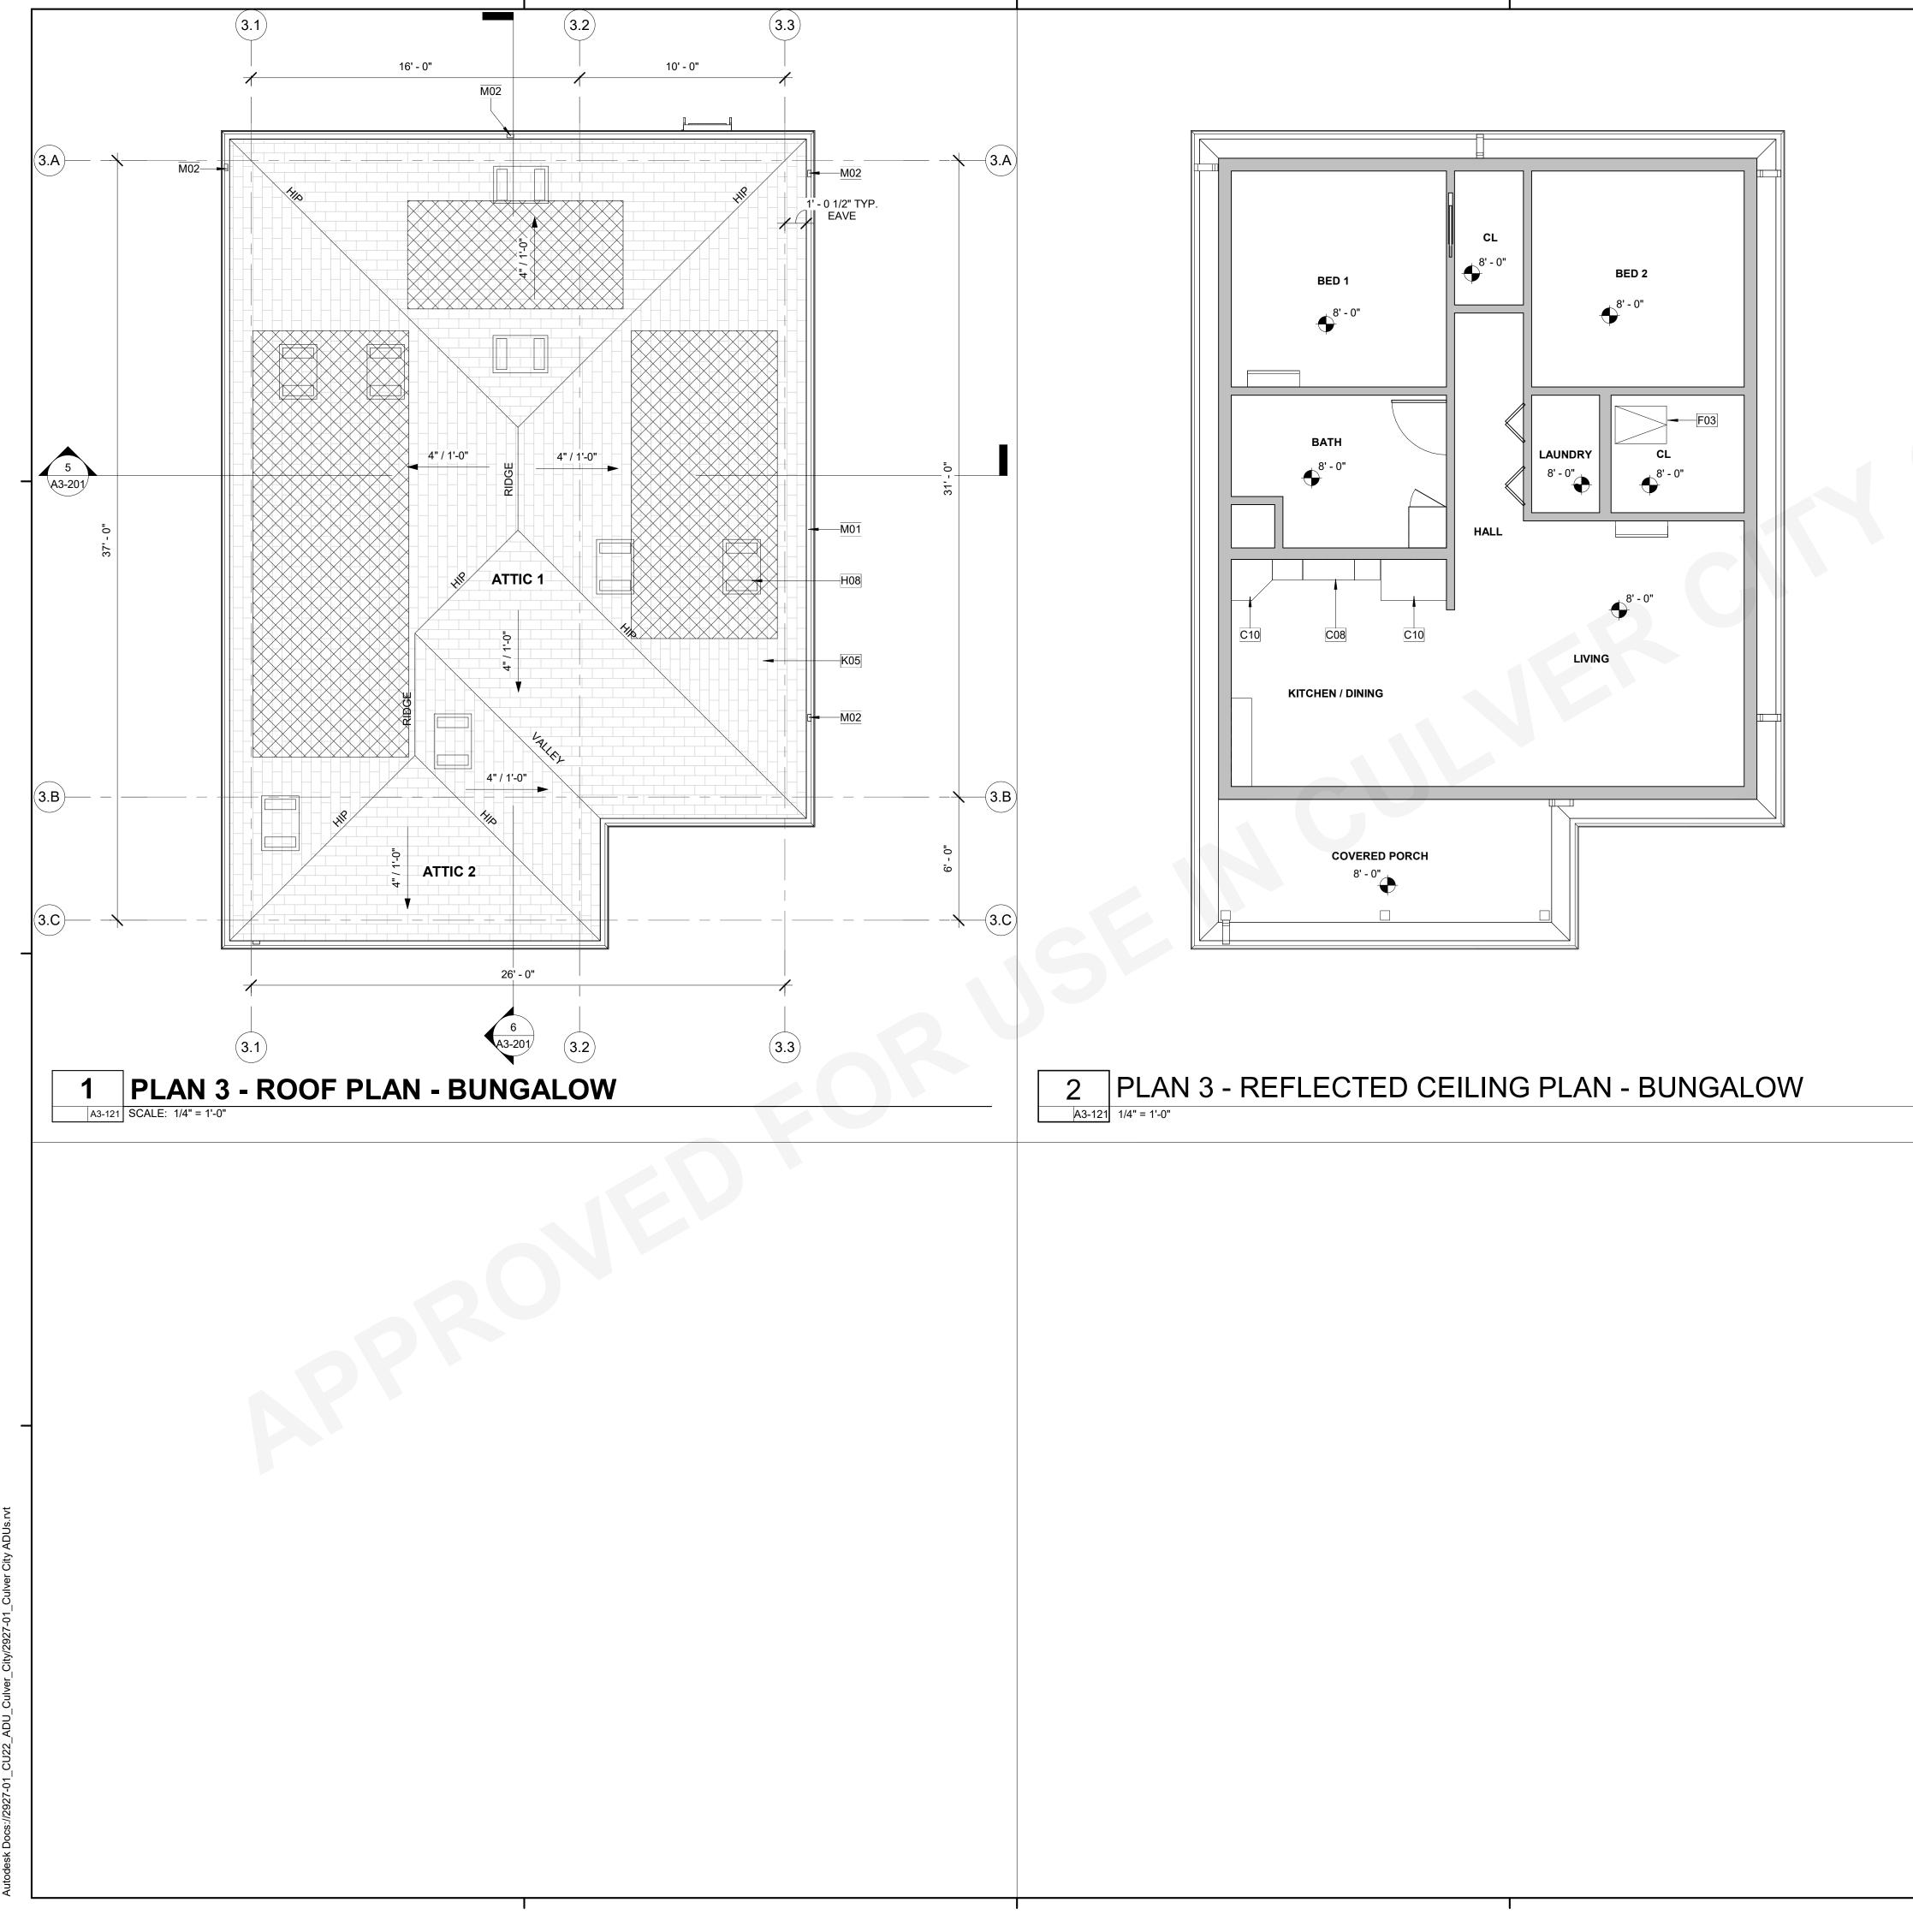

ROOF PLAN GENERAL NOTES

- 1. REFER TO GENERAL NOTES SHEET G-102 FOR ADDITIONAL REQUIREMENTS 2. REFER TO STRUCTURAL PLANS FOR ROOF FRAMING INFORMATION
- INCLUDING MEMBER SIZES AND CONNECTION HARDWARE. 3. PROVIDE A MINIMUM OF 1 INCH OF AIRSPACE BETWEEN THE INSULATION AND ROOF SHEATHING.
- 4. WHERE THE ROOF PROFILE ALLOWS A SPACE BETWEEN THE ROOF COVERING AND DECKING, THE SPACES SHALL BE CONSTRUCTED TO PREVENT THE INTRUSION OF FLAMES AND EMBERS, BE FIRESTOPPED WITH APPROVED MATERIALS OR HAVE ONE LAYER OF MINIMUM 72 POUND MINERAL-SURFACED NONPERFORATED CAP SHEET OVER THE COMBUSTIBLE DECKING.
- 5. ALL ROOFING MATERIALS TO BE INSTALLED PER MANUFACTURER'S SPECS. 6. OVERHANG DIMENSIONS ARE FROM FACE OF EXTERIOR WALL FRAMING TO ROOF EDGE.
- ROOF VENTS SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS. ADJUST AS NEEDED TO ACCOMMODATE TRUSS LOCATIONS, PLUMBING VENTS, AND SOLAR COLLECTORS.

ROOF VENTING CALCULATIONS

UPPER VENTS: O'HAGIN TAPERED LOW PROFILE STANDARD LINE 72.0 SQ.IN OF AIR MOVEMENT PER VENT = 72. SQ.IN. / 144 = 0.5 SF

LOWER VENTS: O'HAGIN TAPERED LOW PROFILE STANDARD LINE 72.0 SQ.IN OF AIR MOVEMENT PER VENT = 72. SQ.IN. / 144 = 0.5 SF

"UPPER VENTS PROVIDED" = (TOTAL ATTIC AREA/300) * (0.5) / (0.5 SF) "LOWER VENTS PROVIDED" = (TOTAL ATTIC AREA/300) * (0.5) / (0.5 SF)

| ATTIC | AREA | | RED ATTI ING (NFA | | UPPER VEN REQUIRED | | | r venting Red (NFA) |
|----------------------------|---------|---------|----------------------|-----------|-----------------------|----------------------|------------------------------|------------------------|
| ATTIC 1 - PLAN 3 | 777 SF | 2.59 SF | | | 1.29 SF | | 1.29 SF | |
| ATTIC 1 - PLAN 3 | 97 SF | 0.32 SF | | | 0.16 SF | | 0.16 SF | |
| VENT TYPE COU | | COUNT | VE | NT LENGTH | ARE | FREE A PER ENT | PROVIDED NET FREE AREA | |
| ATTIC 1 - PLAN 3 LOWER | | | | | | | | |
| O'HAGIN SHINGLE (LOWER) | ROOF VE | ENT | 4 | 2' - | 8" | 0.50 S | F | 2.00 SF |
| UPPER | | | | | | | | - |
| O'HAGIN SHINGLE (UPPER) | ROOF VE | ENT | 4 | 2' - | 8" | 0.50 S | F | 2.00 SF |
| | | | 1 | 1 | | 1 | | 4.00 SF |

- OPENINGS SHALL HAVE CORROSION-RESISTANT WIRE MESH OR OTHER а. APPROVED MATERIAL WITH 1/16-IN. MINIMUM AND 1/4-IN. MAXIMUM OPENING. (R806.1)
- A MINIMUM OF 1-IN. AIRSPACE SHALL BE PROVIDED BETWEEN INSULATION AND ROOF SHEATHING. (R806.3) UNVENTED ATTIC ASSEMBLIES SHALL MEET ALL CONDITIONS IN SECTION C.
- R806.5. PROVIDE CLASS I OR II VAPOR RETARDER IS INSTALLED ON THE WARM-IN-WINTER SIDE OF THE CEILING. (R806.2)

KEYNOTES

C08 C10

F03

12" DEEP UPPER CABINET 24" DEEP UPPER CABINET.

30" X 30" MIN. ATTIC ACCESS. PROVIDED SWITCH AND OUTLET AT ATTIC FOR FAU. PERMANENTLY ATTACH R-38 OR GREATER INSULATION TO ATTIC ACCESS DOOR USING ADHESIVE OR MECHANICAL FASTENERS CEnC 150.0 (a)1. PROVIDE GASKETED ATTIC ACCESS TO PREVENT AIR LEAKÀGE CEnC 150.0 (a)1.

RCP GENERAL NOTES

- 1. REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS. 2. HEIGHT OF CEILINGS SHALL BE MEASURED FROM TOP OF SLAB OR FLOOR TO FINISH FACE OF GWB, U.N.O.
- 3. REFER TO DETAILS FOR FLOOR/CEILING ASSEMBLIES.
- 4. REFER TO ELECTRICAL PLANS FOR LIGHT FIXTURE LOCATIONS.
- DIMENSIONS ARE TO THE FACE OF FRAMING UNLESS OTHERWISE NOTED. 6. SOFFITS ARE TO BE HELD TIGHT TO UNDERSIDE OF MECHANICAL EQUIPMENT.


ATTIC SPACE. REFER TO ROOF VENTING CALCULATIONS FOR

| LEGEND | | | | | | | | |
|----------|--|--|--|--|--|--|--|--|
| 2" / 12" | ROOF SLOPE (REFER TO PLANS FOR ACTUAL SLOPE) | | | | | | | |
| | O'HAGIN ATTIC VENT, PAINT TO MATCH ROOF COLOR. (REFER TO EXTERIOR ELEVATIONS FOR COLORS AND MATERIALS.) | | | | | | | |
| | WALL BELOW | | | | | | | |
| | GUTTER, CONNECT TO DOWNSPOUT | | | | | | | |
| | -DOWNSPOUT, TO ROOF OR SPLASHBLOCK BELOW U.N.O. | | | | | | | |
| | FUTURE SOLAR ZONE. REFER TO SOLAR READY NOTES ON SHEET G-101. | | | | | | | |
| | | | | | | | | |

AREA AND VENTING METHOD

ATTIC #

| CULVER CITY ADU STANDARD PLANS CULVER CITY, CA | ROOF & REFLECTIVE CEILING PLANS - BUNGALOW - PLAN 3 |
|--|--|
| DATE 01/03/2024 SHEET A3- | -121 |

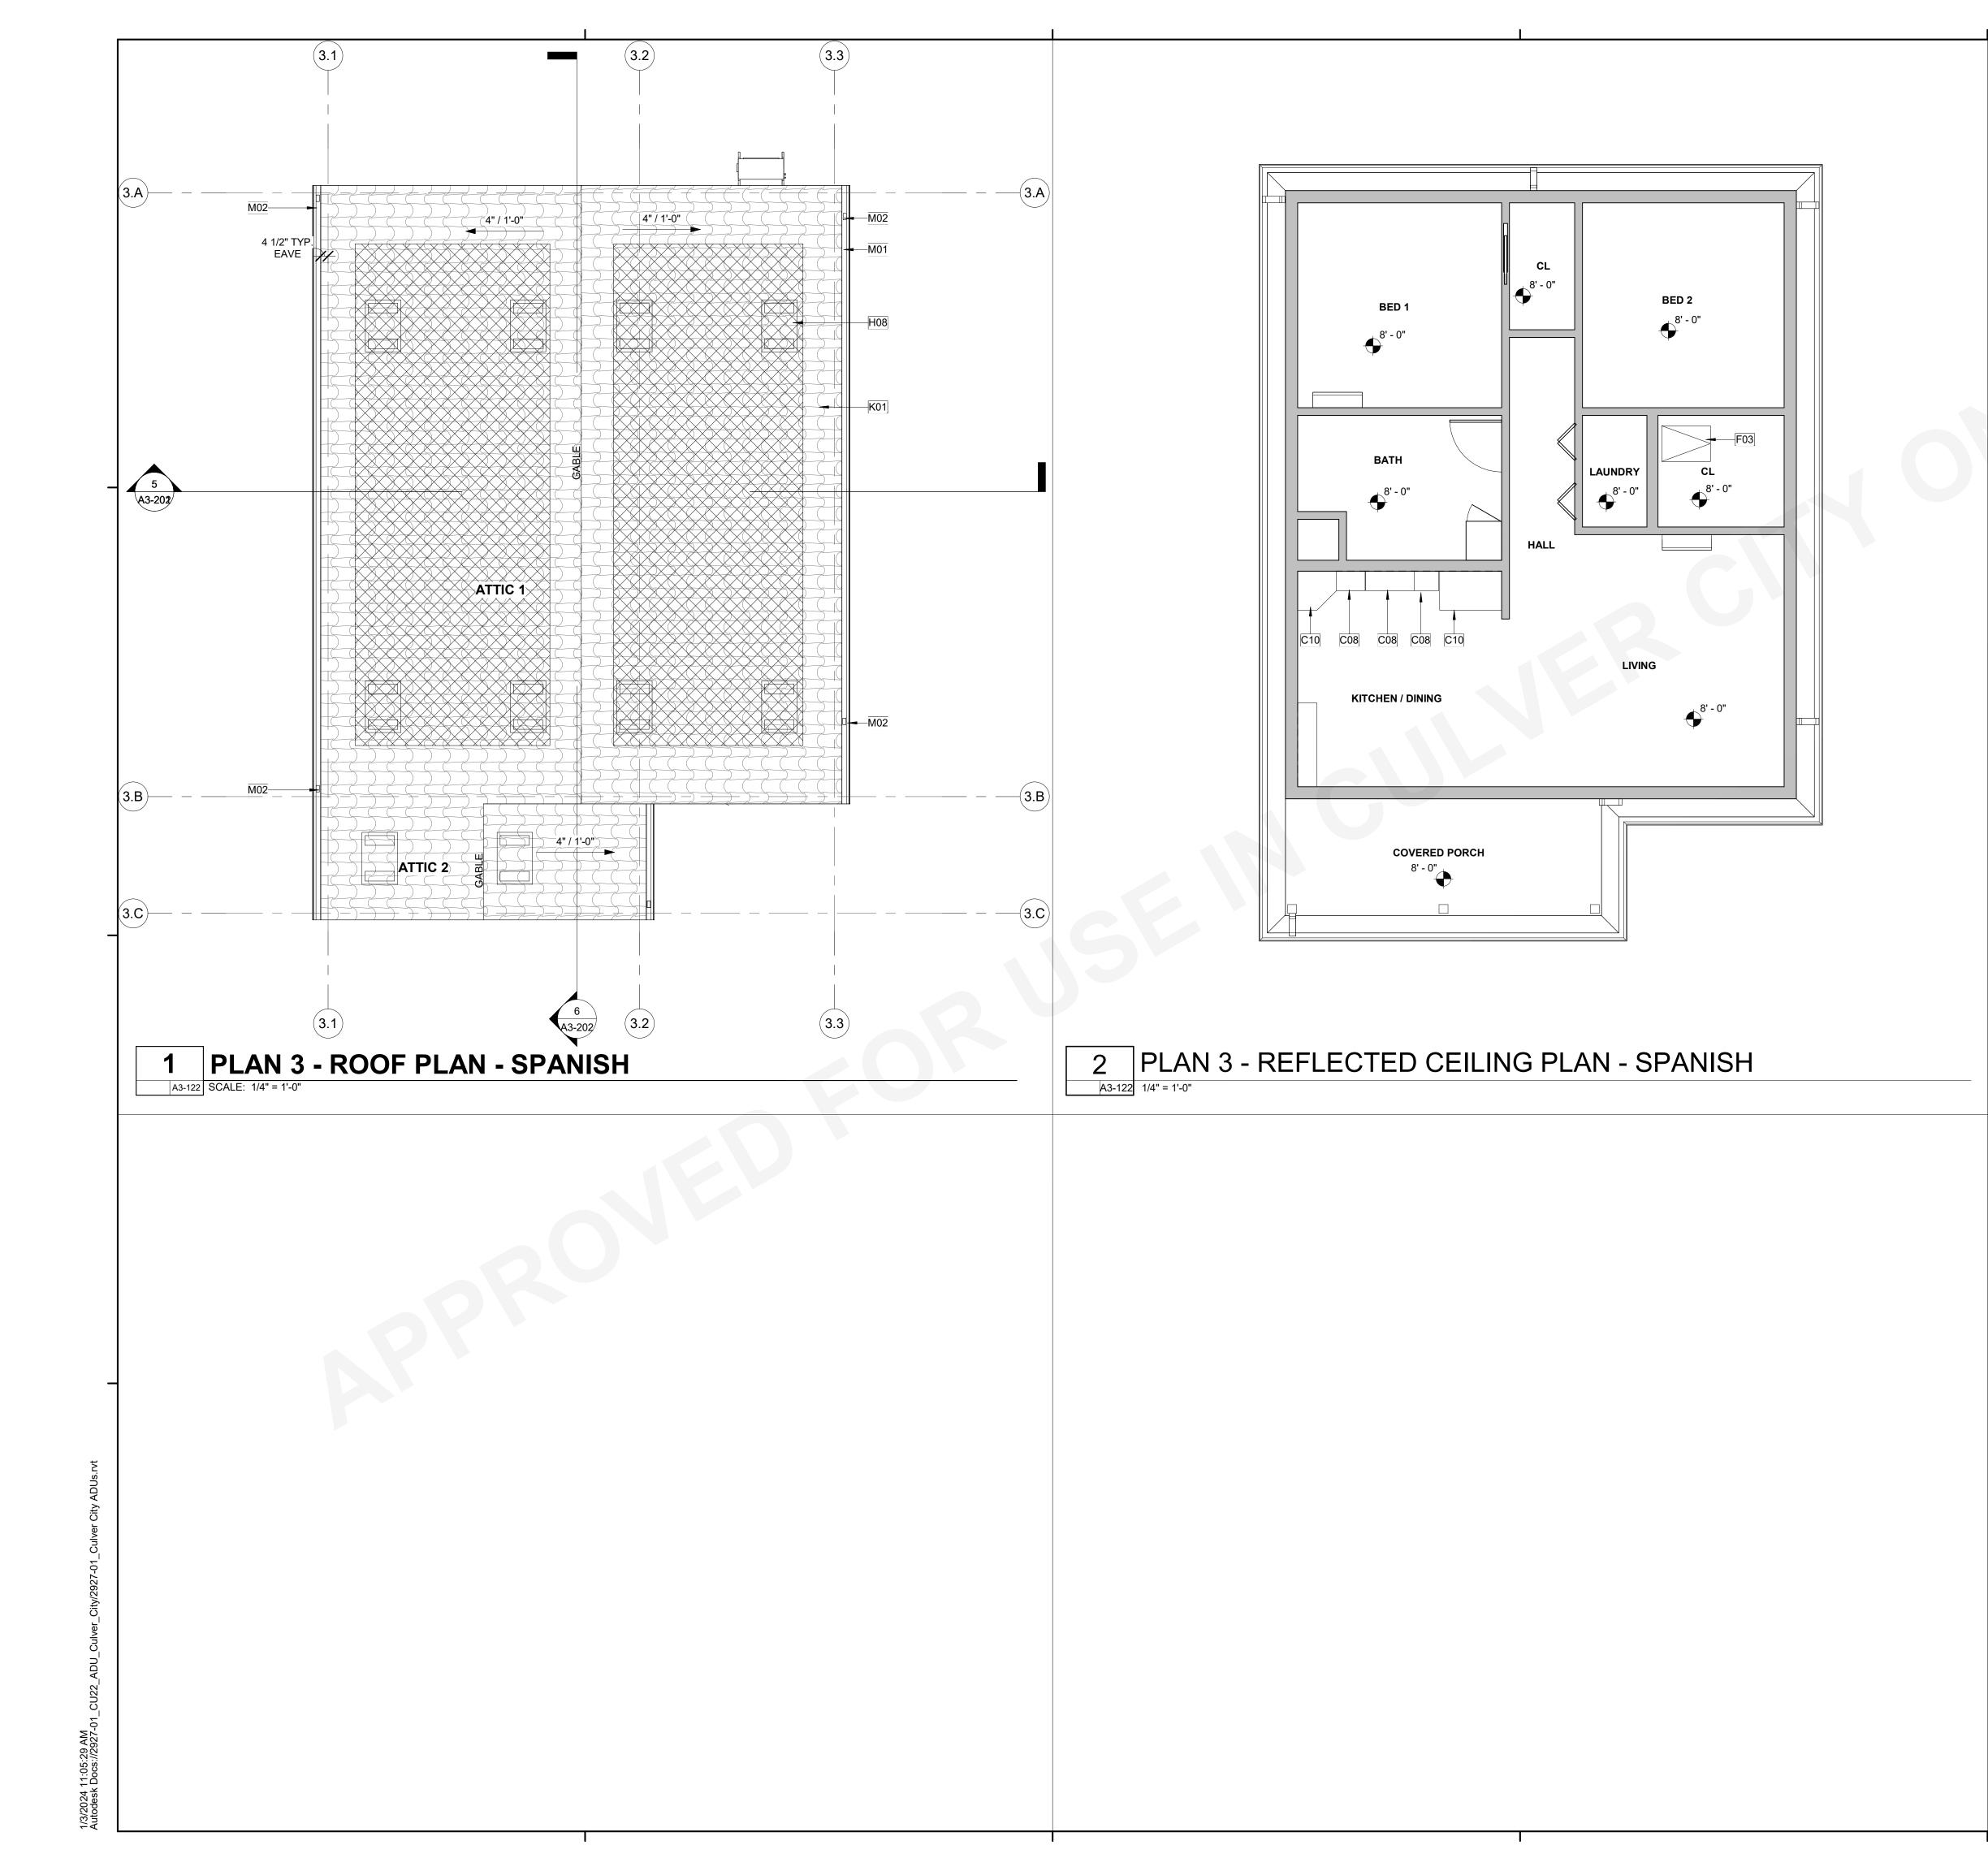

ROOF PLAN GENERAL NOTES

- 1. REFER TO GENERAL NOTES SHEET G-102 FOR ADDITIONAL REQUIREMENTS 2. REFER TO STRUCTURAL PLANS FOR ROOF FRAMING INFORMATION
- INCLUDING MEMBER SIZES AND CONNECTION HARDWARE. 3. PROVIDE A MINIMUM OF 1 INCH OF AIRSPACE BETWEEN THE INSULATION AND ROOF SHEATHING.
- 4. WHERE THE ROOF PROFILE ALLOWS A SPACE BETWEEN THE ROOF COVERING AND DECKING, THE SPACES SHALL BE CONSTRUCTED TO PREVENT THE INTRUSION OF FLAMES AND EMBERS, BE FIRESTOPPED WITH APPROVED MATERIALS OR HAVE ONE LAYER OF MINIMUM 72 POUND MINERAL-SURFACED NONPERFORATED CAP SHEET OVER THE COMBUSTIBLE DECKING.
- 5. ALL ROOFING MATERIALS TO BE INSTALLED PER MANUFACTURER'S SPECS. 6. OVERHANG DIMENSIONS ARE FROM FACE OF EXTERIOR WALL FRAMING TO ROOF EDGE.
- ROOF VENTS SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS. ADJUST AS NEEDED TO ACCOMMODATE TRUSS LOCATIONS, PLUMBING VENTS, AND SOLAR COLLECTORS.

ROOF VENTING CALCULATIONS

UPPER VENTS: O'HAGIN TAPERED LOW PROFILE STANDARD LINE 72.0 SQ.IN OF AIR MOVEMENT PER VENT = 72. SQ.IN. / 144 = 0.5 SF

LOWER VENTS: O'HAGIN TAPERED LOW PROFILE STANDARD LINE 72.0 SQ.IN OF AIR MOVEMENT PER VENT = 72. SQ.IN. / 144 = 0.5 SF

"UPPER VENTS PROVIDED" = (TOTAL ATTIC AREA/300) * (0.5) / (0.5 SF)

"LOWER VENTS PROVIDED" = (TOTAL ATTIC AREA/300) * (0.5) / (0.5 SF)

| | | REQUI | RED ATT | IC | UPPER VEN | TING | LOWE | R VENTING |
|----------------------------|-----------|---------|----------|------|-----------|--------|----------------|----------------------|
| ATTIC | AREA | VENT | ING (NFA |) | REQUIRED | (NFA) | REQUI | RED (NFA) |
| | | | | | | | | |
| ATTIC 1 - PLAN 3 | 777 SF | 2.59 SF | | | 1.29 SF | | 1.29 SF | |
| ATTIC 1 - PLAN 3 | 97 SF | 0.32 SF | | | 0.16 SF | | 0.16 SF | |
| | | | | | | | | |
| | | | | | | ARE | FREE FA PER | PROVIDED NET FREE |
| VENT | TYPE | | COUNT | VE | NT LENGTH | V | ENT | AREA |
| ATTIC 1 - PLAN 3 LOWER | | | | | | | | |
| O'HAGIN SHINGLE (LOWER) | E ROOF VI | ENT | 4 | 2' - | - 8" | 0.50 S | F | 2.00 SF |
| UPPER | | | | | | | | |
| O'HAGIN SHINGLE (UPPER) | E ROOF VI | ENT | 4 | 2' - | - 8" | 0.50 S | F | 2.00 SF |
| | | | | | | | | 4.00 SF |

- OPENINGS SHALL HAVE CORROSION-RESISTANT WIRE MESH OR OTHER а. APPROVED MATERIAL WITH 1/16-IN. MINIMUM AND 1/4-IN. MAXIMUM **OPENING. (R806.1)**
- A MINIMUM OF 1-IN. AIRSPACE SHALL BE PROVIDED BETWEEN INSULATION AND ROOF SHEATHING. (R806.3) UNVENTED ATTIC ASSEMBLIES SHALL MEET ALL CONDITIONS IN SECTION
- R806.5.
- PROVIDE CLASS I OR II VAPOR RETARDER IS INSTALLED ON THE WARM-IN-WINTER SIDE OF THE CEILING. (R806.2)

KEYNOTES

C08 C10 F03

12" DEEP UPPER CABINET 24" DEEP UPPER CABINET.

30" X 30" MIN. ATTIC ACCESS. PROVIDED SWITCH AND OUTLET AT ATTIC FOR FAU. PERMANENTLY ATTACH R-38 OR GREATER INSULATION TO ATTIC ACCESS DOOR USING ADHESIVE OR MECHANICAL FASTENERS CEnC 150.0 (a)1. PROVIDE GASKETED ATTIC ACCESS TO PREVENT AIR LEAKAGE CEnC 150.0 (a)1.

RCP GENERAL NOTES

- 1. REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS. 2. HEIGHT OF CEILINGS SHALL BE MEASURED FROM TOP OF SLAB OR FLOOR TO FINISH FACE OF GWB, U.N.O.
- 3. REFER TO DETAILS FOR FLOOR/CEILING ASSEMBLIES.
- 4. REFER TO ELECTRICAL PLANS FOR LIGHT FIXTURE LOCATIONS.
- DIMENSIONS ARE TO THE FACE OF FRAMING UNLESS OTHERWISE NOTED. 6. SOFFITS ARE TO BE HELD TIGHT TO UNDERSIDE OF MECHANICAL EQUIPMENT.

| LEGEND | | | | | | | | |
|------------------|--|--|--|--|--|--|--|--|
| 2 " / 12" | ROOF SLOPE (REFER TO PLANS FOR ACTUAL SLOPE) | | | | | | | |
| | O'HAGIN ATTIC VENT, PAINT TO MATCH ROOF COLOR. (REFER TO EXTERIOR ELEVATIONS FOR COLORS AND MATERIALS.) WALL BELOW | | | | | | | |
| | GUTTER, CONNECT TO DOWNSPOUT DOWNSPOUT, TO ROOF OR SPLASHBLOCK BELOW U.N.O. | | | | | | | |
| | FUTURE SOLAR ZONE. REFER TO SOLAR READY NOTES ON SHEET G-101. | | | | | | | |

ATTIC SPACE. REFER TO ROOF VENTING CALCULATIONS FOR ATTIC # AREA AND VENTING METHOD



THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

E CEILING PLAN 3

Ш

REFLECTIVE SPANISH -

ROOF & PLANS

ANS

CITY RD PL

CULVER STANDAI CULVER CIT

DO

4

DATE

SHEET

01/03/2024


A3-122

SET

()

PUBLI

CITY,

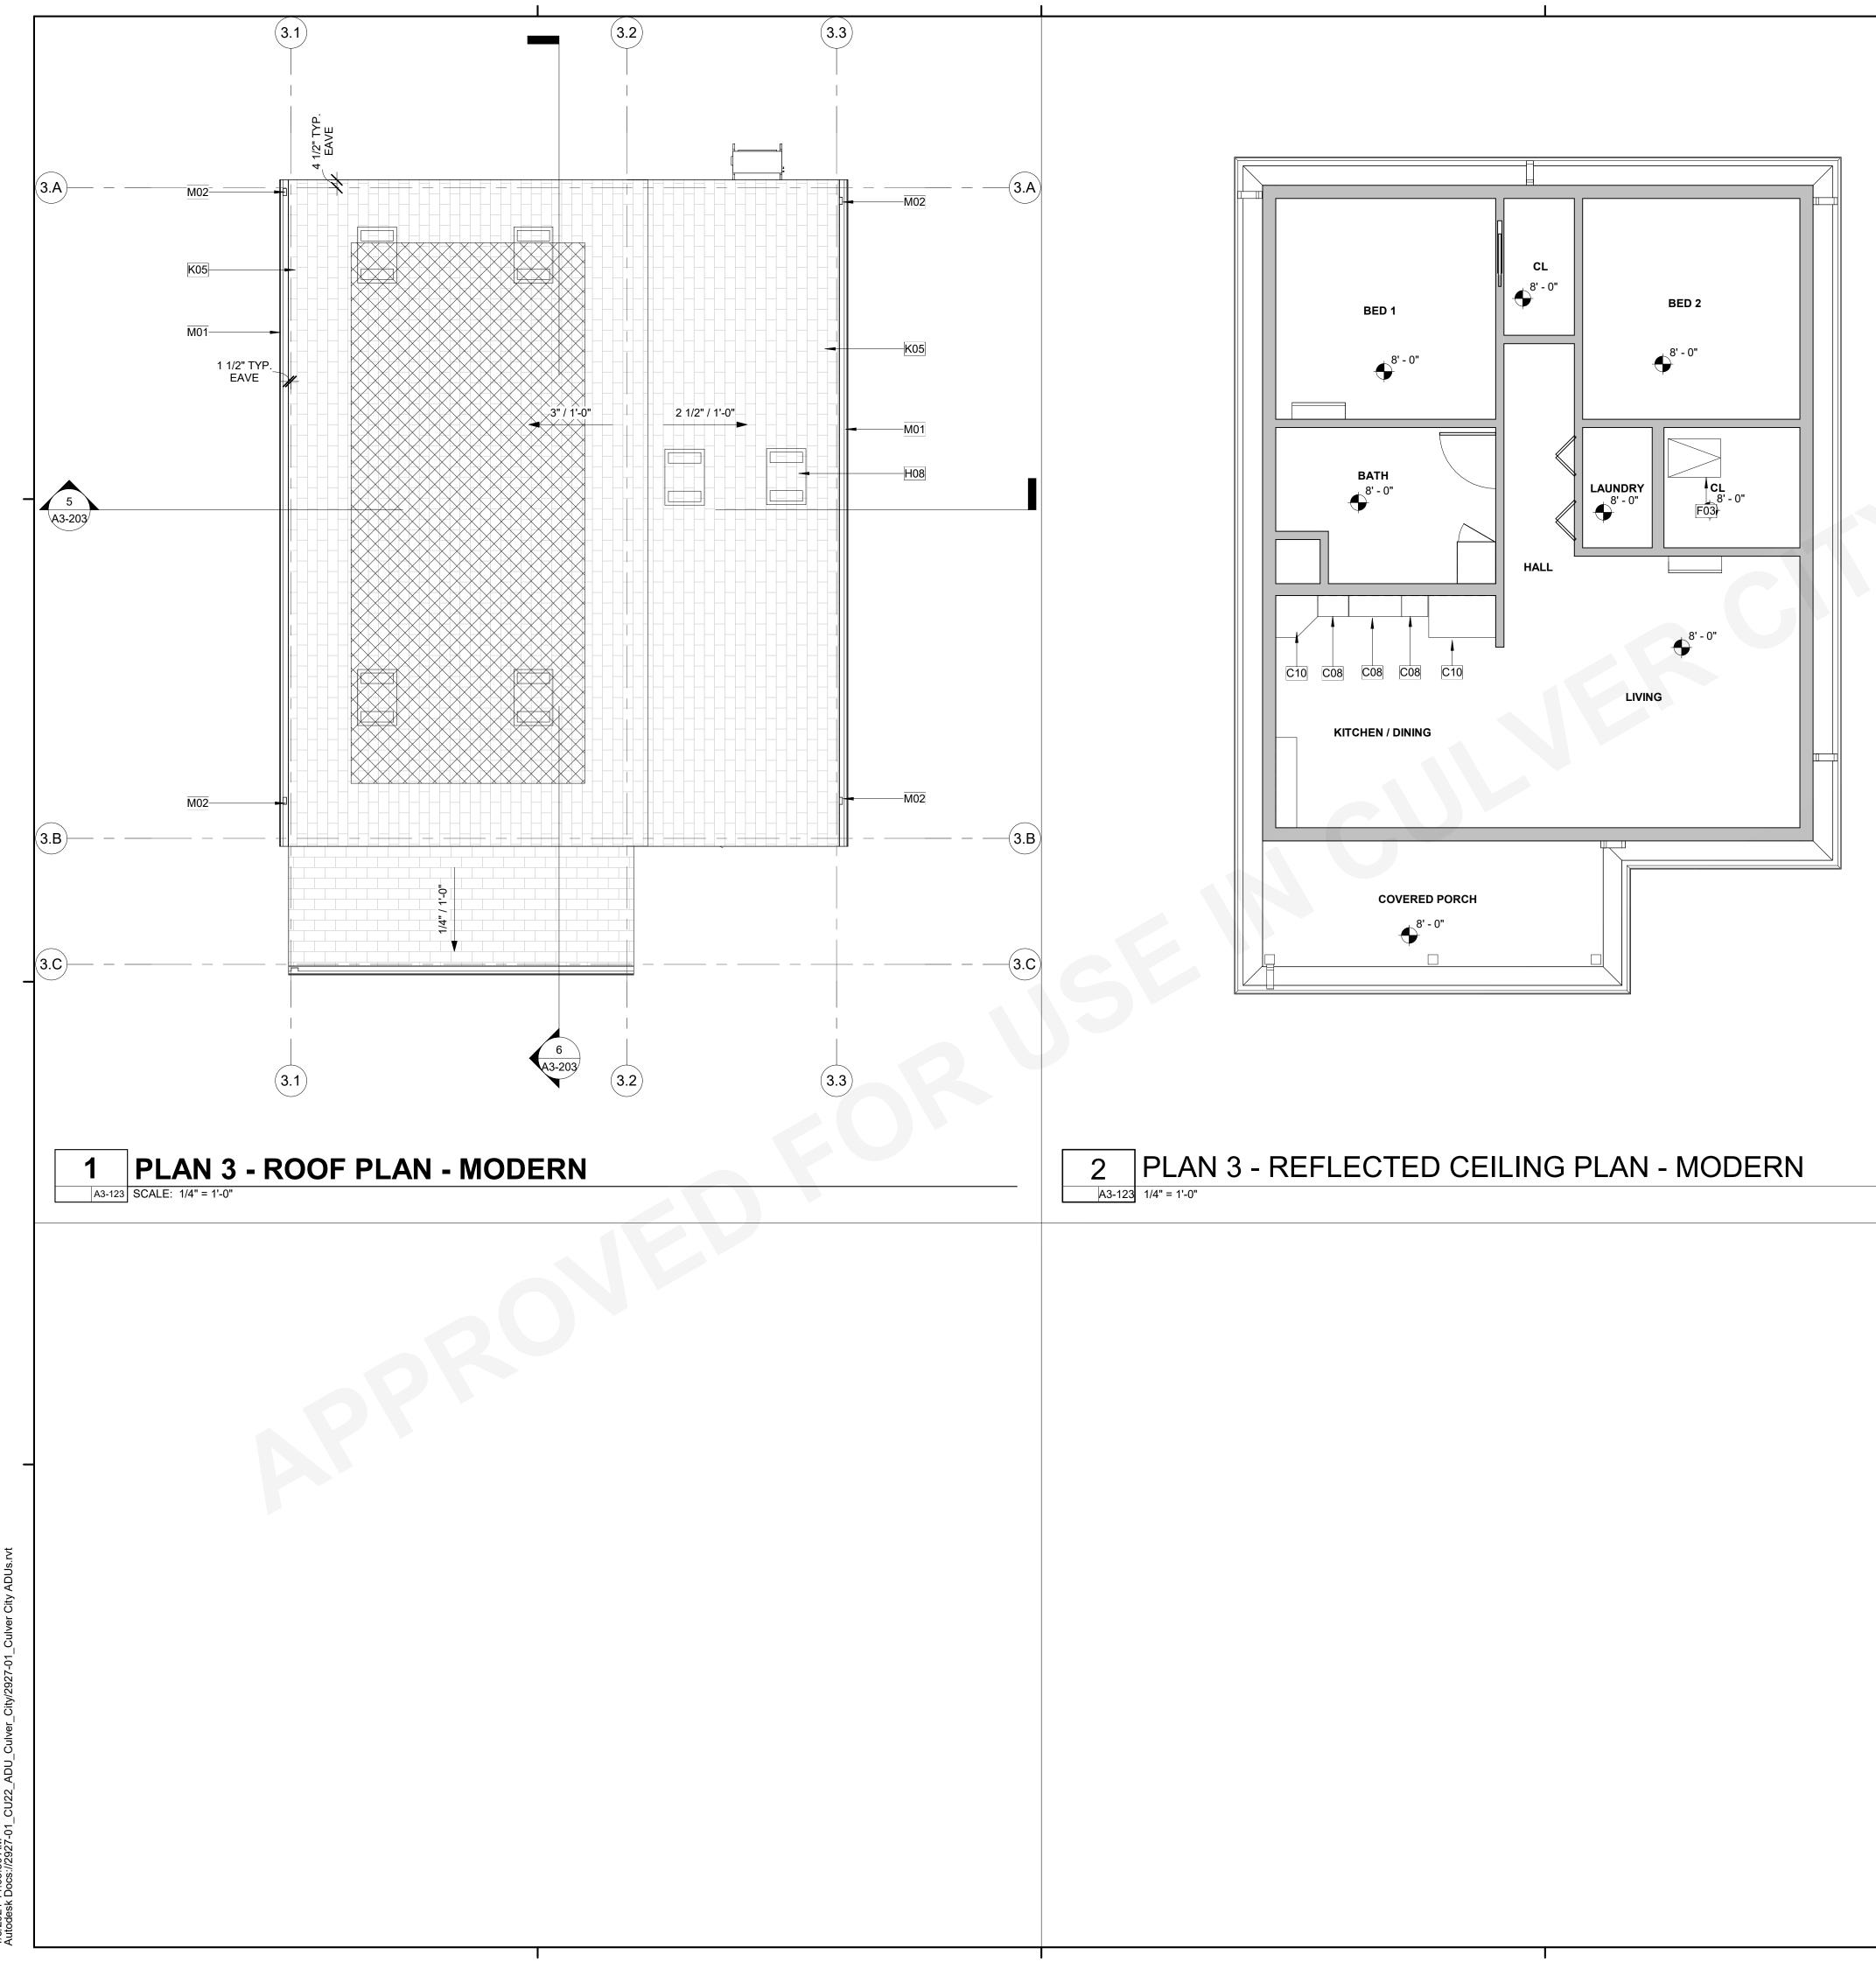

ROOF PLAN GENERAL NOTES

- 1. REFER TO GENERAL NOTES SHEET G-102 FOR ADDITIONAL REQUIREMENTS 2. REFER TO STRUCTURAL PLANS FOR ROOF FRAMING INFORMATION
- INCLUDING MEMBER SIZES AND CONNECTION HARDWARE. 3. PROVIDE A MINIMUM OF 1 INCH OF AIRSPACE BETWEEN THE INSULATION AND ROOF SHEATHING.
- 4. WHERE THE ROOF PROFILE ALLOWS A SPACE BETWEEN THE ROOF COVERING AND DECKING, THE SPACES SHALL BE CONSTRUCTED TO PREVENT THE INTRUSION OF FLAMES AND EMBERS, BE FIRESTOPPED WITH APPROVED MATERIALS OR HAVE ONE LAYER OF MINIMUM 72 POUND MINERAL-SURFACED NONPERFORATED CAP SHEET OVER THE COMBUSTIBLE DECKING.
- 5. ALL ROOFING MATERIALS TO BE INSTALLED PER MANUFACTURER'S SPECS. 6. OVERHANG DIMENSIONS ARE FROM FACE OF EXTERIOR WALL FRAMING TO ROOF EDGE.
- ROOF VENTS SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS. ADJUST AS NEEDED TO ACCOMMODATE TRUSS LOCATIONS, PLUMBING VENTS, AND SOLAR COLLECTORS.

ROOF VENTING CALCULATIONS

UPPER VENTS: O'HAGIN TAPERED LOW PROFILE STANDARD LINE 72.0 SQ.IN OF AIR MOVEMENT PER VENT = 72. SQ.IN. / 144 = 0.5 SF

LOWER VENTS: O'HAGIN TAPERED LOW PROFILE STANDARD LINE 72.0 SQ.IN OF AIR MOVEMENT PER VENT = 72. SQ.IN. / 144 = 0.5 SF

"UPPER VENTS PROVIDED" = (TOTAL ATTIC AREA/300) * (0.5) / (0.5 SF) "LOWER VENTS PROVIDED" = (TOTAL ATTIC AREA/300) * (0.5) / (0.5 SF)

REQUIRED ATTIC UPPER VENTING LOWER VENTING AREA VENTING (NFA) REQUIRED (NFA) REQUIRED (NFA) ATTIC ATTIC 1 - PLAN 3 777 SF 2.59 SF 1.29 SF 1.29 SF ATTIC 1 - PLAN 3 97 SF 0.32 SF 0.16 SF 0.16 SF NET FREE PROVIDED AREA PER NET FREE COUNT VENT LENGTH VENT AREA VENT TYPE ATTIC 1 - PLAN 3 LOWER O'HAGIN SHINGLE ROOF VENT 2.00 SF 2' - 8" 0.50 SF (LOWER) UPPER O'HAGIN SHINGLE ROOF VENT 2.00 SF 0.50 SF 2' - 8" (UPPER) 4.00 SF

- OPENINGS SHALL HAVE CORROSION-RESISTANT WIRE MESH OR OTHER а. APPROVED MATERIAL WITH 1/16-IN. MINIMUM AND 1/4-IN. MAXIMUM
- **OPENING. (R806.1)** A MINIMUM OF 1-IN. AIRSPACE SHALL BE PROVIDED BETWEEN INSULATION AND ROOF SHEATHING. (R806.3) UNVENTED ATTIC ASSEMBLIES SHALL MEET ALL CONDITIONS IN SECTION
- R806.5. PROVIDE CLASS I OR II VAPOR RETARDER IS INSTALLED ON THE WARM-IN-
- WINTER SIDE OF THE CEILING. (R806.2)

KEYNOTES

C08 C10 F03

12" DEEP UPPER CABINET 24" DEEP UPPER CABINET.

30" X 30" MIN. ATTIC ACCESS. PROVIDED SWITCH AND OUTLET AT ATTIC FOR FAU. PERMANENTLY ATTACH R-38 OR GREATER INSULATION TO ATTIC ACCESS DOOR USING ADHESIVE OR MECHANICAL FASTENERS CEnC 150.0 (a)1. PROVIDE GASKETED ATTIC ACCESS TO PREVENT AIR LEAKAGE CEnC 150.0 (a)1.

RCP GENERAL NOTES

- REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS. HEIGHT OF CEILINGS SHALL BE MEASURED FROM TOP OF SLAB OR FLOOR TO FINISH FACE OF GWB, U.N.O.
- 3. REFER TO DETAILS FOR FLOOR/CEILING ASSEMBLIES.
- 4. REFER TO ELECTRICAL PLANS FOR LIGHT FIXTURE LOCATIONS.
- DIMENSIONS ARE TO THE FACE OF FRAMING UNLESS OTHERWISE NOTED. 6. SOFFITS ARE TO BE HELD TIGHT TO UNDERSIDE OF MECHANICAL EQUIPMENT.

| LEGEND | | | | | | | |
|----------|--|--|--|--|--|--|--|
| 2" / 12" | ROOF SLOPE (REFER TO PLANS FOR ACTUAL SLOPE) | | | | | | |
| | O'HAGIN ATTIC VENT, PAINT TO MATCH ROOF COLOR. (REFER TO EXTERIOR ELEVATIONS FOR COLORS AND MATERIALS.) | | | | | | |
| | WALL BELOW | | | | | | |
| T | GUTTER, CONNECT TO DOWNSPOUT —DOWNSPOUT, TO ROOF OR SPLASHBLOCK BELOW U.N.O. | | | | | | |
| | FUTURE SOLAR ZONE. REFER TO SOLAR READY NOTES ON SHEET G-101. | | | | | | |
| ATTIC # | ATTIC SPACE. REFER TO ROOF VENTING CALCULATIONS FOR AREA AND VENTING METHOD | | | | | | |



THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

CEILING PLAN 3

Шı

REFLECTIVE -MODERN -

ROOF & PLANS -

ANS

CITY RD PL

CULVER STANDA CULVER CIT

DO

4

DATE

SHEET


01/03/2024

A3-123

SET

()

CITY,

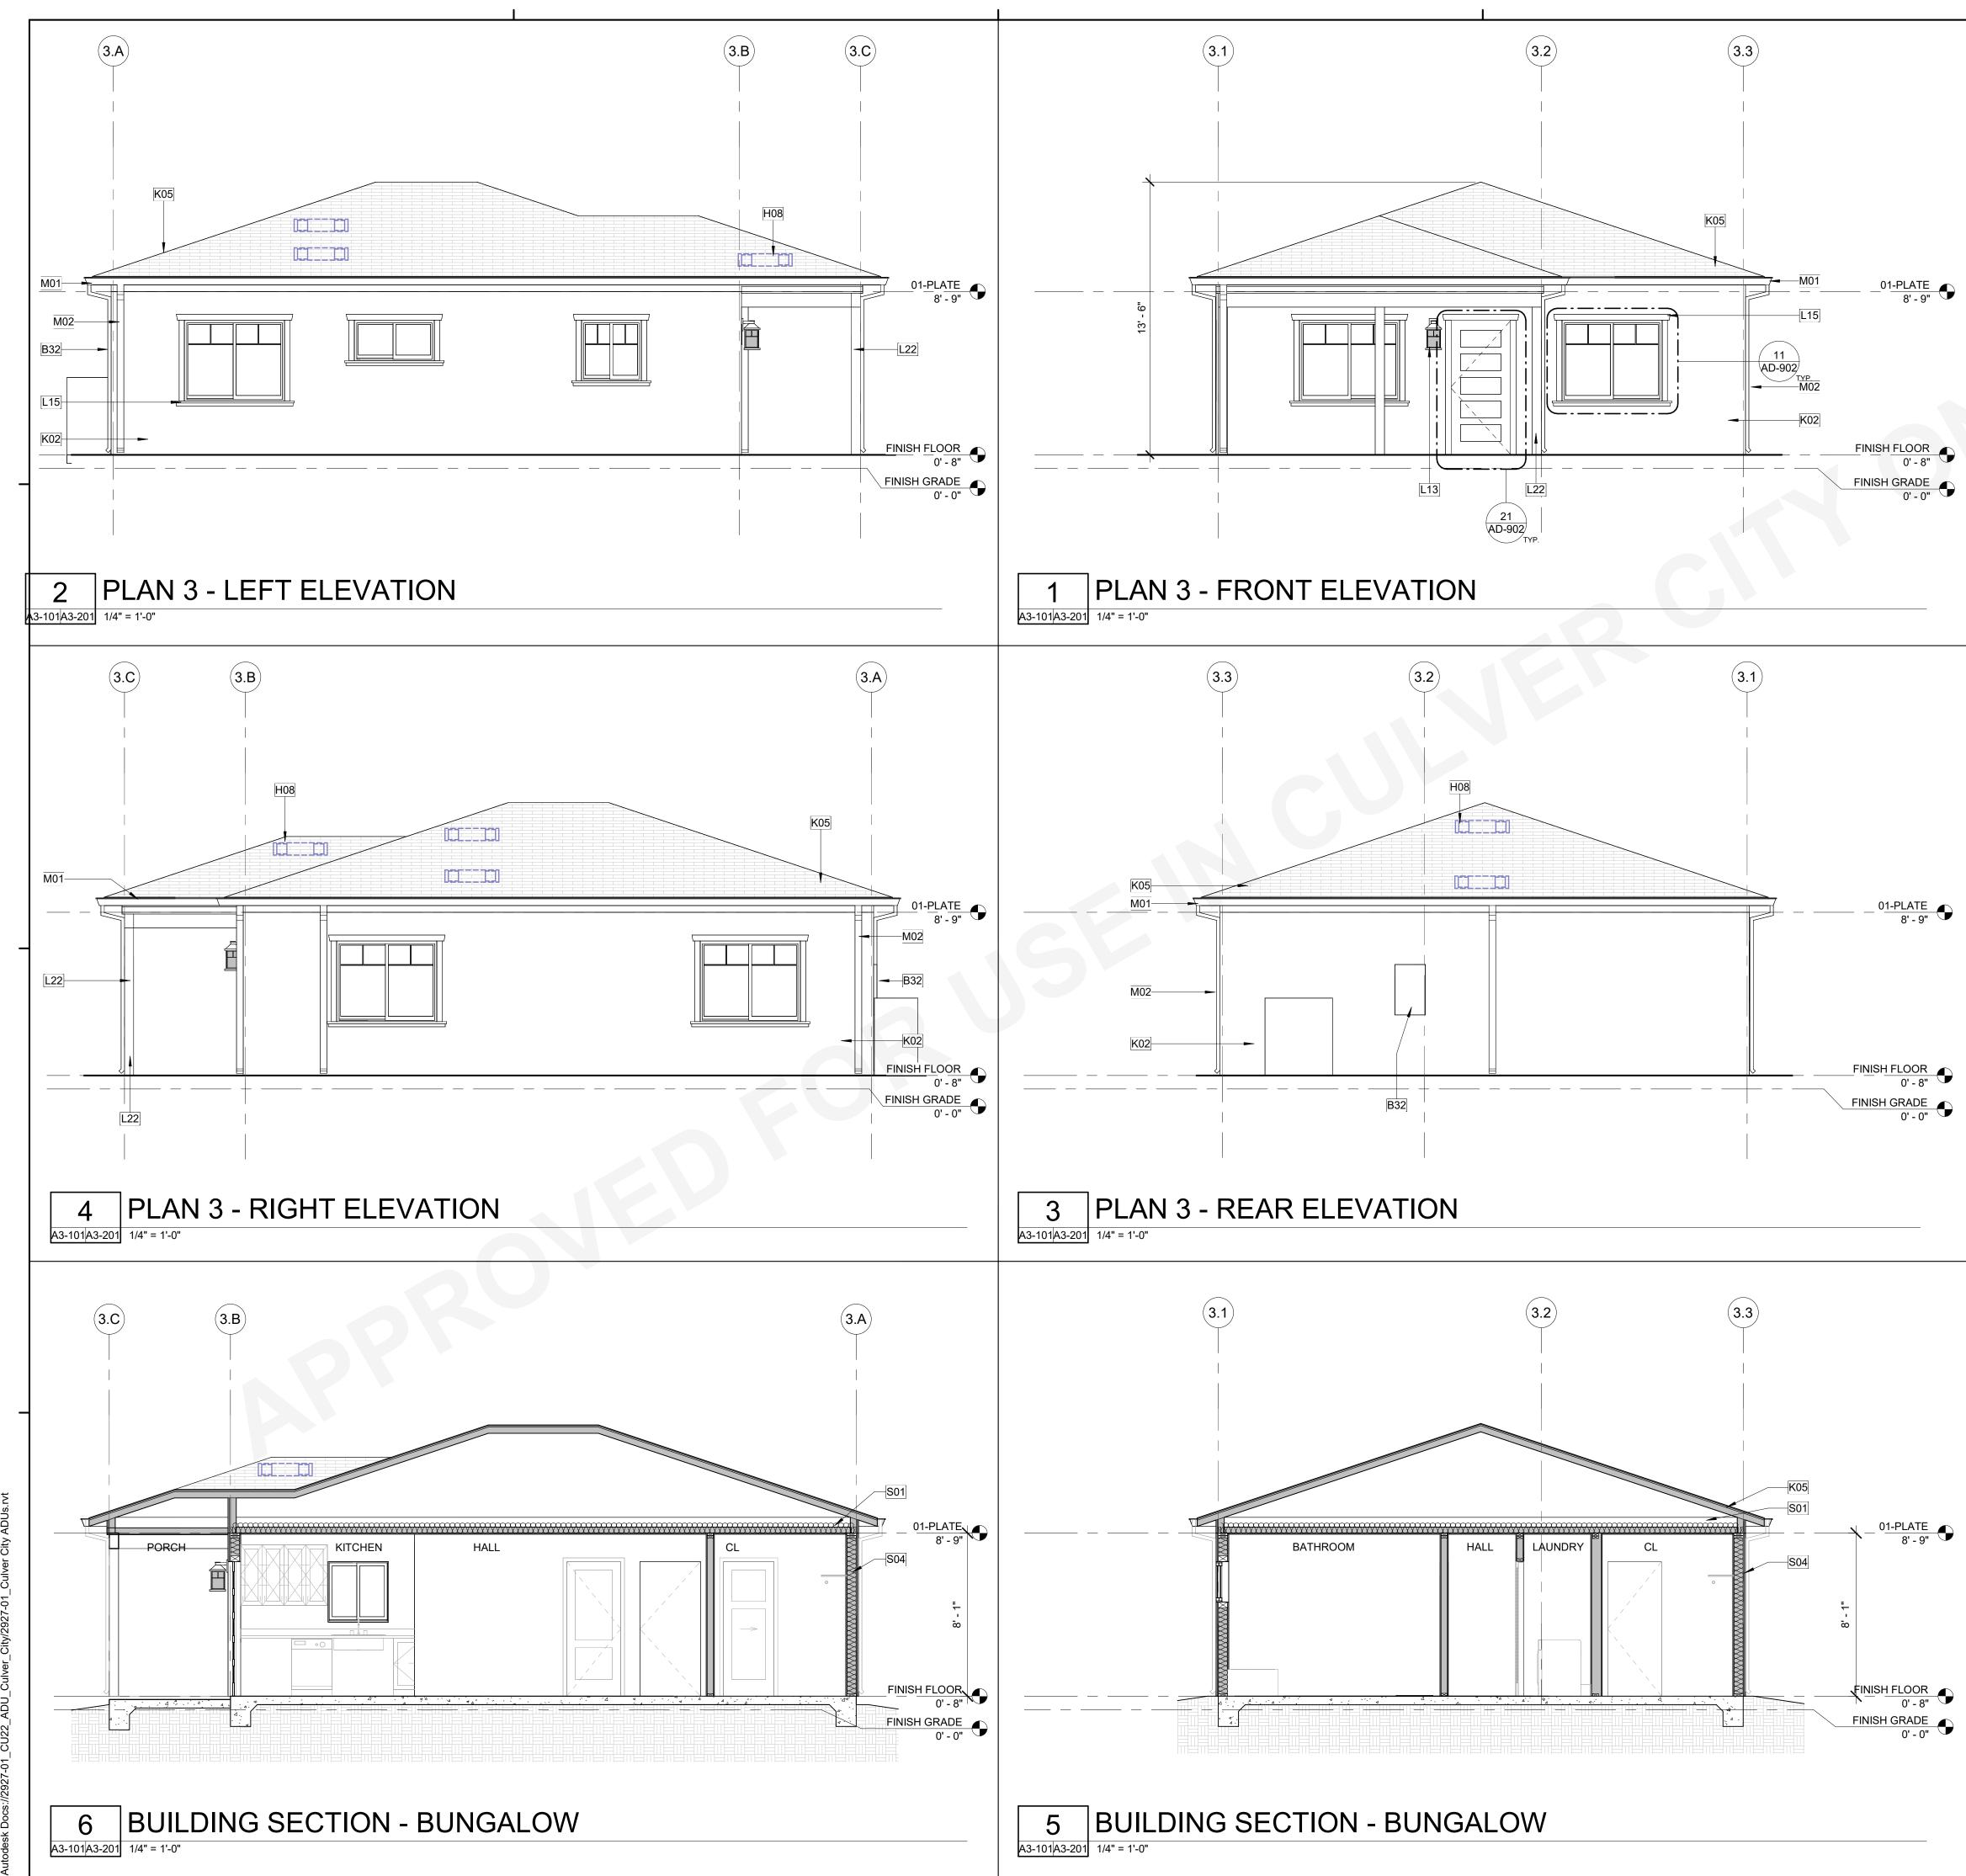

ELEVATION GENERAL NOTES

- REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS. 2. FRAMING ELEVATIONS, INCLUDING FLOOR PLATES AND FLOOR LEVEL
- ELEVATIONS ARE MEASURED FROM BUILDING FINISH FLOOR, U.N.O. 3. SEE DETAILS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
- 4. REFER TO ROOF PLAN FOR ROOF PITCH AND OVERHANGS. FASCIA PER DETAILS.
- 5. SEE ROOF PLAN FOR APPROXIMATE DOWNSPOUT LOCATIONS, U.N.O. 6. REFER TO DOOR AND WINDOW SCHEDULES AND TYPES FOR DOOR AND WINDOW INFORMATION.
- 7. SEE ELECTRICAL DRAWINGS FOR EXTERIOR LIGHTING
- 8. SEE MECHANICAL DRAWINGS FOR GRILLES AND LOUVERS. PAINT TO MATCH ADJACENT FINISH. 9. CONTRACTOR TO VERIFY COLOR SCHEME WITH OWNER BEFORE PERFORMING THE WORK.

SECTIONS GENERAL NOTES

- 1. THE PURPOSE OF THESE DRAWINGS IS TO SHOW CONSTRUCTION MATERIALSS/ASSEMBLIES. FOR SPECIFIC SIZES AND DETAILS REFER TO ARCHITECTURAL PLANS, ELEVATIONS, DETAILS, AND STRUCTURAL PLANS. INSULATION: REFER TO TITLE 24 REPORT AND "INSULATION" NOTES ON
- SHEET FOR ADDITIONAL RATINGS, REQUIREMENTS, AND INFORMATION. REFER TO FIREBLOCKING/DRAFTSTOPING NOTES ON SHEET G-101. WOOD SHALL BE PROTECTED FROM DECAY AND TERMITES AS REQUIRED
- PER 2022 CRC SECTION R317 WOOD FRAMING MEMBERS, INCLUDING WOOD SHEATHING, THAT ARE IN CONTACT WITH EXTERIOR FOUNDATION WALLS AND ARE LESS THAN 8 INCHES (203 MM) FROM EXPOSED EARTH SHALL BE OF NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD. 2022 CRC SECTION R317 THROUGH PENETRATIONS OF FIRE-RESISTANCE-RATED WALLS SHALL
- COMPLY WITH 2022 CBC SECTIONS 714.1 WALL ASSEMBLIES TO BE PER FLOOR PLAN.
- 8. DOORS, WINDOWS AND STOREFRONT SYSTEMS TO BE PER APPLICABLE SCHEDULE. REFER TO FLOOR PLANS FOR IDENTIFICATION.

KEYNOTES

M02

S01


S04

0' - 8'

0' - 0"


B32 100 AMP SERVICE, CONFIRM WITH EXISTING SERVICE. H08 ATTIC VENT. METAL W/ PAINT FINISH TO MATCH ROOF COLOR. REFER TO COLORS AND MATERIALS. 7/8" CEMENT PLASTER (3-COAT) SYSTEM O/ WATER RESISTIVE K02 BARRIER PER CRC 703.7.3. EXTERIOR BUILDING FINISH SHALL BE IN COMPLIANCE WITH 2022 CRC R337. CLASS A ASPHALT COMPOSITE ROOF SHINGLES. GAF TIMBERLINE K05 HD (ICC-ESR-1475) OR APROVED EQUAL. THE USE OF CLASS A TILE ROOFING IS ALSO ALLOWED AND HAS BEEN ACCOUNTED FOR IN STRUCTURAL ROOF LOADS. EXTERIOR LIGHT SHIELDED AND DOWNWARD FACING AND TITLE 24 L13 COMPLIANT. L15 WIN/DOOR SURROUNDS L22 6x6 WOOD POST(S) GUTTER. CONNECT TO DOWNSPOUT. PROVIDE MEANS TO M01 PREVENT ACCUMULATION OF LEAVES AND DEBRIS IN GUTTER PER

- CRC R327.5.4 DOWNSPOUT. CONNECT TO STORM DRAIN SYSTEM
- CEILING INSULATION. REFER TO TITLE 24 (R-38 MIN. PER CF1R) 2x6 WALL INSULATION. REFER TO TITLE 24 (R-30 MIN. PER CF1R)

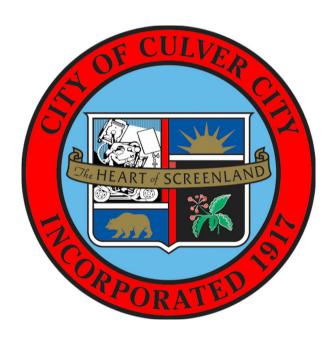

THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

ANS EXTERIOR ELEVATIONS BUNGALOW- PLAN 3 CITY RD P CULVER STANDAI CULVER CIT ADU DATE SET 01/03/2024 oublic SHEET A3-201

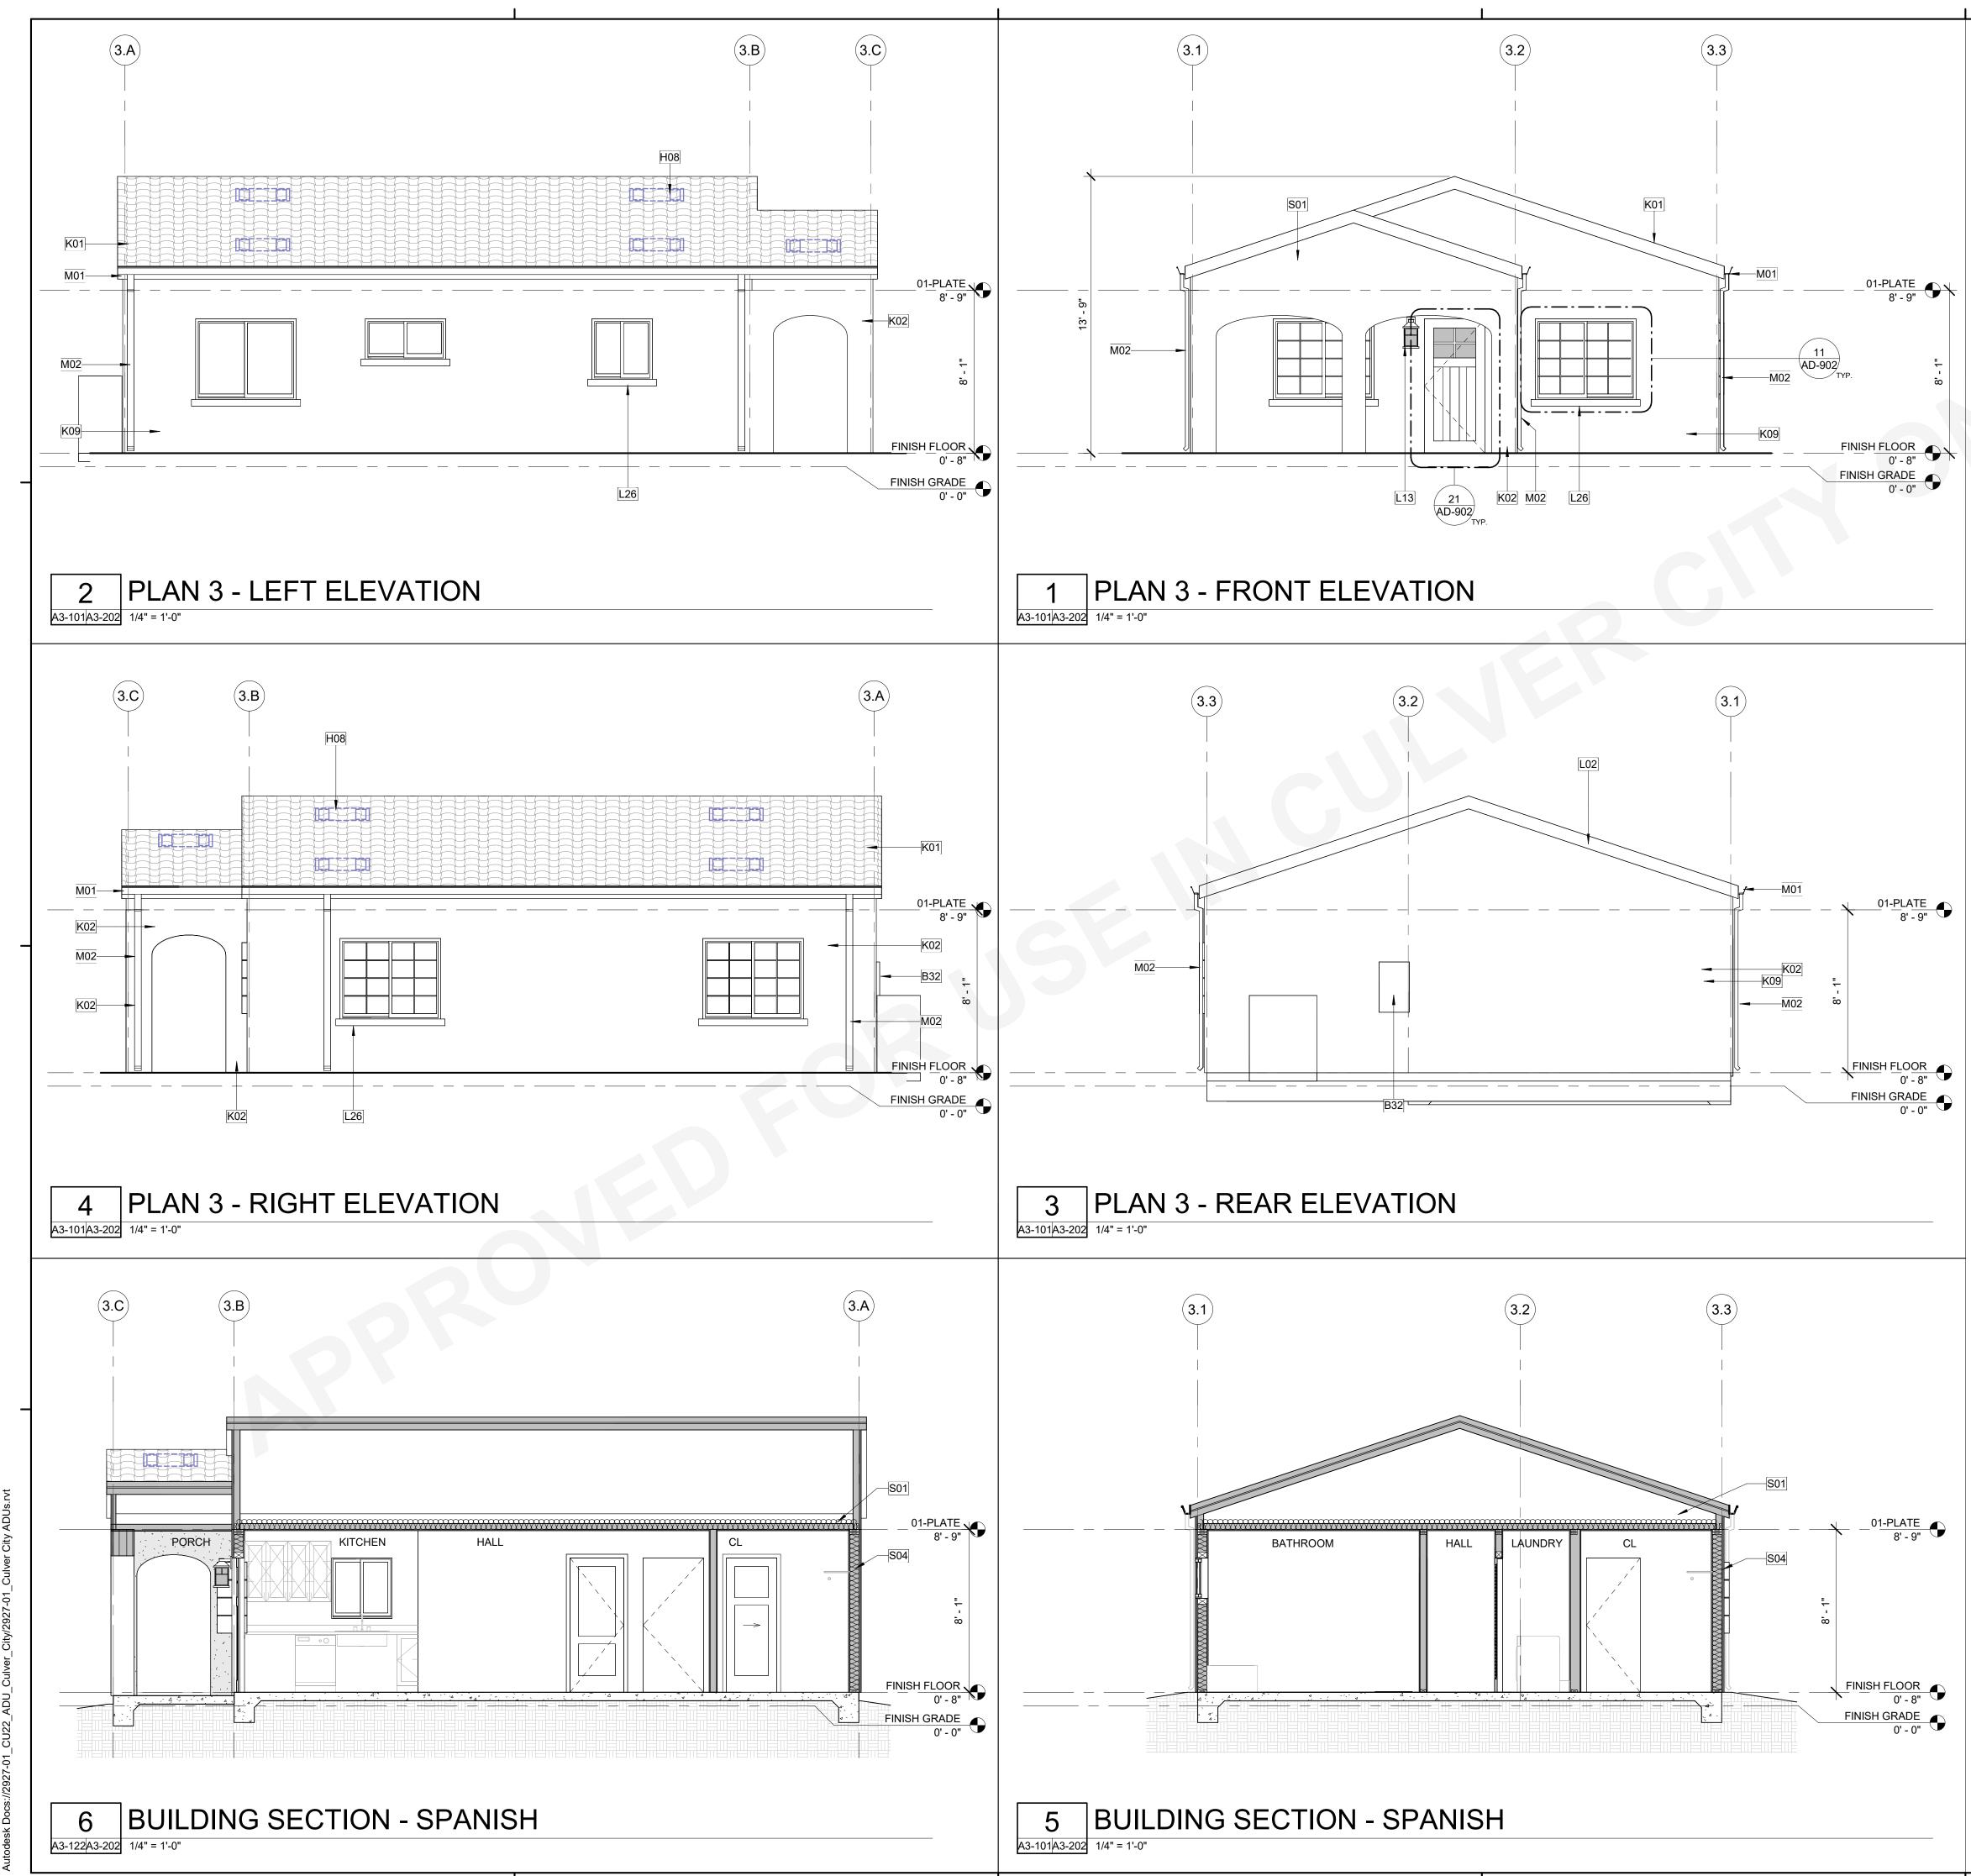

ELEVATION GENERAL NOTES

- REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS. 2. FRAMING ELEVATIONS, INCLUDING FLOOR PLATES AND FLOOR LEVEL
- ELEVATIONS ARE MEASURED FROM BUILDING FINISH FLOOR, U.N.O. 3. SEE DETAILS FOR ADDITIONAL INFORMATION AND REQUIREMENTS.
- 4. REFER TO ROOF PLAN FOR ROOF PITCH AND OVERHANGS. FASCIA PER
- DETAILS. 5. SEE ROOF PLAN FOR APPROXIMATE DOWNSPOUT LOCATIONS, U.N.O. 6. REFER TO DOOR AND WINDOW SCHEDULES AND TYPES FOR DOOR AND WINDOW INFORMATION.
- 7. SEE ELECTRICAL DRAWINGS FOR EXTERIOR LIGHTING
- 8. SEE MECHANICAL DRAWINGS FOR GRILLES AND LOUVERS. PAINT TO MATCH ADJACENT FINISH. 9. CONTRACTOR TO VERIFY COLOR SCHEME WITH OWNER BEFORE PERFORMING THE WORK.

SECTIONS GENERAL NOTES

- THE PURPOSE OF THESE DRAWINGS IS TO SHOW CONSTRUCTION MATERIALSS/ASSEMBLIES. FOR SPECIFIC SIZES AND DETAILS REFER TO ARCHITECTURAL PLANS, ELEVATIONS, DETAILS, AND STRUCTURAL PLANS. INSULATION: REFER TO TITLE 24 REPORT AND "INSULATION" NOTES ON
- SHEET FOR ADDITIONAL RATINGS, REQUIREMENTS, AND INFORMATION. REFER TO FIREBLOCKING/DRAFTSTOPING NOTES ON SHEET G-101. WOOD SHALL BE PROTECTED FROM DECAY AND TERMITES AS REQUIRED
- PER 2022 CRC SECTION R317 WOOD FRAMING MEMBERS, INCLUDING WOOD SHEATHING, THAT ARE IN CONTACT WITH EXTERIOR FOUNDATION WALLS AND ARE LESS THAN 8 INCHES (203 MM) FROM EXPOSED EARTH SHALL BE OF NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD. 2022 CRC SECTION R317 THROUGH PENETRATIONS OF FIRE-RESISTANCE-RATED WALLS SHALL
- COMPLY WITH 2022 CBC SECTIONS 714.1 WALL ASSEMBLIES TO BE PER FLOOR PLAN.
- 8. DOORS, WINDOWS AND STOREFRONT SYSTEMS TO BE PER APPLICABLE SCHEDULE. REFER TO FLOOR PLANS FOR IDENTIFICATION.


KEYNOTES


S01


S04

B32 100 AMP SERVICE, CONFIRM WITH EXISTING SERVICE. H08 ATTIC VENT. METAL W/ PAINT FINISH TO MATCH ROOF COLOR. REFER TO COLORS AND MATERIALS. K01 CLASS A CONCRETE S-TILE BY WESTLAKE ROYAL (ICC-ESR-3098) OR APPROVED EQUAL. 7/8" CEMENT PLASTER (3-COAT) SYSTEM O/ WATER RESISTIVE K02 BARRIER PER CRC 703.7.3. EXTERIOR BUILDING FINISH SHALL BE IN COMPLIANCE WITH 2022 CRC R337. K09 FIBER CEMENT HOROZONTAL SIDING, IN COMPLIANCE WITH 2022 CRC R337 1x8 FIBER CEMENT FASCIA. L02 EXTERIOR LIGHT SHIELDED AND DOWNWARD FACING AND TITLE 24 L13 COMPLIANT. STUCCO TRIM AT SILL L26 GUTTER. CONNECT TO DOWNSPOUT. PROVIDE MEANS TO M01 PREVENT ACCUMULATION OF LEAVES AND DEBRIS IN GUTTER PER CRC R327.5.4 DOWNSPOUT. CONNECT TO STORM DRAIN SYSTEM M02

CEILING INSULATION. REFER TO TITLE 24 (R-38 MIN. PER CF1R) 2x6 WALL INSULATION. REFER TO TITLE 24 (R-30 MIN. PER CF1R)

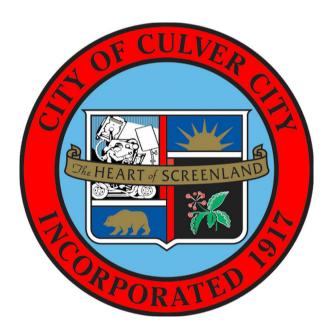

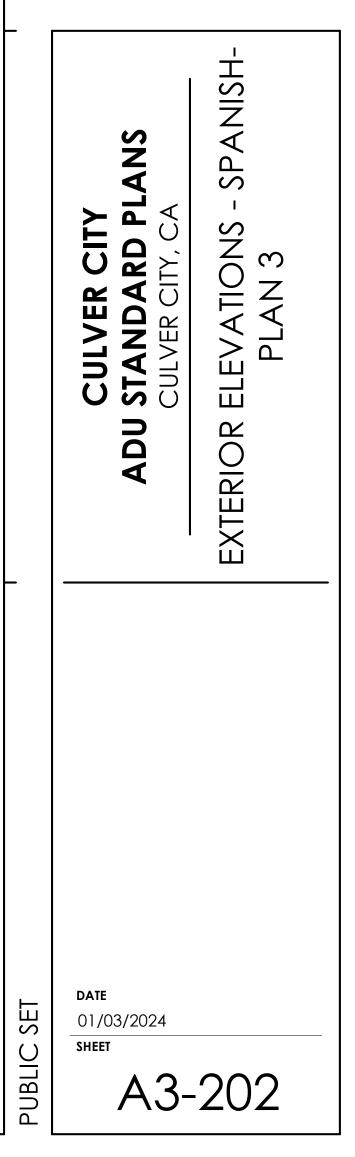

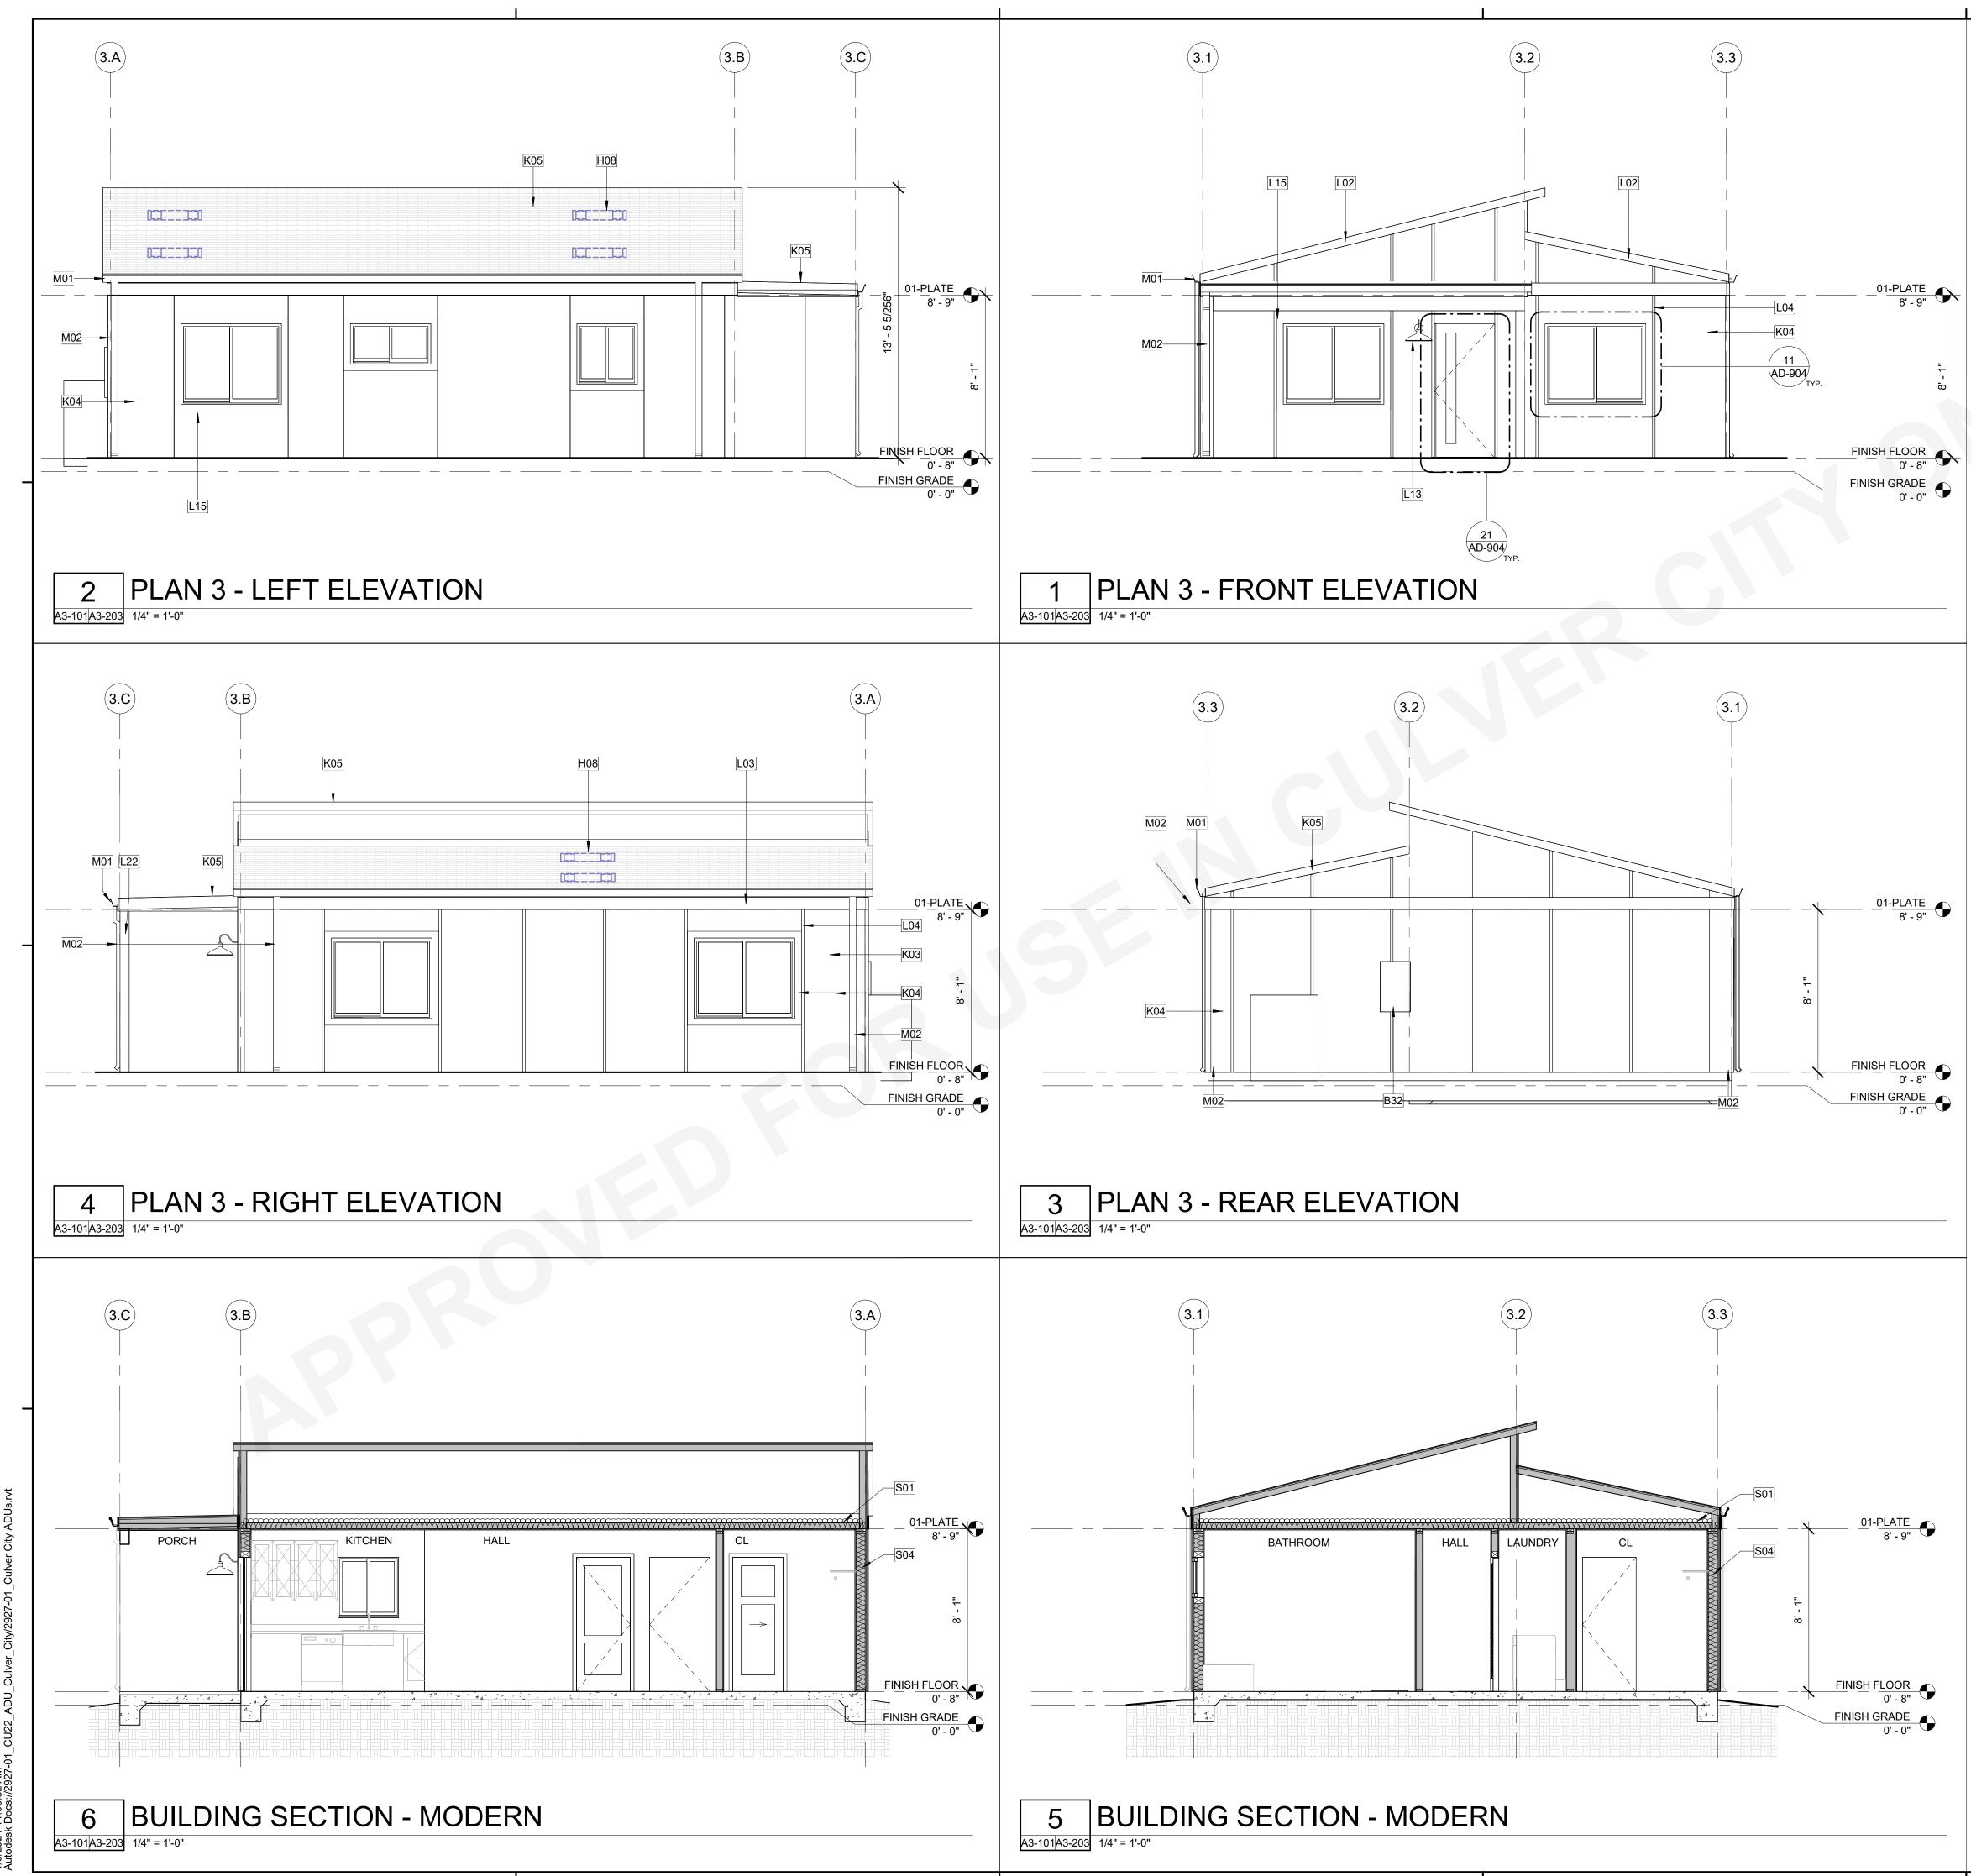

ELEVATION GENERAL NOTES

- 1. REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS. 2. FRAMING ELEVATIONS, INCLUDING FLOOR PLATES AND FLOOR LEVEL
- ELEVATIONS ARE MEASURED FROM BUILDING FINISH FLOOR, U.N.O.
- 3. SEE DETAILS FOR ADDITIONAL INFORMATION AND REQUIREMENTS. 4. REFER TO ROOF PLAN FOR ROOF PITCH AND OVERHANGS. FASCIA PER
- DETAILS. 5. SEE ROOF PLAN FOR APPROXIMATE DOWNSPOUT LOCATIONS, U.N.O. 6. REFER TO DOOR AND WINDOW SCHEDULES AND TYPES FOR DOOR AND WINDOW INFORMATION.
- 7. SEE ELECTRICAL DRAWINGS FOR EXTERIOR LIGHTING
- 8. SEE MECHANICAL DRAWINGS FOR GRILLES AND LOUVERS. PAINT TO MATCH ADJACENT FINISH. 9. CONTRACTOR TO VERIFY COLOR SCHEME WITH OWNER BEFORE PERFORMING THE WORK.

SECTIONS GENERAL NOTES

- 1. THE PURPOSE OF THESE DRAWINGS IS TO SHOW CONSTRUCTION MATERIALSS/ASSEMBLIES. FOR SPECIFIC SIZES AND DETAILS REFER TO ARCHITECTURAL PLANS, ELEVATIONS, DETAILS, AND STRUCTURAL PLANS. INSULATION: REFER TO TITLE 24 REPORT AND "INSULATION" NOTES ON
- SHEET FOR ADDITIONAL RATINGS, REQUIREMENTS, AND INFORMATION. REFER TO FIREBLOCKING/DRAFTSTOPING NOTES ON SHEET G-101. 4. WOOD SHALL BE PROTECTED FROM DECAY AND TERMITES AS REQUIRED
- PER 2022 CRC SECTION R317 WOOD FRAMING MEMBERS, INCLUDING WOOD SHEATHING, THAT ARE IN CONTACT WITH EXTERIOR FOUNDATION WALLS AND ARE LESS THAN 8 INCHES (203 MM) FROM EXPOSED EARTH SHALL BE OF NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD. 2022 CRC SECTION R317 THROUGH PENETRATIONS OF FIRE-RESISTANCE-RATED WALLS SHALL
- COMPLY WITH 2022 CBC SECTIONS 714.1 WALL ASSEMBLIES TO BE PER FLOOR PLAN.
- 8. DOORS, WINDOWS AND STOREFRONT SYSTEMS TO BE PER APPLICABLE SCHEDULE. REFER TO FLOOR PLANS FOR IDENTIFICATION.

KEYNOTES

| B32 | 100 AMP SERVICE, CONFIRM WITH EXISTING SERVICE. |
|-----|---|
| H08 | ATTIC VENT. METAL W/ PAINT FINISH TO MATCH ROOF COLOR. REFER TO COLORS AND MATERIALS. |
| K03 | FIBER CEMENT SHEET SIDING, IN COMPLIANCE WITH 2022 CRC R337 |
| K04 | FIBER CEMENT BOARD AND BATTEN SIDING, IN COMPLIANCE WITH 2022 CRC R337 |
| K05 | CLASS A ASPHALT COMPOSITE ROOF SHINGLES. GAF TIMBERLINE HD (ICC-ESR-1475) OR APROVED EQUAL. THE USE OF CLASS A TILE ROOFING IS ALSO ALLOWED AND HAS BEEN ACCOUNTED FOR IN STRUCTURAL ROOF LOADS. |
| L02 | 1x8 FIBER CEMENT FASCIA. |
| L03 | 1x8 FIBER CEMENT TRIM W/ 1x2 FIBER CEMENT ACCENT TRIM. |
| L04 | 1X2 FIBER CEMENT BATTEN. |
| L13 | EXTERIOR LIGHT SHIELDED AND DOWNWARD FACING AND TITLE 24 COMPLIANT. |
| L15 | WIN/DOOR SURROUNDS |
| L22 | 6x6 WOOD POST(S) |
| M01 | GUTTER. CONNECT TO DOWNSPOUT. PROVIDE MEANS TO PREVENT ACCUMULATION OF LEAVES AND DEBRIS IN GUTTER PER |

PREVENT ACCUMULATION OF LEAVES AND DEBRIS IN GUTTER PER CRC R327.5.4 DOWNSPOUT. CONNECT TO STORM DRAIN SYSTEM CEILING INSULATION. REFER TO TITLE 24 (R-38 MIN. PER CF1R). 2x6 WALL INSULATION. REFER TO TITLE 24 (R-30 MIN. PER CF1R)

FINISH FLOOR 0' - 8"

0' - 0'


M02


S01


S04




| | CULVER CITY ADU STANDARD PLANS CULVER CITY, CA | EXTERIOR ELEVATIONS - MODERN- PLAN 3 |
|-----------|--|---|
| UBLIC SEI | DATE 01/03/2024 SHEET ДДЗ- | 203 |

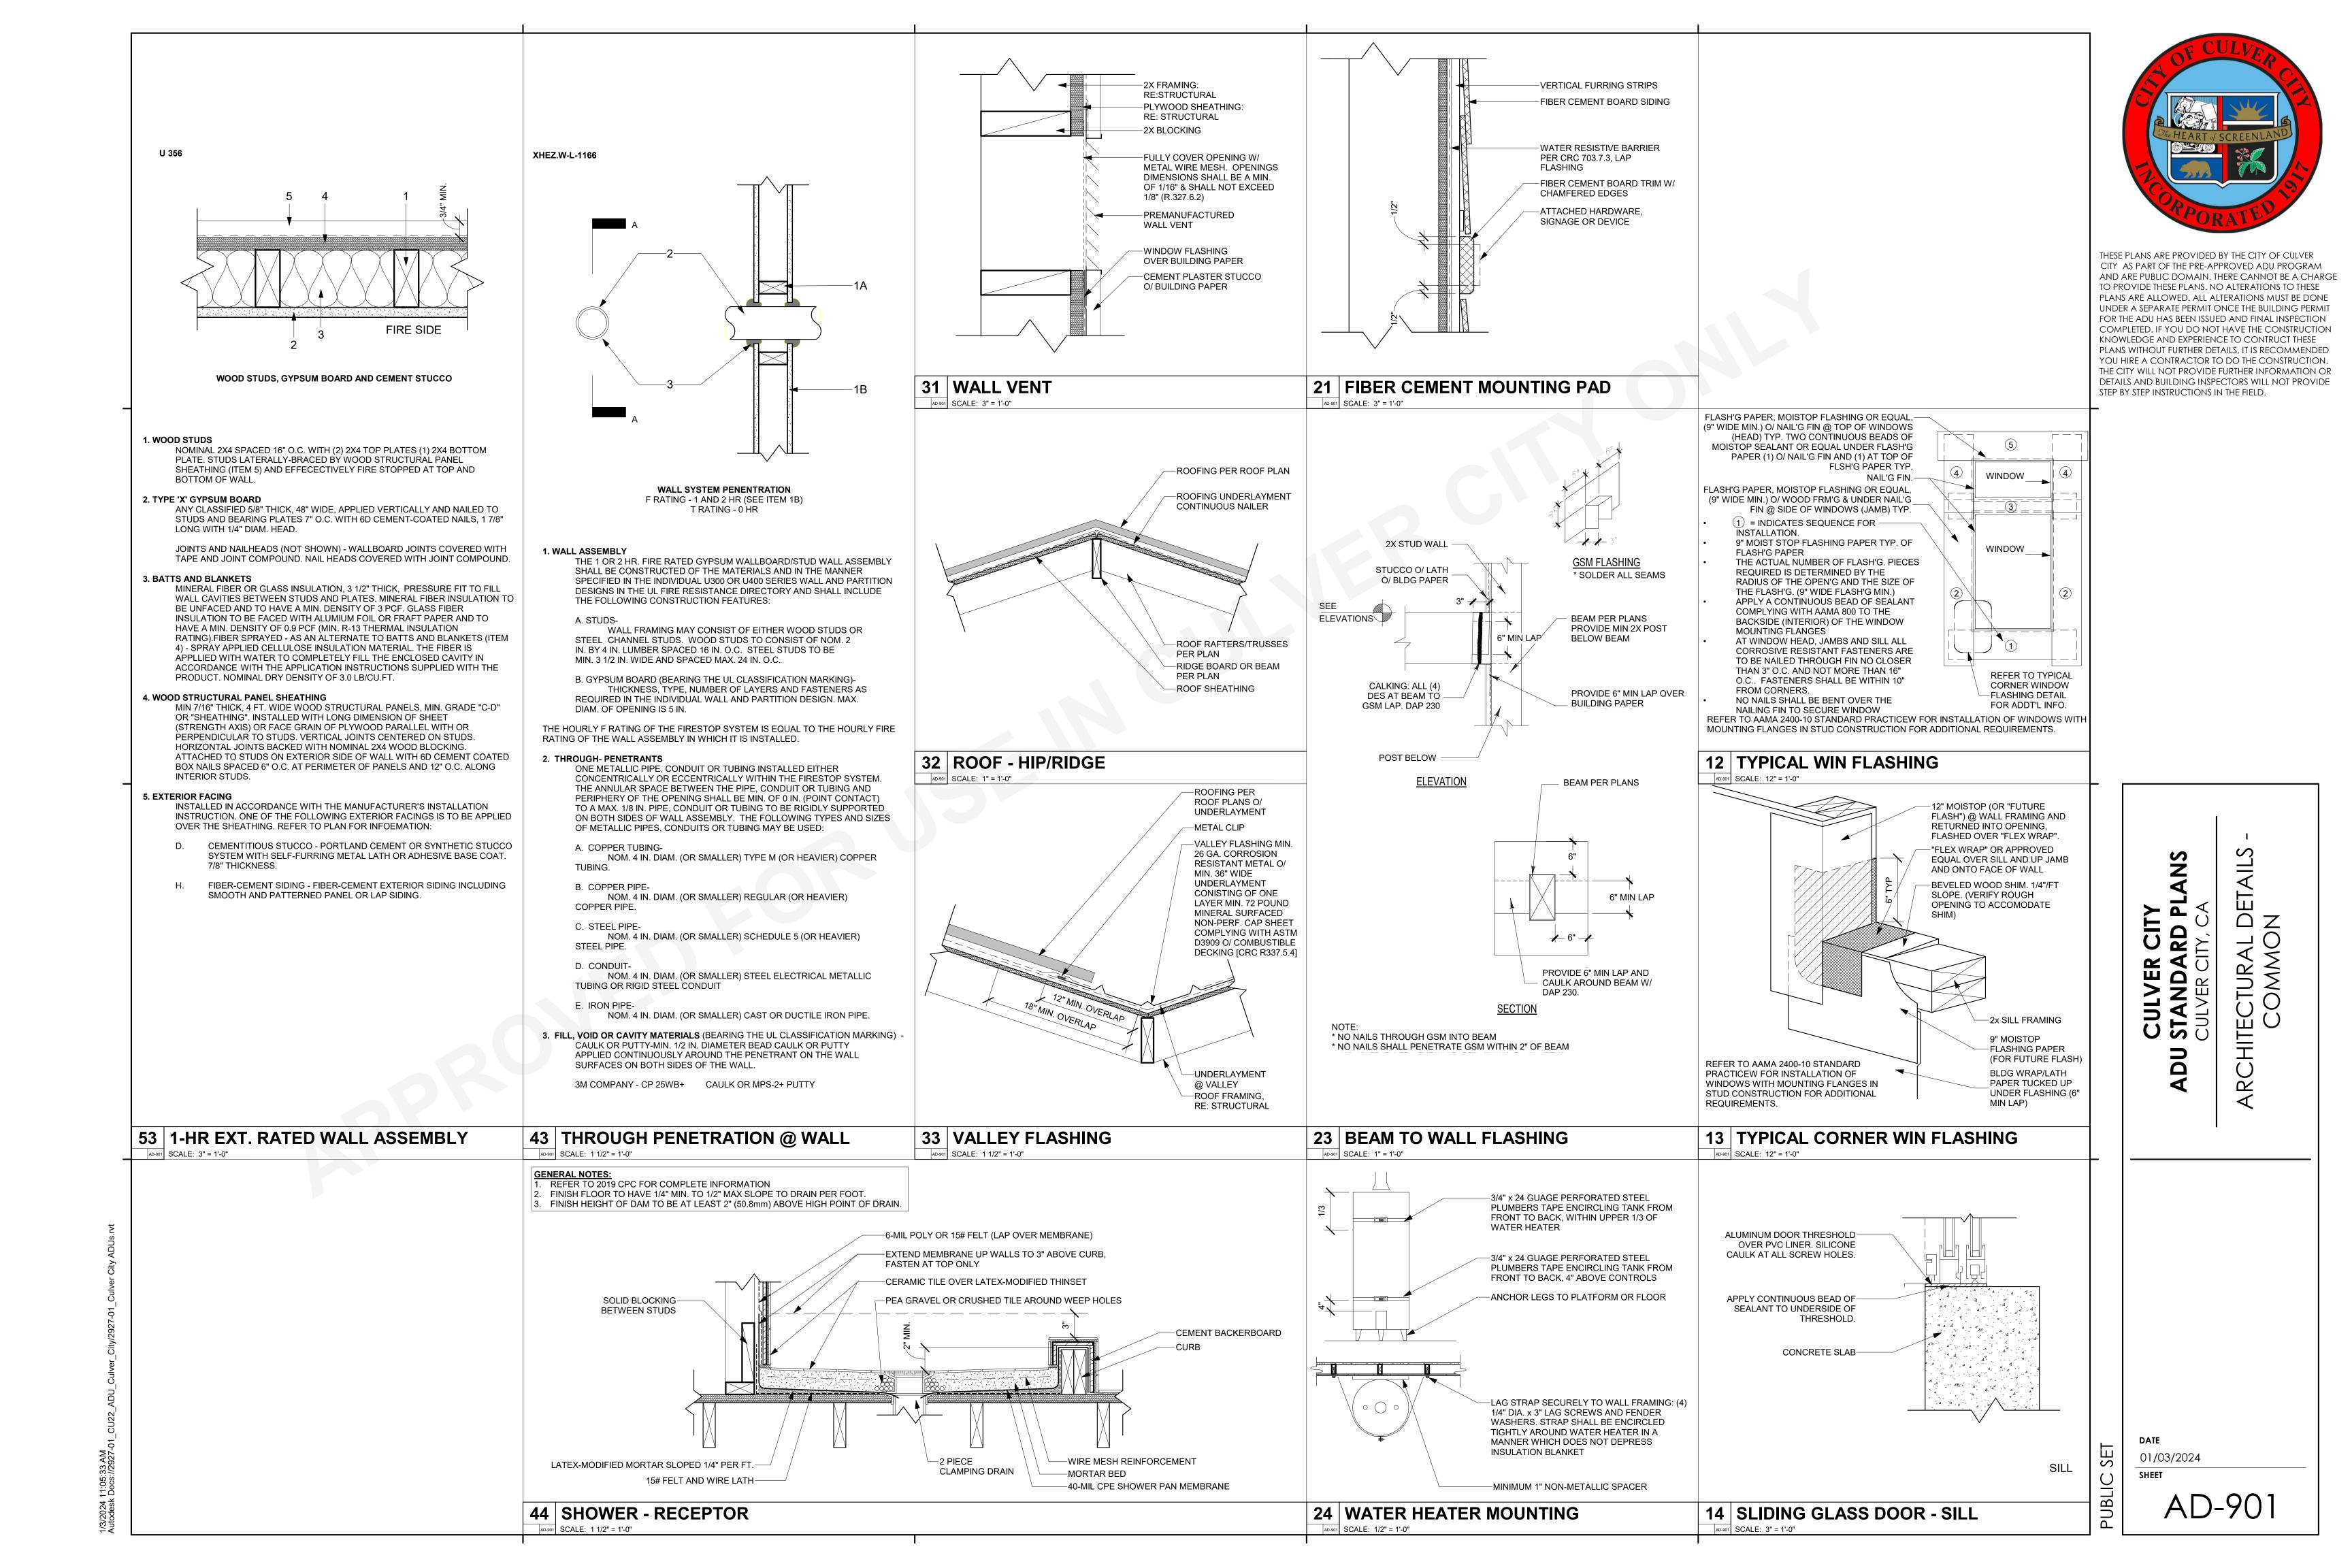

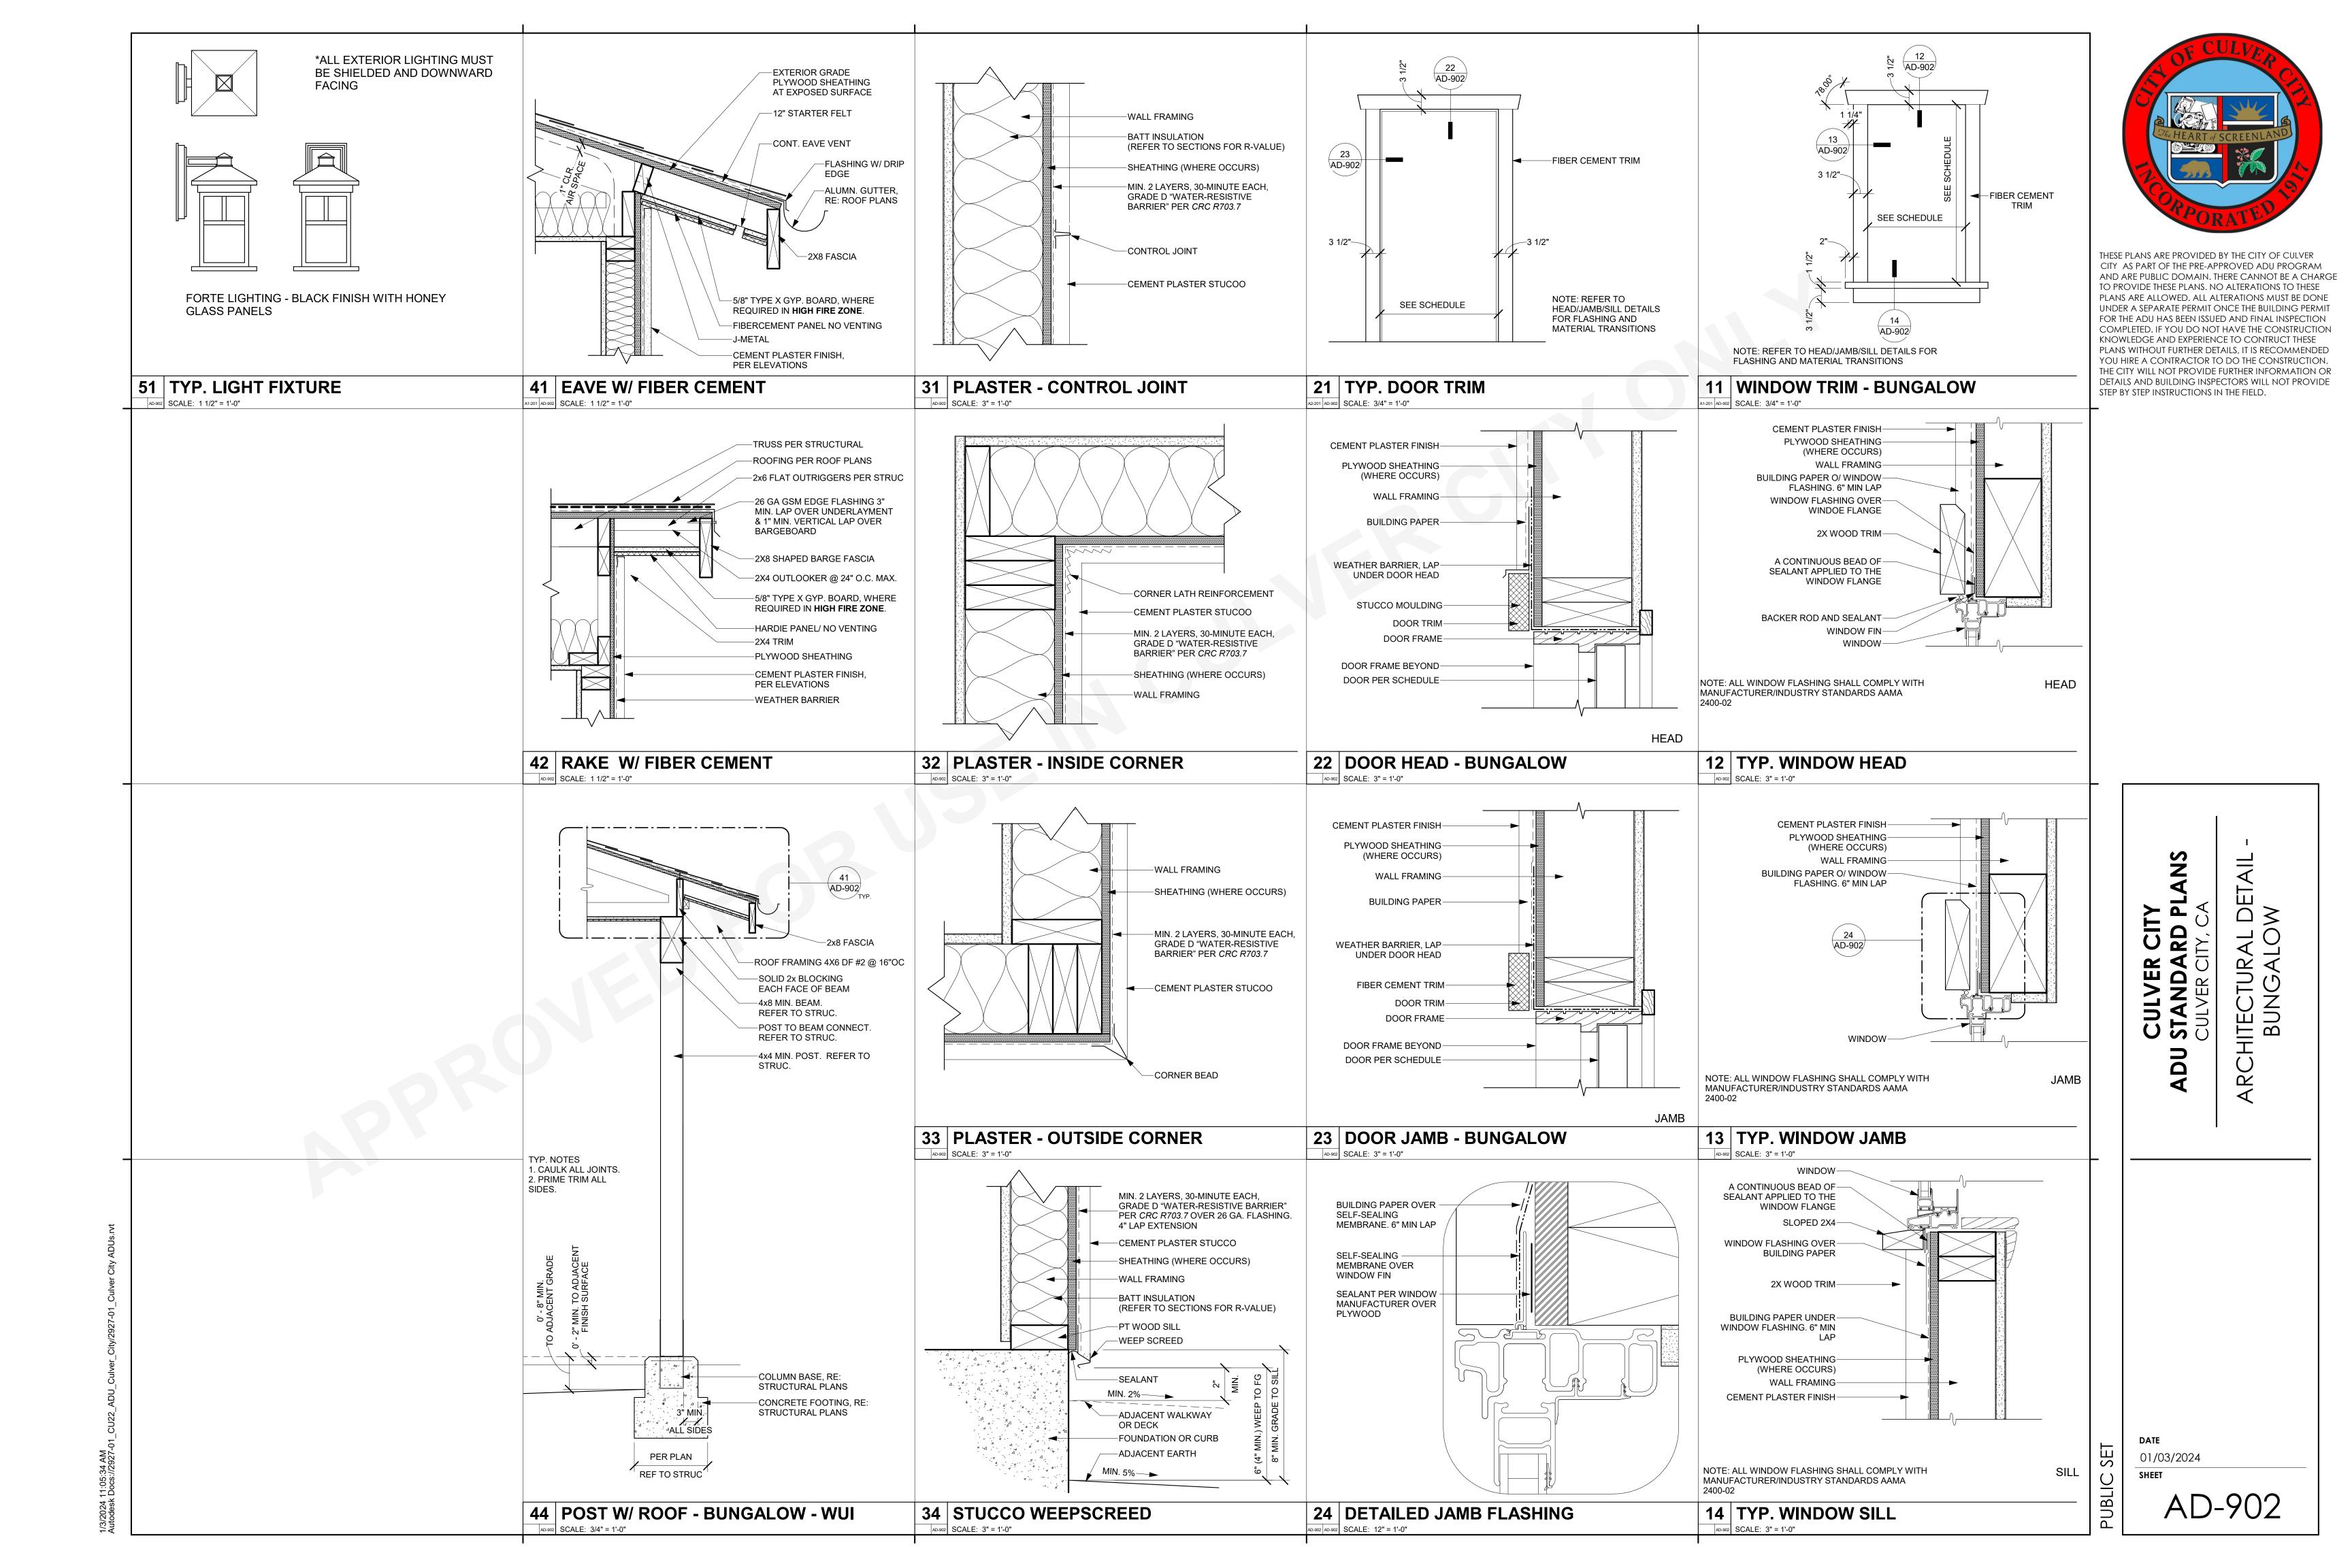

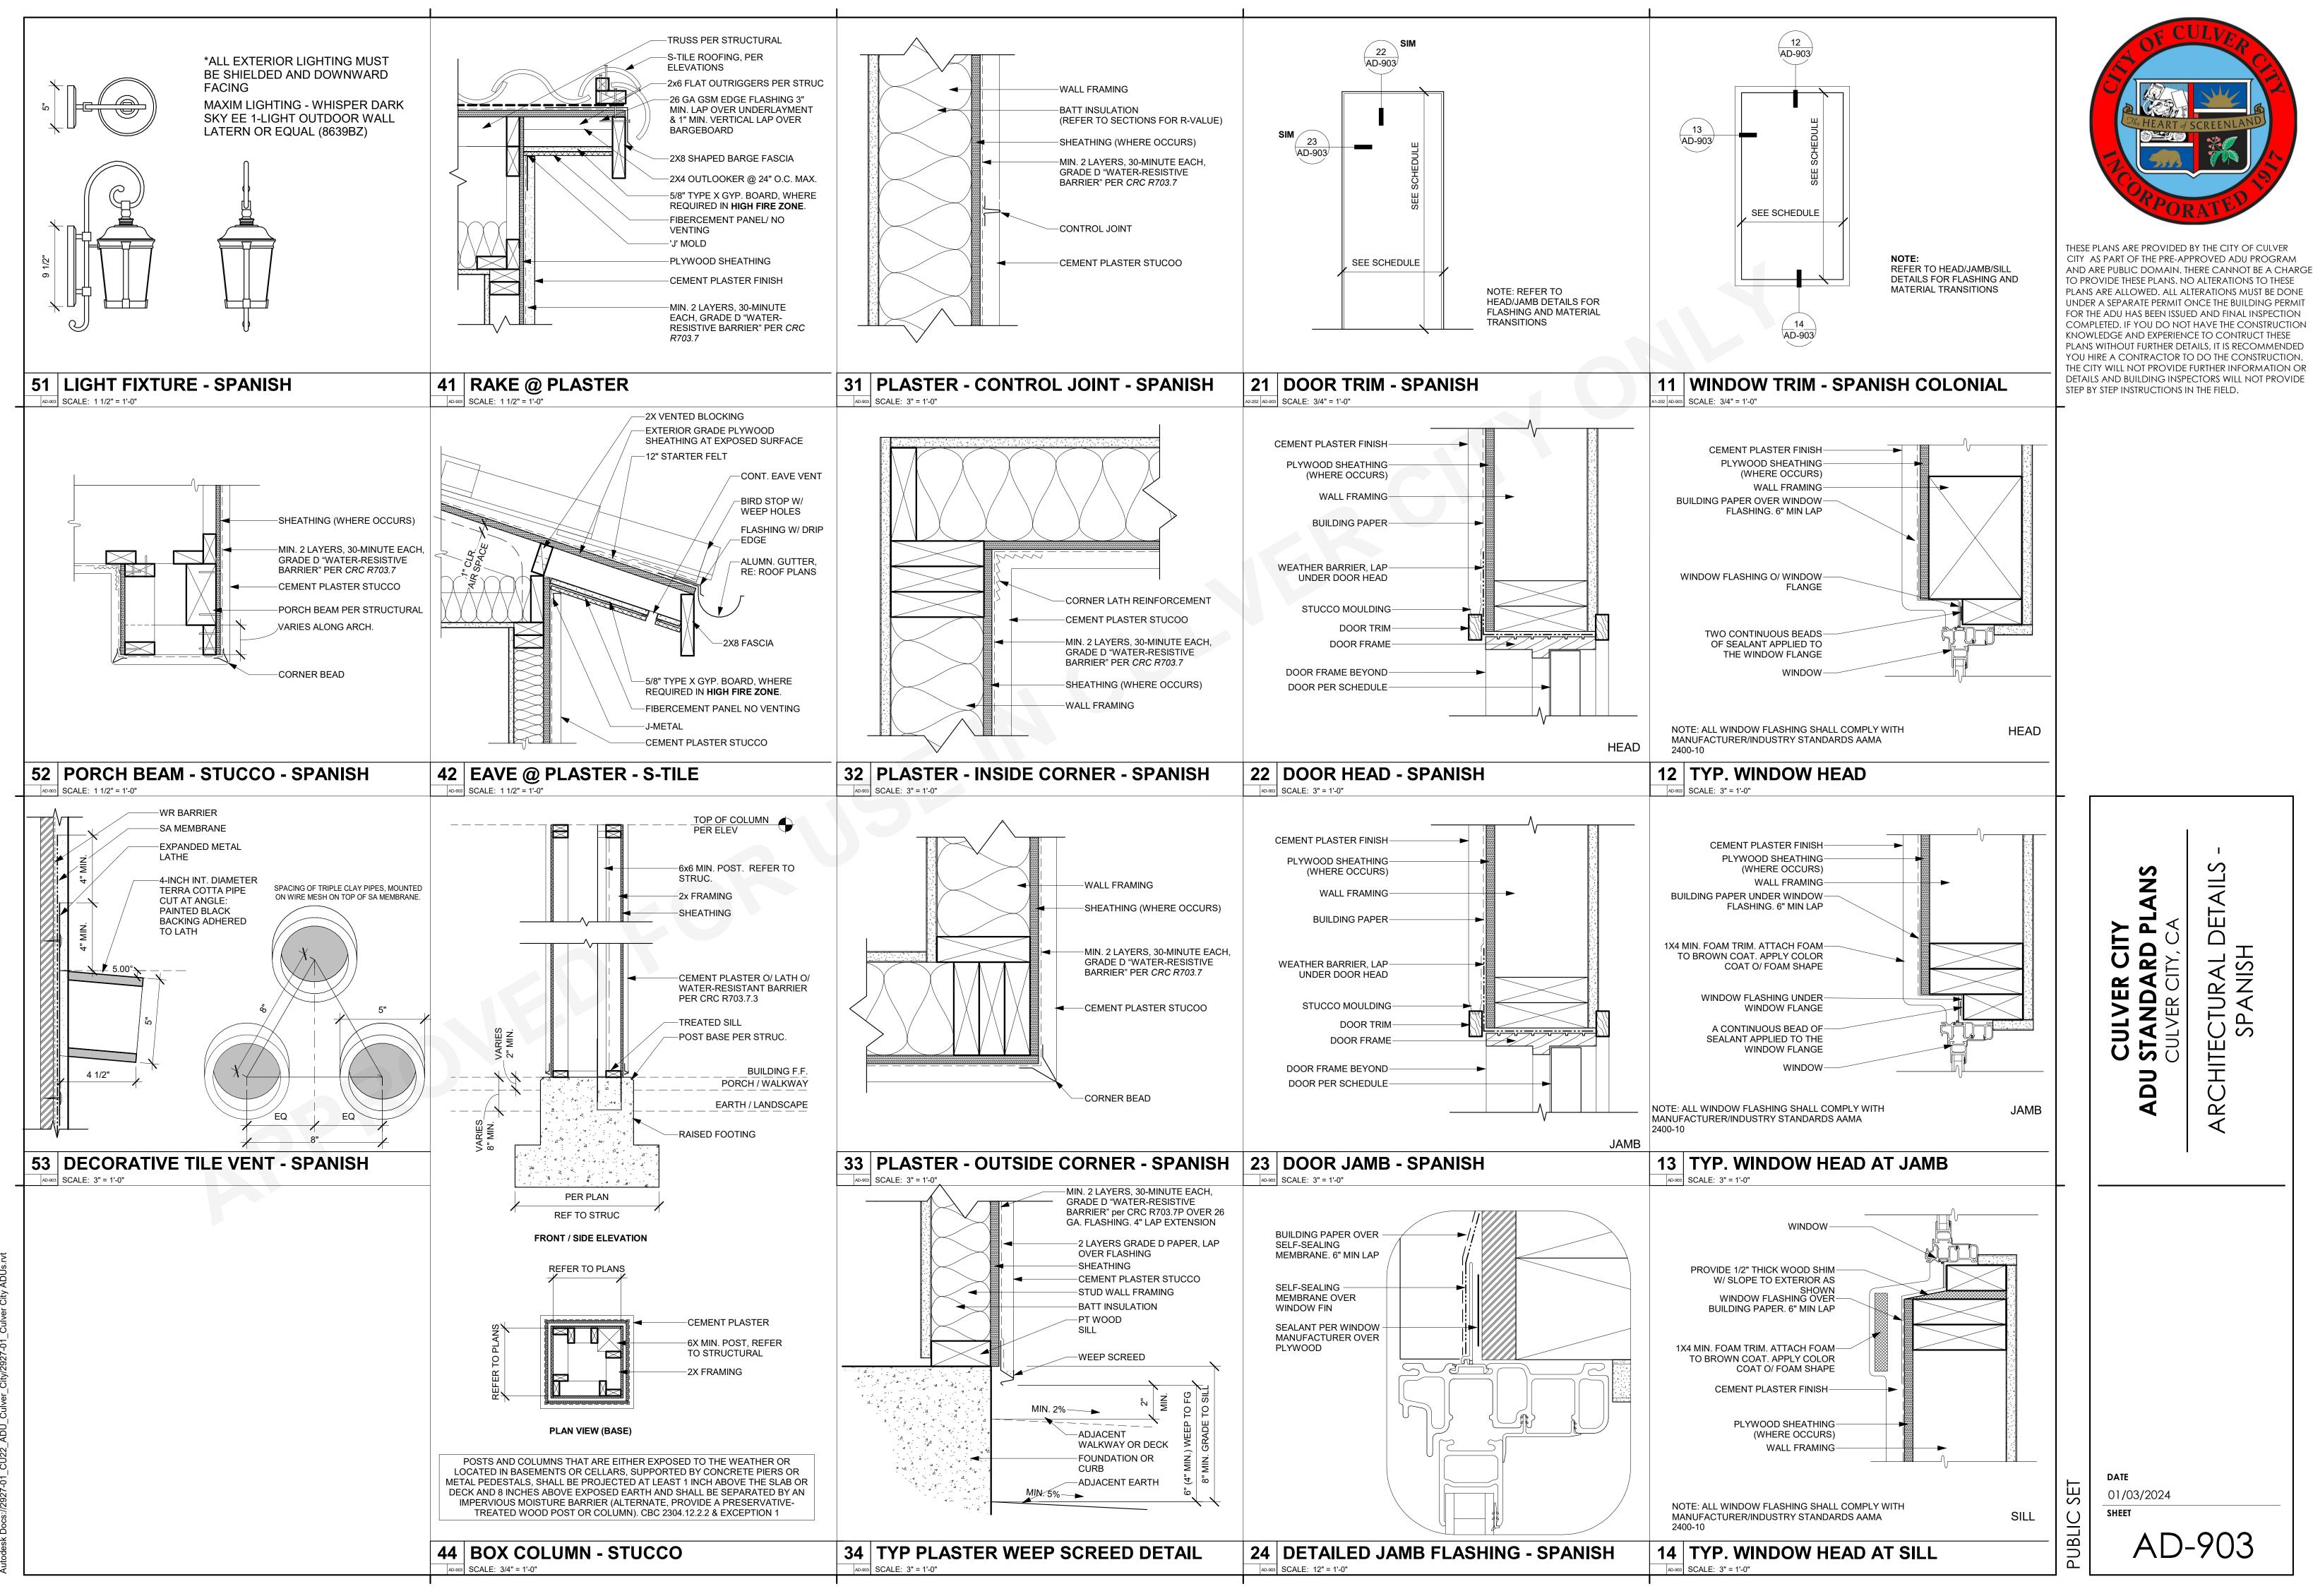

4 11:05:34 AM sk Docs//2927-01 CU22 ADU Culver Citv/2927-01 Culver Citv A

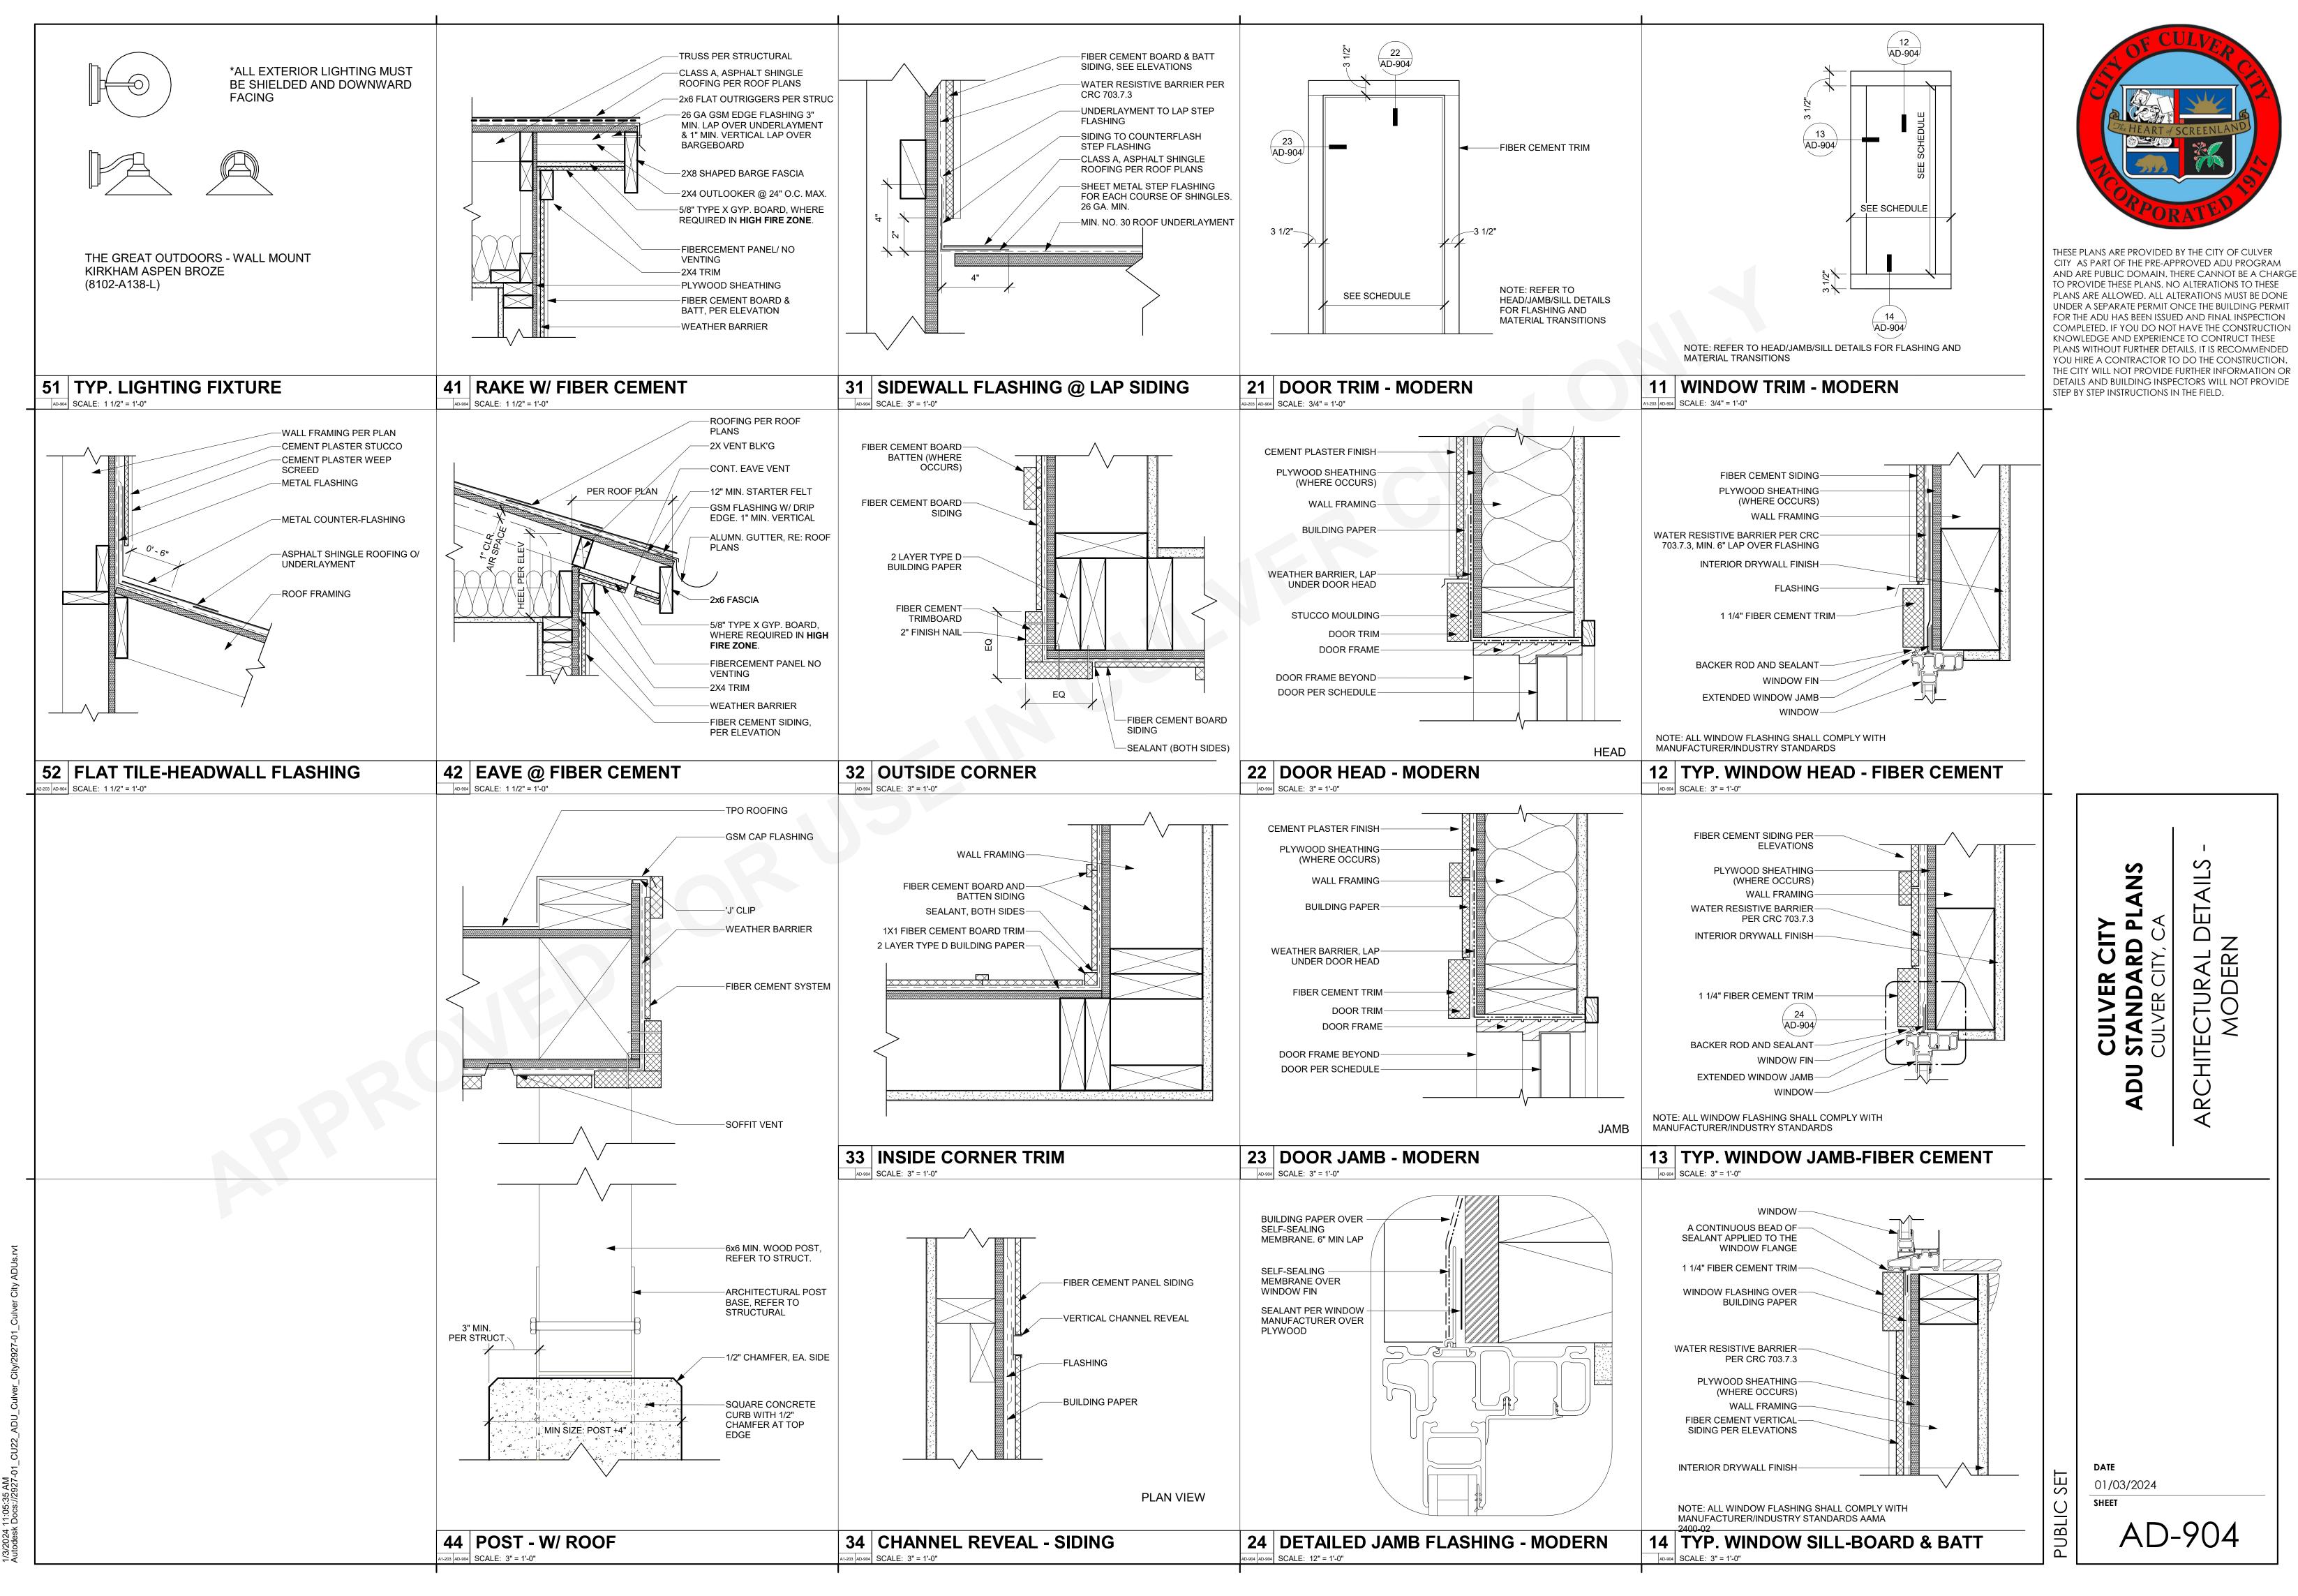

SYMBOLS

| | DETAIL REFERENCE BUBBLE WITH LEADER | XX'-X'' X | INDICATES SHEAR WALL TYPE AND LENGTH, PER SHEAR WALL SCHEDULE |
|--------------------------|-------------------------------------|--------------|--|
| | DETAIL REFERENCE BUBBLE | | INDICATES SPAN AND DIRECTION OF PREFABRICATED ROOF TRUSS (BY OTHERS) |
| — | FULL HEIGHT SECTION INDICATOR | XX | INDICATES SPAN AND DIRECTION OF ROOF RAFTER OR FLOOR JOIST WITH WEB |
| | | XX / | INDICATES SPAN AND DIRECTION OF ROOF RAFTER OR FLOOR JOIST |
| | ELEVATION OF WALL OR FRAME | × | INDICATES EXTENTS OF FRAMING OR OTHER STRUCTURAL ELEMENT |
| | | | INDICATES HEADER @ OPENING PER HEADER SCHEDULE |
| | NORTH ARROW | | EARTH LAYER |
| | | | INDICATES SAND OR GROUT |
| BOT OF EL = (-X'-X'') | TOP/BOTTOM OF ELEVATIONS | | INDICATES GRAVEL |
| \longrightarrow | SLOPE | | STEEL IN CROSS SECTION |
| | | | INDICATES BEARING WALL |
| x x x | WELDED WIRE FABRIC (WWF LAYER) | | SHADED AREA INDICATES CALIFORNIA FRAMING |
| 777 777 | STEPPED SURFACE; FLOOR DEPRESSION | | SHADED AREA INDICATES FOOTPRINT OF FLOOR ABOVE |
| | | | STEEL HSS TUBE COLUMN |
| | SLOPED SURFACE | \bigcirc | STEEL HSS OR PIPE COLUMN |
| თ —— – —— თ | STEPPED FOOTING | Ţ | WIDE FLANGE STEEL COLUMN |
| | | \square | WOOD POST |
| 89 — – — 89 | BOTTOM STEPPED FOOTING | | |

| A & B | ABOVE AND BELOW | |
|----------|--|---------------|
| AB | ANCHOR BOLT | CU FT |
| ABV | ABOVE | d |
| ACI | AMERICAN CONCRETE INSTITUTE | DBL |
| | | DEPT |
| ADDL | ADDITIONAL | DET |
| ADJ | | DF |
| AESS | ARCHITECTURAL EXPOSED STRUCTURAL STEEL | DIA OR |
| AISC | AMERICAN INSTITUTE OF STEEL CONSTRUCTION | |
| ALT | ALTERNATE | DIAG |
| ALUM | ALUMINUM | DIAPH |
| ANCH | ANCHOR | DIM |
| ANSI | AMERICAN NATIONAL STANDARDS INSTITUTE | DN |
| APA | ENGINEERED WOOD ASSOCIATION (FORMERLY THE AMERICAN PLYWOOD ASSOCIATION) | DO DWG |
| APPVD | APPROVED | DWL |
| APPROX | APPROXIMATE | EA |
| ARCH | ARCHITECTURAL; ARCHITECT | EF |
| AWPA | AMERICAN WOOD PRESERVERS ASSOCIATION | EJ |
| AWS | AMERICAN WELDING SOCIETY | EL |
| AITC | AMERICAN INSTITUTE OF TIMBER CONSTRUCTION | ELEC |
| ASTM | AMERICAN SOCIETY FOR TESTING MATERIALS | |
| BEL | BELOW | elev Embed |
| BLDG | BUILDING | |
| BLK | BLOCK | EN |
| BLKG | BLOCKING | ENGR |
| BM | BEAM | EQ |
| BN | BOUNDARY NAIL | EQUIP |
| BOT OR B | BOTTOM | ES |
| BRC | BRACE | EW |
| BRG | BEARING | EXIST or |
| BTWN | BETWEEN | EXT |
| CANT | CANTILEVER | FDN |
| CAM OR C | CAMBER | FIN |
| CC | CENTER TO CENTER | fj FlG |
| CG | CENTER OF GRAVITY | FLG |
| CIP | CAST-IN-PLACE | FLK |
| CJ | CONSTRUCTION JOINT; CONTROL JOINT | FOC |
| CL | CENTER LINE | FOM |
| CLR | CLEARANCE; CLEAR | FOS |
| CMU | CONCRETE MASONRY UNIT | FOW |
| COL | COLUMN | FRMG |
| COL | COMPRESSION | FT |
| COMP | CONCRETE | FTA |
| | | FTG |
| CONN | CONNECTION; CONNECT | GA |
| CONSTR | | GALV |
| CONT | | GB |
| CONTR | CONTRACTOR | GLB |
| CJP | COMPLETE JOINT PENETRATION WELD | GR |
| CTR | CENTER | GRND |
| CTSK | COUNTERSINK; COUNTERSUNK | |
| | | |

CUBIC FOOT PENNY (NAIL OR BAR DIA) DOUBLE DEPARTMENT DETAIL DOUGLAS FIR/LARCH DIAMETER DIAGONAL DIAPHRAGM DIMENSION DOWN DO OVER DRAWING DOWEL EACH EACH FACE **EXPANSION JOINT** ELEVATION ELECTRICAL ELEVATOR EMBEDMENT EDGE NAIL ENGINEER EQUAL OR EQUIVALENT EQUIPMENT EACH SIDE EACH WAY EXISTING EXTERIOR FOUNDATION FINISH FLOOR JOIST FLANGE FLOOR FIELD NAIL FACE OF CONCRETE FACE OF MASONARY FACE OF STUD FACE OF WALL FRAMING FOOT; FEET FLOOR TIE ABOVE FOOTING GAUGE GALVANIZED GRADE BEAM GLUED LAMINATED BEAM GRADE GROUND

WALL TYPES

| L SCHEDULE | ——(X) | INDICATES TOP PLATE SPLICE NAILING PER SCHEDULE |
|-----------------------------|-------------|--|
| TRUSS (BY OTHERS) | <1x> | INDICATES SHEAR WALL STRAP / HOLDOWN TYPE PER SCHEDULE |
| | F1 | INDICATES PAD FOOTING TYPE PER SCHEDULE |
| OR JOIST WITH WEB STIFFENER | Cl | INDICATES CONTINUOUS FOOTING TYPE PER SCHEDULE |
| DR JOIST | ↔ | ANGLE BRACE |
| JK JOI2I | (2L) ↔ | DOUBLE ANGLE BRACE |
| EMENT | • | DRAG STRUT CONNECTION |
| | ♦ | FULL HEIGHT STIFFENER CONNECTION |
| | > | MOMENT CONNECTION |
| | ⊥ T | MEMBER SPLICE |
| | (+3") | TOP OF STEEL ± ELEVATION |
| | [X] | NUMBER OF EVENLY SPACED SHEAR STUDS |
| | [X-Y-Z] | SPECIAL STUD SPACING SEE TYPICAL STEEL DETAILS |
| | <3/4> | BEAM CAMBER AT MID-SPAN |
| | | |

DIA OR Ø

EXIST or (E)

| H or HORIZ | HORIZONTAL |
|------------|----------------------------------|
| HDR | HEADER |
| HGR | HANGER |
| HP | HIGH POINT |
| HSH | HORIZONTALLY SLOTTED HOLES |
| HT | HEIGHT |
| ID | INSIDE DIAMETER |
| IF | INSIDE FACE |
| I-JST | I-JOIST |
| IN | INCH |
| INCL | INCLUDE |
| INFO | INFORMATION |
| INSP | INSPECTION |
| INT | INTERIOR |
| JST | JOIST |
| JL | JOINT |
| K | KIPS |
| KS | KING STUD |
| KP | KING POST |
| KSI | KIPS PER SQUARE INCH |
| LB(S) OR # | POUND(S) |
| LF | LINEAL FOOT |
| LIN | LINEAL; LINEAR |
| LLH | LONG LEG HORIZONTAL |
| LLV | LONG LEG VERTICAL |
| LP | LOW POINT |
| LSH | LONG SLOTTED HOLES |
| LSL | LAMINATED STRAND LUMBER |
| LT WT | LIGHTWEIGHT |
| I VI | LEVEL OR LAMINATED VENEER LUMBER |
| MAS | MASONRY |
| MATL | MATERIAL |
| MAX | MAXIMUM |
| MB | MACHINE BOLT |
| MECH | MECHANICAL |
| MECH | MANUFACTURER |
| MIN | MINIMUM; MINUTE |
| MISC | MISCELLANEOUS |
| (N) | NEW |
| N | NORTH |
| NO or # | NUMBER |
| NTS | NOT TO SCALE |
| OC | ON CENTER |
| OD | OUTSIDE DIAMETER |
| OF | OUTSIDE FACE |
| OH | OPPOSITE HAND |
| OPNG | OPENING |
| OPP | OPPOSITE |
| ORIG | ORIGINAL |
| | |
| | |

| | INDICATES PLYWOOD SIDE FOR SHEARWALL |
|-------------|--|
| | INDICATES BEARING WOOD WALL BELOW |
| ₽ ⊒∃ | INDICATES BEARING WOOD WALL ABOVE |
| | INDICATES NON-BEARING WOOD WALL BELOW |
| | INDICATES NON-BEARING WOOD WALL ABOVE |
| £ | INDICATES EXISTING BEARING WOOD WALL |
| £ | INDICATES EXISTING NON-BEARING WOOD WALL |
| | INDICATES BEARING CMU WALL BELOW |
| | INDICATES BEARING CMU WALL ABOVE |
| | INDICATES NON-BEARING CMU WALL BELOW |
| {ZZZ | INDICATES NON-BEARING CMU WALL ABOVE |
| | INDICATES EXISTING BEARING CMU WALL |
| Z | INDICATES EXISTING NON-BEARING CMU WALL |
| | INDICATES BEARING CONCRETE WALL BELOW |
| | INDICATES BEARING CONCRETE WALL ABOVE |
| | INDICATES NON-BEARING CONCRETE WALL BELOW |
| | INDICATES NON-BEARING CONCRETE WALL ABOVE |
| | INDICATES EXISTING BEARING CONCRETE WALL |
| | INDICATES EXISTING NON-BEARING CONCRETE WALL |

ORIENTED STRAND BOARD POST ABOVE PARA OR // PARALLEL PRECAST; PIECE PERPENDICULAR PLYWOOD INDEX PLATE PROPERTY LINE PONDS PER LINEAL FOOT PLACES PLYWOOD PROPERTY PRESSURE TREATED PLATE WASHER PARTIAL JOINT PENETRATION WELD PREFABRICATED POUNDS PER SQUARE FOOT POUNDS PER SQUARE INCH PARALLEL STRAND LUMBER PAVEMENT POUND; NUMBER REFERENCE REINFORCE; REINFORCING REQUIRED ROOF **ROOF RAFTER** ROUND; DIAMETER SCHEDULE SECTION SEPARATION SHEET Sheathing SIMILAR SLAB ON GRADE SHEAR NAIL SPACING SPECIFICATIONS SQUARE STAINLESS STEEL SHORT SLOTTED HOLES STANDARD STAGGER STIFFENERS STIRRUP STEEL STRUCTURAL SHEAR WALL SYMMETRICAL

OSB

PA

PC

PI

PL

PLF

PLCS

PLY

PROP

PT

PW

PJP

PSF

PSI

PSL

#

REF

REINF

REQD

RF

RR

Ø

SCHED

SECT

SEP

SHT

Shtg

SIM

SOG

SN

SPCG

SPECS

SQ

SS

SSL

STD

STGR

STIFF

STIRR

STRUCT

STL

SW

SYM

PVMT

PREFAB

PERP

PLOR PL.

SHEET INDEX

| S-101 | SHEET INDEX, ABBREVIATION & SYMBOLS |
|-------|---|
| S-102 | GENERAL NOTES |
| S-103 | GENERAL NOTES, SPECIAL INSPECTION & TESTS |
| | |
| S-201 | FOUNDATION & ROOF FRAMING PLAN - BUNGALOW |
| S-211 | FOUNDATION & ROOF FRAMING PLAN - SPANISH |
| S-221 | FOUNDATION & ROOF FRAMING PLAN - MODERN |
| | |
| S-301 | TYPICAL CONCRETE DETAILS |
| S-311 | CONCRETE DETAILS |
| | |
| S-401 | TYPICAL WOOD DETAILS |
| S-402 | TYPICAL WOOD DETAILS |
| S-403 | TYPICAL WOOD DETAILS |

ROOF FRAMING DETAILS ROOF FRAMING DETAILS

S-421

S-422



THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

| ТВ | TIE BEAM |
|------------------|------------------------------|
| Т&В | TOP AND BOTTOM |
| T & G | TONGUE & GROOVE |
| TO | TOP OF |
| TOC | TOP OF CURB; TOP OF CONCRETE |
| TOF | TOP OF FOOTING |
| TEMP | TEMPERATURE; TEMPORARY |
| THRU | THROUGH |
| ТНК | THICKNESS/THICK |
| THR | THREADED |
| TOP or T | TOP |
| TOS | TOP OF STEEL/TOP OF SLAB |
| TOW | TOP OF WALL |
| TS | TRIMMER STUD |
| TYP | TYPICAL |
| UNO | UNLESS NOTED OTHERWISE |
| UT | ULTRA-SONIC TEST |
| VERT | VERTICAL |
| VSH | VERTICAL SLOTTED HOLES |
| W/ | WITH |
| W/O | WITHOUT |
| WO | WHERE OCCURS |
| WD | WOOD |
| WP | WORK POINT; WATERPROOF |
| WWF | WELDED WIRE FABRIC |
| STRUCTURAL STEEL | Shapes |
| W | W SHAPE |
| С | AMERICAN STD CHANNEL SHAPE |
| MC | MISC CHANNEL SHAPE |
| L | ANGLE SHAPE |
| WT, ST, MT | STRUCT TEE SHAPE |
| PIPE | STANDARD PIPE SHAPE |
| PIPE-X | EXTRA STRONG PIPE SHAPE |
| PIPE-XX | DBL EXTRA STRONG PIPE SHAPE |
| HSS | HOLLOW STRUCTURAL SECTION |

ADU CA

CULVER CITY , PROTOTYPE CULVER CITY, C

DATE SET 01/03/2024 SHEET PUBLIC

S-101

SHEET INDEX, ABBREVIATION & SYMBOLS

REINFORCING STEEL

- REINFORCING BARS SHALL CONFORM TO THE REQUIREMENTS OF CHAPTER 19 OF THE CODE AND WITH THE PROVISIONS OF ACI 318-19, ASTM A706, GRADE 60 UNO. ASTM A615 GR 60 STEEL MAY BE SUBSTITUTED FOR ASTM A706 GR60 STEEL PER ACI 318-19 SECTION 20.2.2.5 PROVIDED THE FOLLOWING CONDITIONS ARE MET:
- A. THE ACTUAL YIELD STRENGTH BASED ON MILL TESTS DOES NOT EXCEED THE SPECIFIED YIELD STRENGTH BY MORE THAN 18,000 PSI.
- B. THE RATIO OF THE ACTUAL ULTIMATE TENSILE STRESS TO THE ACTUAL YIELD STRENGTH IS NOT LESS THAN
- C. WHERE REINFORCEMENT COMPLYING WITH ASTM A615 IS TO BE WELDED, CHEMICAL TESTS SHALL BE PERFORMED TO DETERMINE WELDABILITY IN ACCORDANCE WITH SECTION 26.6.4 OF ACI 318-19.

2. BARS SHALL BE CLEAN OF RUST, GREASE, OR OTHER MATERIALS LIKELY TO IMPAIR BOND. ALL REINFORCING BAR BENDS SHALL BE MADE COLD.

- 3. WELDED WIRE REINFORCEMENT (WWR), PLAIN OR DEFORMED, SHALL CONFORM TO ASTM A185. WELDED DEFORMED WIRE REINFORCEMENT (WWR) SHALL CONFORM TO ASTM A1064. ALL WWR FOR STAIR PANS AND ALL WWR FOR CONCRETE FILL ON METAL DECK TO BE PLAIN WWR. PROVIDE LAPS PER ACI 318-19 SECTION 25.5.3 OR 25.5.4 MINIMUM. WWR SHALL BE SUPPORTED ON APPROVED CHAIRS.
- REINFORCING BAR LAP SPLICES SHALL BE MADE AS INDICATED ON THE DRAWINGS. LAP ALL HORIZONTAL BARS AT CORNERS AND INTERSECTIONS. STAGGER ALL SPLICES UNLESS NOTED OTHERWISE ON PLANS.
- A. MINIMUM LAP SPLICE LENGTH FOR REINFORCING STEEL BARS IN CONCRETE SHALL BE PER ACI 318-19 SECTION 25.5.2 AND THE REINFORCING SCHEDULE ON THE DRAWINGS.
- B. MINIMUM LAP SPLICE LENGTH FOR REINFORCING STEEL BARS IN MASONRY SHALL BE PER TMS 042-16 SECTION 6.1.6.1.1 AND THE REINFORCING SCHEDULE ON THE DRAWINGS.
- 5. ALL BARS SHALL BE MARKED SO THEIR IDENTIFICATION CAN BE MADE WHEN THE FINAL IN-PLACE INSPECTION IS MADE. ALL REINFORCING CONFORMING TO DIFFERING ASTM SPECIFICATIONS AND/OR OF DIFFERING GRADES SHALL BE CLEARLY MARKED TO DIFFERENTIATE THEM FROM OTHER REINFORCING STEEL IF CONCURRENTLY PRESENT ON SITE.
- WHERE WELDING OF REINFORCING IS APPROVED BY THE STRUCTURAL ENGINEER, IT SHALL BE DONE BY AWS CERTIFIED WELDERS USING E80XX OR APPROVED ELECTRODES. WELDING PROCEDURES SHALL CONFORM TO THE REQUIREMENTS OF STRUCTURAL WELDING CODE- REINFORCING STEEL", AWS-D1.4-15. REINFORCING BARS TO BE WELDED SHALL CONFORM TO THE REQUIREMENTS OF ASTM A706.
- REINFORCING STEEL SHALL BE ACCURATELY PLACED AND ADEQUATELY SUPPORTED BEFORE THE CONCRETE IS PLACED AND SHALL BE SECURED AGAINST DISPLACEMENT DURING CONSTRUCTION WITHIN PERMITTED TOLERANCES. ADEQUATE SUPPORTS ARE ALSO NECESSARY TO KEEP THE REINFORCING STEEL AT THE PROPER DISTANCE FROM THE FORMS. USE WIRE BAR SUPPORTS, PRECAST CONCRETE SUPPORTS, SPACERS, BOLSTERS, REINFORCEMENT OR OTHER MEANS OF SUPPORT PER THE "CRSI MANUAL OF STANDARD PRACTICE", LATEST EDITION.
- REINFORCING STEEL SHALL BE DETAILED IN ACCORDANCE WITH THE "CRSI MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCED CONCRETE STRUCTURES", LATEST EDITION.
- 9. COMPLETE AND DETAILED REINFORCING PLACEMENT DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ARCHITECT FOR APPROVAL BY THE SEOR PRIOR TO FABRICATION IN ACCORDANCE WITH THE SPECIFICATIONS AND APPLICABLE CODES. THESE DRAWINGS SHALL BE AVAILABLE ON THE JOB SITE PRIOR TO PLACING OF CONCRETE. THE REINFORCING PLACEMENT DRAWINGS SHALL INCLUDE ALL PRIMARY REINFOREMENT, LAP SPLICES, TIES, DOWELS, HEADED U-DOWELS, EMBED PLATES, ANCHOR BOLTS, ETC. AREAS OF CONGESTION SHALL BE DETAILED SUFFICIENTLY TO DEMONSTRATE THAT PLACEMENT OF REBAR MEETS SPACING REQUIREMENTS OF ACI 318-19.
- 10. MILL TEST REPORTS FOR GRADE 60 BARS SHALL BE SUBMITTED TO THE INSPECTOR OF RECORD PRIOR TO PLACEMENT OF CONCRETE PER ACI 318-19 SECTION 26.13.2.3 OF THE CODE.
- 11. WHEN REQ'D, INSPECTION OF CONCRETE SHALL INCLUDE INSPECTION DURING INSTALLATION OF REINFORCING STEEL. INSPECTION SHALL BE SCHEDULED SO THAT PLACEMENT OF REINFORCING STEEL. CONDUIT, SLEEVES, AND EMBEDDED ITEMS MAY BE CORRECTED PRIOR TO PLACEMENT OF OVERLYING GRIDS OR REINFORCING STEEL.

12. CONCRETE PROTECTION FOR REINFORCEMENT

| 1 | FOLLOWING MINIMUM CONCRETE COVER SHALL BE PROVIDED FOR FORCEMENT IN CAST-IN-PLACE CONCRETE (NON-PRESTRESSED): | MINIMUM COVER, IN. |
|----|--|---------------------|
| Α. | CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH | 3 |
| В. | CONCRETE EXPOSED TO EARTH OR WEATHER: NO.6 THROUGH NO. 18 BAR NO.5 BAR, W31 OR D31 WIRE & SMALLER | 2 1 ½" |
| C. | CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND: SLABS, WALLS, JOISTS: NO.14 AND NO.18 BARS NO.11 BAR & SMALLER BEAMS, COLUMNS: PRIMARY REINFORCEMENT TIES, STIRRUPS, SPIRALS | 1 ½" 34" 1 ½" |

CONCRETE

ALL CONCRETE CONSTRUCTION SHALL CONFORM WITH CHAPTER 19 OF THE CODE AND WITH THE PROVISIONS OF ACI 318-19.

| MATERIAL | ASTM STANDARD |
|--|---------------|
| PORTLAND CEMENT (TYPE II) ^A | C150 |
| CONCRETE AGGREGATES (HARDROCK) | C33 |
| CONCRETE AGGREGATES (LIGHTWEIGHT) ^C | C330 |
| NATER ^B | C1602 |
| coal fly ash or pozollan (class f) | C618 |
| NATURAL OR MANUFACTURED SAND | C33 |
| SLAG | C989 |

- A. FOR SOILS WITH HIGH CONCENTRATIONS OF SULFATES (EXPOSURES S2 OR S3 PER ACI 318-19 TABLE 19.3.2.1) PORTLAND CEMENT SHALL BE TYPE V. VERIFY WITH PROJECT GEOTECHNICAL REPORT.
- B. WATER SHOULD ONLY BE ADDED AT THE BATCH PLANT. IN NO CASE SHALL THE DESIGN WATER/ CEMENT RATIO BE EXCEEDED.
- C. PUMICE AGGREGATE SHALL NOT BE USED.
- 3. CONCRETE MIXES SHALL BE PROPORTIONED BASED ON SECTION 26.4.3 OF ACI 318-19, WHICH REFERENCES ACI 301-20 ARTICLE 4.2.3. MIX DESIGNS SHALL INCLUDE DOCUMENTATION OF MIX AVERAGE COMPRESSIVE STRENGTH THROUGH FIELD TEST DATA OR TRAIL MIXTURES IN ACCORDANCE WITH ACI 301-20 ARTICLE 4.2.3.4. SCHEDULE OF STRUCTURAL CONCRETE STRENGTHS AND LOCATIONS (UNO):

| LOCATION IN STRUCTURE | MINIMUM STRENGTH (PSI) | DENSITY (PCF) | MAX SLUMP (IN±1) | MAX WATER/CEMENT RATIO | SLAG/ FLY ASH ^A (MAX) |
|--|---------------------------|---------------|---------------------|------------------------------|--|
| CONCRETE FOUNDATIONS, GRADE BEAMS, TIE BEAMS | 2,500 | 150 | 4 | 0.5 | 0.15 |
| CONCRETE SLAB ON GRADE | 2,500 | 150 | 4 | 0.45 | 0.15 |

- 4. READY MIXED CONCRETE SHALL BE MIXED AND DELIVERED IN ACCORDANCE WITH THE REQUIREMENTS OF ASTM C94 OR C685.
- 5. DEPOSITING AND CONVEYING OF CONCRETE SHALL CONFORM TO SECTION 26.5 OF ACI 318-19 AND PROJECT SPECIFICATIONS.
- 6. ALL CONCRETE SURFACES AGAINST WHICH NEW CONCRETE IS TO BE PLACED SHALL BE CLEANED AND ROUGHENED TO 1/4" AMPLITUDE.
- 7. ALL REINFORCING BARS, ANCHOR BOLTS AND OTHER CONCRETE INSERTS SHALL BE WELL SECURED IN POSITION PRIOR TO PLACING CONCRETE.
- 8. PROVIDE SLEEVES FOR PLUMBING AND ELECTRICAL OPENINGS IN CONCRETE BEFORE PLACING. DO NOT CUT ANY REINFORCING WHICH MAY CONFLICT. CORING IN CONCRETE IS NOT PERMITTED WITHOUT SEOR APPROVAL. NOTIFY THE SEOR IN ADVANCE OF CONDITIONS NOT SHOWN ON THE DRAWINGS. SEE THE DRAWINGS FOR ADDITIONAL RESTRICTIONS ON THE PLACEMENT OF OPENINGS IN SLABS AND WALLS.

9. PIPES EMBEDDED IN CONCRETE:

- A. CONCRETE a. PIPES LARGER THAN 1-1/2" DIAMETER SHALL NOT BE EMBEDDED IN STRUCTURAL CONCRETE
- EXCEPT WHERE SPECIFICALLY APPROVED BY SEOR. b. NO CONDUITS SHALL BE PLACED IN CONCRETE FILL OVER METAL DECK.
- c. PIPES SHALL NOT DISPLACE OR INTERRUPT REINFORCING BARS.
- d. DO NOT STACK CONDUITS, SPACE EMBEDDED PIPES AND CONDUITS AT A MINIMUM OF 3 DIAMETERS CLEAR FROM OTHER EMBEDDED PIPES/CONDUITS AND REBAR.

FOUNDATION

1. GEOTECHNICAL INFORMATION AND FOUNDATION DESIGN IS BASED ON THE FOLLOWING: DESIGN LATERAL SOIL LOADS ARE IN ACCORDANCE WITH 2022 CBC TABLE 1610.1 B. ALLOWABLE FOUNDATION BEARING AND LATERAL PRESSURES ARE IN ACCORDANCE WITH 2022 CBC TABLE 1806.2 C. VALUES LISTED SHALL BE VERIFIED BY A LICENSED GEOTECHNICAL ENGINEER

| <u>)</u> . | SPREAD OR CONTINUOUS | FOOTINGS: | | | |
|------------|----------------------|--|--|----------------|--|
| | | | ALLOWABLE LATERAL RESISTANCE B | | |
| | ELEMENT | Allowable bearing Capacity (PSF) ^a | PASSIVE RESISTANCE (PSF/FT BELOW GRADE) ^E | COHESION (PSF) | |
| | CONT FTGS | 1,500 | 100 | 120 | |

A. THE ALLOWABLE CAPACITY MAY BE INCREASED BY ONE-THIRD WHEN CONSIDERING LOADS OF SHORT DURATION SUCH AS WIND OR SEISMIC FORCES.

B. THE ALLOWABLE LATERAL RESISTANCE CAN BE TAKEN AS THE SUM OF THE FRICTIONAL RESISTANCE AND PASSIVE RESISTANCE .

- C. THE UPPER 0 FOOT OF SOIL NOT PROTECTED BY PAVEMENT SHALL BE NEGLECTED WHEN CALCULATING PASSIVE RESISTANCE.
- D. COMPACTED FILL SHOULD BE PREPARED AS FOLLOWS: A MIN OF 12" OF COMPACTED FILL SHALL BE PROVIDED, COMPACTED TO A MIN OF 90 PERCENT MODIFIED PROCTOR IN ACCORDANCE WITH ASTM D 1557 (2022 CBC 1804.6)
- 4. WHERE NOT SHOWN ON THE DRAWINGS, CONTRACTOR TO PROVIDE FOR DESIGN AND INSTALLATION OF ALL CRIBBING, SHEATHING AND SHORING REQUIRED AND SHALL BE SOLELY RESPONSIBLE FOR ALL EXCAVATION PROCEDURES INCLUDING LAGGING, SHORING, AND PROTECTION OF ADJACENT PROPERTY, STRUCTURES, STREETS, AND UTILITIES IN ACCORDANCE WITH ALL NATIONAL, STATE AND LOCAL SAFETY ORDINANCES.
- 5. CONTRACTOR TO PROVIDE FOR DE-WATERING OF EXCAVATIONS FROM SURFACE WATER, GROUND WATER AND/OR SEEPAGE.
- 6. EXCAVATION FOR FOOTINGS SHALL BE APPROVED BY THE INSPECTOR OR GEOTECHNICAL ENGINEER PRIOR TO PLACING CONCRETE AND REINFORCING.
- 7. ALL EXCAVATIONS SHALL BE PROPERLY BACKFILLED. DO NOT PLACE BACKFILL BEHIND RETAINING WALLS BEFORE CONCRETE OR GROUT HAS ATTAINED FULL DESIGN STRENGTH. CONTRACTOR SHALL PROVIDE FOR DESIGN, PERMITS AND INSTALLATION OF SUCH BRACING.
- 8. EXCAVATIONS SHALL BE CUT SQUARE AND SMOOTH, WITH LEVEL BOTTOMS.
- 9. FOOTING BACKFILL AND UTILITY TRENCH BACKFILL WITHIN BUILDING AREA SHALL BE MECHANICALLY COMPACTED IN LAYERS IN ACCORDANCE WITH THE GEOTECHNICAL INVESTIGATION REPORT AND APPROVED BY THE GEOTECHNICAL ENGINEER. FLOODING WILL NOT BE PERMITTED. ALL FILLS USED TO SUPPORT FOUNDATIONS SHALL BE INSPECTED BY THE GEOTECHNICAL ENGINEER REPRESENTATIVE PER SECTION 1705.6 OF THE CODE.
- 10. ALL ABANDONED FOOTINGS, UTILITIES, ETC. SHALL BE REMOVED. NEW FOOTINGS MUST EXTEND INTO UNDISTURBED SOILS.
- 11. PIPES WITHIN THE ZONE OF INFLUENCE OF BUILDING OR SITE ELEMENT FOUNDATIONS SHALL BE ENCASED IN LEAN CONCRETE AT THE DIRECTION OF THE GEOTECHNICAL ENGINEER OF RECORD.

DESIGN INFORMATION

| DEAD LOADS: | |
|---|---------------|
| DEAD LOADS | |
| LOCATIONS | UNIFORM (PSF) |
| ROOF: CLAY TILE WITH GYPSUM CEILING | 25.0 |
| EXTERIOR BEARING WALLS: STUCCO FINISH OVER 2x6 STUDS | 17.6 |
| INTERIOR NON BEARING WALLS: GYPSUM BOARD EACH FACE, 2x6 STU | IDS 8.7 |
| ROOF LIVE LOADS (2022 CBC SECTION 1603.1.2) | |

2. ROOF LIVE LOADS (2022 CBC SECTION 1603.1.2)

| | ROOF LIVE LOADS | | | | | |
|---|--|------------------|----------------|--------------------------|--|--|
| | OCCUPANCY OR USE | UNIFORM (PSF) | CONC. (LBS) | REFERENCE | | |
| | ROOF ORDINARY FLAT, PITCHED AND CURVED ROOFS (THAT ARE NOT OCCUPIABLE) | 20 | | 2022 CBC TABLE 1607.1 | | |
| • | ROOF SNOW LOADS (2022 CBC SECTION 1603.1.3): | | | | | |
| | SNOW DESIGN DATA | | | | | |
| | | | | DEEEDENLOE | | |

PARAMETER VALUE REFERENCE Pg = 0 PSFASCE 7-16 7.2 GROUND SNOW LOAD 4. WIND DESIGN DATA (2022 CBC SECTION 1603.1.4) :

| WIND DESIGN DATA | | | | | |
|---|---------------------------|-------------------------|--|--|--|
| PARAMETER | VALUE | REFERENCE | | | |
| ultimate design wind speed (3-sec gust) | V _{ULT} = 94 MPH | 2022 CBC FIG. 1609.3 | | | |
| NOMINAL DESIGN WIND SPEED (3-SEC GUST) | V _{ASD} = 73 MPH | 2022 CBC 1609.3.1 | | | |
| EXPOSURE CATEGORY | С | 2022 CBC 1609.4.3 | | | |
| INTERNAL PRESSURE COEFFICIENT: | GCpi = ± 0.18 | ASCE 7-16 TABLE 26.13-1 | | | |

COMPONENTS & CLADDING WIND PRESSURES (PSF)

| | | COMPONENT TRIBUTARY AREA (SQ FT) | | | |
|----------|-----------|----------------------------------|-------|-------|--|
| LOCATION | | 10 | 100 | 500 | |
| | ZONE 1 | -25.8 | -16.0 | -16.0 | |
| | ZONE 2r | -35.6 | -22.5 | -19.3 | |
| ROOF | ZONE 2e | -35.6 | -22.5 | -19.3 | |
| | ZONE 3 | -35.6 | -22.5 | -19.3 | |
| | ALL ZONES | 16.0 | 16.0 | 16.0 | |
| | ZONE 1 | -33.9 | -33.1 | -32.3 | |
| OVERHANG | ZONE 2r | -42.1 | -37.2 | -35.6 | |
| OVERNANG | ZONE 2e | -42.1 | -37.2 | -35.6 | |
| | ZONE 3 | -48.6 | -32.3 | -27.4 | |
| | ZONE 4 | -20.9 | -18.1 | -16.0 | |
| WALL | ZONE 5 | -25.8 | -20.1 | -16.0 | |
| | POSITIVE | 19.3 | 16.0 | 16.0 | |

5. EARTHQUAKE DESIGN DATA (2022 CBC SECTION 1603.1.5):

SITE AND OCCUPANCY PARAMETERS

| PARAMETER | VALUE | REFERENCE |
|---|---------------|-----------------------|
| RISK CATEGORY | П | 2022 CBC TABLE 1604.5 |
| SEISMIC IMPORTANCE FACTOR | I = 1.0 | ASCE 7-16 TABLE 1.5-2 |
| MAPPED SPECTRAL RESPONSE ACCELERATIONS: | Ss = 2.011g | 2022 CBC 1613.2.1 |
| MAFFED SFECTRAL RESPONSE ACCELERATIONS: | S1 = 0.713g | 2022 CDC 1013.2.1 |
| SITE CLASS | d (default) | 2022 CBC 1613.2.2 |
| SPECTRAL RESPONSE COEFFICIENTS: | S Ds = 1.721g | 2022 CBC 1613.2.4 |
| SPECIKAL RESPONSE COEFFICIENTS. | S DI = 0.808g | ZUZZ CDC 1013.2.4 |

| PARAMETER | VALUE | REFERENCE | |
|--------------------------------------|---|--------------------|--|
| SEISMIC DESIGN CATEGORY | SDC = D | 2022 CBC 1613.2.5 | |
| BASIC SEISMIC FORCE RESISTING SYSTEM | LIGHT FRAME (WOOD) WALLS SHEATHED WITH WOOD STRUCTURAL PANELS RATED FOR SHEAR RESISTANCE | ASCE 7-16 TABLE | |
| RESPONSE MODIFICATION FACTOR | $R = 6\frac{1}{2}$ | 12.2-1 | |
| SYSTEM OVERSTRENGTH FACTOR | Ωo = 3 | | |
| DEFLECTION AMPLIFICATION FACTOR | Cd = 4 | | |
| DESIGN BASE SHEAR | V = 11.0 k | ASCE 7-16 12.8.1 | |
| REDUNDANCY FACTOR | 1.3 | ASCE 7-16 12.3.4 | |
| SEISMIC RESPONSE COEFFICIENTS | Cs = 0.265 | ASCE 7-16 12.8.1.1 | |
| ANALYSIS PROCEDURE USED | EQUIVALENT LATERAL FORCE PROCEDURE | ASCE 7-16 12.8 | |

EXISTING CONDITIONS

ALL INFORMATION SHOWN ON THE PLANS RELATIVE TO EXISTING CONDITIONS IS GIVEN AS THE BEST PRESENT KNOWLEDGE FROM PLANS SUPPLIED BY THE OWNER, BUT WITHOUT GUARANTEE OF ACCURACY.

WHERE ACTUAL CONDITIONS ARE NOT IN ACCORDANCE WITH THE INFORMATION PRESENTED, THE ARCHITECT AND/OR STRUCTURAL ENGINEER SHALL BE NOTIFIED IMMEDIATELY. NO MODIFICATIONS OF THE PLANS FOR NEW CONSTRUCTION SHALL BE MADE WITHOUT THE WRITTEN APPROVAL OF THE ARCHITECT.

EXISTING UNDERGROUND UTILITIES

- THE ARCHITECT AND ENGINEERS ARE NOT RESPONSIBLE FOR THE LOCATIONS OF EXISTING UNDERGROUND UTILITIES WHETHER OR NOT SHOWN ON THE DRAWINGS. DRAWINGS, IF ANY, IS APPROXIMATE. THE CONTRACTOR SHALL EXERCISE EXTREME CAUTION IN EXCAVATING AND TRENCHING ON THE SITE. THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ARCHITECT AND/OR STRUCTURAL ENGINEER SHOULD ANY SUCH UNIDENTIFIED CONDITIONS BE DISCOVERED.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGES WHICH MAY RESULT FROM HIS FAILURE TO EXACTLY LOCATE AND PRESERVE ALL EXISTING UNDERGROUND UTILITIES.
- 3. AN UNDERGROUND SERVICE ALERT INQUIRY IDENTIFICATION NUMBER MUST BE OBTAINED AT LEAST TWO WORKING DAYS BEFORE STARTING WORK WITH THIS PERMIT. A. FOR PROJECTS IN SOUTHERN CALIFORNIA TELEPHONE NO. 1-800-422-4133.

GENERAL

- 1. ALL WORK SHALL CONFORM TO THE MINIMUM STANDARDS OF THE FOLLOWING CODES AND STANDARDS:
- A. 2022 CALIFORNIA BUILDING CODE, PART 2, VOLUME 2 OF 2, AND TITLE 24 C.C.R. 2022 EDITION AND LATEST REVISIONS (INCLUDING SUPPLEMENTS AND ERRATA) HEREIN REFERRED TO AS "THE CODE".
- B. ANY OTHER REGULATING AGENCIES WHICH HAVE AUTHORITY OVER ANY PORTION OF THE WORK, INCLUDING THE STATE OF CALIFORNIA DIVISION OF OCCUPATIONAL SAFETY AND HEALTH (CAL/OSHA).
- C. CODES & STANDARDS REFERENCED IN THE CODE OR LISTED IN THESE NOTES AND SPECIFICATIONS.
- 2. ALL DRAWINGS ARE CONSIDERED TO BE A PART OF THE CONTRACT DOCUMENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REVIEW AND COORDINATION OF ALL DRAWINGS AND SPECIFICATIONS PRIOR TO THE START OF CONSTRUCTION. ANY DISCREPANCIES THAT OCCUR SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT PRIOR TO START OF CONSTRUCTION SO THAT A CLARIFICATION CAN BE ISSUED. ANY WORK PERFORMED IN CONFLICT WITH THE CONTRACT DOCUMENTS OR ANY CODE REQUIREMENTS SHALL BE CORRECTED BY THE CONTRACTOR AT THEIR OWN EXPENSE AND AT NO EXPENSE TO THE OWNER OR ARCHITECT
- NOTES AND DETAILS ON DRAWINGS SHALL TAKE PRECEDENCE OVER GENERAL NOTES AND TYPICAL DETAILS. WHERE NO DETAILS ARE GIVEN, CONSTRUCTION SHALL BE AS SHOWN FOR SIMILAR WORK.
- 4. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO STARTING CONSTRUCTION. THE ARCHITECT SHALL BE NOTIFIED OF ANY DISCREPANCIES OR INCONSISTENCIES. IN NO INSTANCE SHALL DIMENSIONS BE SCALED FROM THE DRAWINGS.
- SEE ARCHITECTURAL DRAWINGS FOR THE FOLLOWING:
- A. SIZE AND LOCATION OF ALL DOOR AND WINDOW OPENINGS, EXCEPT AS NOTED
- B. SIZE AND LOCATION OF ALL INTERIOR AND EXTERIOR NON-BEARING PARTITIONS UNLESS NOTED AND/OR DETAILED ON THE STRUCTURAL DRAWINGS
- C. SIZE AND LOCATION OF ALL CONCRETE CURBS, EQUIPMENT PADS, PITS, FLOOR DRAINS, SLOPES, DEPRESSED AREAS, CHANGE IN LEVEL, CHAMFERS, GROOVES, INSERTS, ETC
- D. SIZE AND LOCATION OF ALL FLOOR AND ROOF OPENINGS EXCEPT AS SHOWN
- E. FLOOR AND ROOF FINISHES
- F. MISCELLANEOUS DRAINAGE AND WATERPROOFING
- G. ALL FIREPROOFING REQUIREMENTS INCLUDING FIREPROOFING OF STRUCTURAL STEEL
- H. DIMENSIONS NOT SHOWN ON STRUCTURAL DRAWINGS
- 6. SEE MECHANICAL, PLUMBING AND ELECTRICAL DRAWINGS FOR THE FOLLOWING:
- A. PIPE RUNS, SLEEVES, HANGERS, TRENCHES, WALL AND SLAB OPENINGS, ETC., EXCEPT AS SHOWN OR NOTED.
- B. ELECTRICAL CONDUIT RUNS, BOXES, OUTLETS IN WALLS AND SLABS.
- C. CONCRETE INSERTS FOR ELECTRICAL, MECHANICAL OR PLUMBING FIXTURES.
- D. SIZE AND LOCATION OF MACHINE OR EQUIPMENT BASES, ANCHOR BOLTS FOR MOTOR MOUNTS.
- THE CONTRACT STRUCTURAL DRAWINGS AND SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE. THEY DO NOT INDICATE THE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL PROVIDE ALL MEASURES NECESSARY TO PROTECT THE STRUCTURE DURING CONSTRUCTION. SUCH MEASURES SHALL INCLUDE, BUT NOT BE LIMITED TO, BRACING, SHORING FOR LOADS DUE TO CONSTRUCTION EQUIPMENT ETC. THE CONTRACTOR IS RESPONSIBLE FOR PROVISION OF TEMPORARY SHORING AND OTHER CONSTRUCTION AIDS, INCLUDING ALL ENGINEERING OF SUCH SYSTEMS, FOR TEMPORARY SUPPORT OF NEW AND/OR EXISTING STRUCTURAL ELEMENTS AS REQUIRED FOR ERECTION AND OTHER CONTRACTOR'S MEANS AND METHODS OF CONSTRUCTION (UNO). OBSERVATION VISITS TO THE SITE BY THE STRUCTURAL ENGINEER SHALL NOT INCLUDE INSPECTION OF THE ABOVE ITEMS OR CONCERN CONSTRUCTION MEANS AND METHODS OR CONSTRUCTION SAFETY.
- 9. THE CONTRACT STRUCTURAL DRAWINGS SHOW THE BUILDING IN ITS FINAL INTENDED POSITION. CONTRACTOR SHALL MAKE PROVISIONS IN THE LAYOUT OF THE BUILDING TO TAKE INTO ACCOUNTS SHRINKAGE, CREEP, SHORTENING, ETC..
- 10. ASTM SPECIFICATIONS ON THE DRAWINGS SHALL BE THE VERSION REFERENCED IN CHAPTER 35 OF THE CODE OR AS REFERENCED IN THE APPLICABLE DESIGN STANDARD.
- 11. CONTRACTOR SHALL INVESTIGATE SITE DURING CLEARING AND EARTHWORK OPERATIONS FOR FILLED EXCAVATIONS OR BURIED STRUCTURES, SUCH AS CESSPOOLS, CISTERNS, FOUNDATIONS, ETC. IF ANY SUCH STRUCTURES ARE FOUND, THE STRUCTURAL ENGINEER AND GEOTECHNICAL ENGINEER SHALL BE NOTIFIED IMMEDIATELY.
- 12. CONSTRUCTION MATERIAL SHALL BE SPREAD OUT IF PLACED ON FRAMED ROOF OR FLOOR. LOAD SHALL NOT EXCEED THE DESIGN LIVE LOAD PER SQUARE FOOT. THE CONTRACTOR TO DESIGN AND PROVIDE ADEQUATE SHORING AND/OR BRACING WHERE STRUCTURE HAS NOT ATTAINED DESIGN STRENGTH.
- 13. CONTRACTOR SHALL COORDINATE SHORING WITH DRAWINGS OF RECORD TO INSURE PROVISIONS FOR POCKETS, BLOCKOUTS, OFFSETS, STEPPED FOOTINGS AND ANY OTHER ITEMS AFFECTED BY THE SHORING. SHORING IS NOT THE RESPONSIBILITY OF THE SEOR. CONTRACTOR TO SUBMIT ANY SHORING DESIGN AND DRAWINGS FOR REVIEW AND APPROVAL PRIOR TO INSTALLATION.
- 14. AN UNDERGROUND SERVICE ALERT INQUIRY IDENTIFICATION NUMBER MUST BE OBTAINED AT LEAST TWO WORKING DAYS BEFORE STARTING WORK WITH THIS PERMIT. G. FOR PROJECTS IN SOUTHERN CALIFORNIA TELEPHONE NO. 1-800-422-4133.
- 15. EDGE OF SLAB DIMENSIONS TO BE COORDINATED AND VERIFIED BY THE GENERAL CONTRACTOR PRIOR TO FABRICATION.

DIMENSIONS

- 1. DIMENSIONS SHALL BE DEFINED TO INCLUDE BOTH HORIZONTAL DIMENSIONS AND VERTICAL DIMENSIONS (ELEVATIONS).
- 2. WRITTEN DIMENSIONS SHALL TAKE PRECEDENCE. DRAWINGS SHALL NOT BE SCALED.
- 3. SEE ARCHITECTURAL DRAWINGS FOR DIMENSION NOT NOTED ON STRUCTURAL DRAWINGS.
- 4. SEE ARCHITECTURAL AND/OR CIVIL DRAWINGS FOR FINISH FLOOR ELEVATIONS.
- 5. SEE ARCHITECTURAL DRAWINGS FOR ALL TOP OF SHEATHING AND/OR ROOF ELEVATIONS.
- 6. THE CONTRACTOR SHALL REVIEW AND VERIFY ALL DIMENSIONS PRIOR TO STARTING CONSTRUCTION. THE ARCHITECT SHALL BE NOTIFIED IMMEDIATELY OF ANY DISCREPANCIES OR INCONSISTENCIES.



THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.




ÔZ R ΪZ Ш ()

Ш S UBL

DATE

01/03/2024 SHEET



| WOOD CODE CHAPTER 17 AND REFERENCED 2018 NDS AND AWO | C SDPV | VS-201 | 5 |
|--|------------|----------|------------------------|
| SPECIAL INSPECTION OR TEST | CONTINUOUS | PERIODIC | CBC REFERENCE |
| HIGH LOAD DIAPHRAGM WOOD STRUCTURAL PANELS - VERIFY THE FOLLOWING: GRADE THICKNESS NOMINAL SIZE OF FRAMING MEMBERS AT ADJOINING PANEL EDGES NAIL DIAMETER AND LENGTH NUMBER OF FASTENER LINES SPACING BETWEEN FASTENERS IN EACH LINE SPACING BETWEEN FASTENERS AT EDGE MARGINS | | X | 1705.5.1 2306.2 |
| 3. WOOD LATERAL FORCE-RESISTING SYSTEM WITH FASTENER SPACING OF THE SHEATHING LESS THAN OR EQUAL TO 4" OC. - WOOD SHEAR WALLS - WOOD DIPHRAGMS - DRAG STRUTS - SHEAR PANELS - HOLD-DOWNS | | х | 1705.12.2 1705.13.2 |
| 4. WOOD LATERAL FORCE-RESISTING SYSTEM WITH FASTENER SPACING OF THE SHEATHING GREATER THAN 4" OC (NOT REQUIRED) - WOOD SHEAR WALLS - WOOD DIAPHRAGMS - DRAG STRUTS - SHEAR PANELS - HOLD-DOWNS | | | 1705.12.2 1705.13.2 |

SOILS CODE TABLE 1705.6

| SPECIAL INSPECTION OR TEST | CONTINUOUS | PERIODIC |
|--|------------|----------|
| 1. VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY | | Х |
| 2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL. | | Х |
| 3. PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIALS | | Х |
| VERIFY USE OF PROPER MATERIALS, DENSITIES, AND LIFT THICKNESSES DURING PLACEMENT AND COMPACTION OF COMPACTED FILL. | Х | |
| 5. PRIOR TO PLACEMENT OF COMPACTED FILL, INSPECT SUBGRADE AND VERIFY THAT SITE HAS BEEN PREPARED PROPERLY. | | Х |

| CONCRETE CONSTRUCTION CODE TABLE 1705.3 | | | | |
|--|------------|----------|------------------------------------|---------------|
| SPECIAL INSPECTION OR TEST | CONTINUOUS | PERIODIC | REFERENCED STANDARD | CBC REFERENCE |
| 3. INSPECT ANCHORS CAST IN CONCRETE | | Х | ACI 318: 26.7 | |
| 4. INSPECT ANCHORS POST-INSTALLED IN HARDENED CONCRETE MEMBERS ^(b) (a) ADHESIVE ANCHORS INSTALLED IN HORIZONTALLY OR UPWARDLY INCLINED ORIENTATIONS TO RESIST SUSTAINED TENSION LOADS (b) MECHANICAL ANCHORS AND ADHESIVE ANCHORS NOT DEFINED IN 4.a. | x | X | ACI 318: 26.7.1 ACI 318: 26.7.1 | |

STATEMENT OF SPECIAL INSPECTIONS

1. THIS STATEMENT OF SPECIAL INSPECTIONS HAS BEEN PREPARED PURSUANT TO SECTION 1704.3 THIS SECTION DETAILS BOTH REQUIRED SPECIAL INSPECTIONS AND TESTS INCLUDING TESTING I 1705 OF THE CODE. THE FOLLOWING SHALL BE OBSERVED DURING THEIR IMPLEMENTATION:

A. GENERAL:

a. STRUCTURAL VERIFICATIONS, INSPECTIONS AND TESTS SHALL BE PERFORMED IN / WITH CHAPTER 17 OF THE CODE AND/OR THE APPLICABLE REFERENCE STANDAR

B. OWNER REQUIREMENTS:

a. THE OWNER OR OWNER'S AGENT SHALL EMPLOY ONE OR MORE APPROVED AG PERFORM INSPECTIONS DURING CONSTRUCTION ON THE TYPES OF WORK LISTED 1705 OF THE CODE AND IN THIS STATEMENT OF INSPECTIONS.

C. SPECIAL INSPECTOR QUALIFICATIONS:

a. THE SPECIAL INSPECTIONS SHALL PROVIDE WRITTEN DOCUMENTATION TO THE BI OFFICIAL DEMONSTRATING HIS OR HER COMPETENCE AND RELEVANT EXPERIEN TRAINING. THE EXPERIENCE OR TRAINING SHALL BE CONSIDERED RELEVANT WHE DOCUMENTED EXPERIENCE OR TRAINING IS RELATED IN COMPLEXITY TO THE SAM SPECIAL INSPECTION ACTIVITIES FOR PROJECTS OF SIMILAR COMPLEXITY AND M quantities.

D. CONTRACTOR REQUIREMENTS:

- a. SPECIAL INSPECTION IS IN ADDITION TO THE CONTRACTOR'S QUALITY CONTROL AND TESTING. THE CONTRACTOR'S QUALITY CONTROL INSPECTIONS AND TESTIN OCCUR PRIOR TO SPECIAL INSPECTION AND REPORTS SHALL BE AVAILABLE TO T INSPECTOR.
- b. THE CONTRACTOR SHALL ENSURE THAT THE WORK FOR WHICH SPECIAL INSPECT REMAINS ACCESSIBLE AND EXPOSED FOR SPECIAL INSPECTION PURPOSES UNTIL OF THE REQUIRED SPECIAL INSPECTION.
- c. ANY CONTRACTOR RESPONSIBLE FOR THE CONSTRUCTION OF THE MAIN WIND FORCE RESISTING SYSTEM SHALL SUBMIT A WRITTEN STATEMENT OF RESPONSIBILI BUILDING OFFICIAL AND OWNER PRIOR TO COMMENCEMENT OF WORK ON TH COMPONENT. THE STATEMENT OF RESPONSIBILITY SHALL CONTAIN ACKNOWLED AWARENESS OF THE SPECIAL INSPECTION REQUIREMENTS CONTAINED IN THE STA SPECIAL INSPECTIONS.

E. SPECIAL INSPECTOR REPORT REQUIREMENTS:

- a. THE SPECIAL INSPECTOR SHALL KEEP RECORD OF INSPECTIONS b. THE SPECIAL INSPECTOR SHALL FURNISH INSPECTION REPORTS TO THE BUILDING (
- TO THE ARCHITECT AND STRUCTURAL ENGINEER OF RECORD. c. REPORTS SHALL INDICATE THAT WORK INSPECTED WAS OR WAS NOT COMPLETED
- CONFORMANCE TO APPROVED CONSTRUCTION DOCUMENTS. d. DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE CONT CORRECTION.
- e. IF NOT CORRECTED DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF TH OFFICIAL AND THE ARCHITECT AND STRUCTURAL ENGINEER OF RECORD PRIOR TO COMPLETION OF THAT PHASE OF WORK.
- f. A FINAL REPORT DOCUMENTING SPECIAL INSPECTIONS AND CORRECTION OF J DISCREPANCIES NOTED SHALL BE SUBMITTED TO THE BUILDING OFFICIAL.

SHOP FABRICATION

- 1. SHOP FABRICATION REQUIRES SPECIAL INSPECTION IN ACCORDANCE WITH CODE SECTION EXCEPTION: SHOP SPECIAL INSPECTIONS ARE NOT REQUIRED WHEN WORK IS DONE ON THE PR FABRICATOR REGISTERED AND APPROVED TO PERFORM SUCH WORK IN ACCORDANCE WITH SECTION 1704.2.5.1. THE FOLLOWING ACCREDITATIONS MEET THE REQUIREMENTS OF THIS EXCE A. STEEL BUILDINGS (OR STEEL ELEMENTS IN OTHER BUILDINGS)
 - a. FOR GENERAL STEEL BUILDINGS OR ELEMENTS THE FABRICATOR SHALL BE AN AISO FABRICATOR IN ACCORDANCE WITH THE AISC CERTIFICATION PROGRAM FOR S STEEL FABRICATORS (AISC 201-06).
 - OTHER ACCREDITATION DEEMED ACCEPTABLE BY THE AUTHORITY HAVING JURIS c. IF FABRICATION IS PERFORMED BY AN APPROVED FABRICATOR A CERTIFICATE C MUST BE PROVIDED TO THE BUILDING INSPECTOR THAT THE MATERIALS SUPPLIED / PERFORMED BY THE FABRICATOR ARE IN CONFORMANCE WITH THE CONSTRUCT DOCUMENTS.
 - d. IF FABRICATION IS NOT PERFORMED BY AN APPROVED FABRICATOR WELDING IN REPORTS MUST BE SUBMITTED TO THE BUILDING OFFICIAL BY AN APPROVED TESTIN d.a. NONDESTRUCTIVE TESTING (NDT) MAY BE PERFORMED BY THE FABRICATOR
 - THE QA AGENCY SHALL REVIEW THE FABRICATOR'S NDT REPORTS. B. WOOD BUILDINGS

a. PREFABRICATED WOOD TRUSSES

b. STRUCTURAL GLUED LAMINATED TIMBER

| | PRE-FABRICATED WOOD TRUSS NOTES | WOO |
|---|--|-------------------|
| 4.3 OF THE CODE . G PER SECTION | THE DESIGN OF METAL PLATE CONNECTED WOOD TRUSSES SHALL BE IN ACCORDANCE WITH THE FOLLOWING A. CODES AND STANDARDS: | 1. WOOL NOTED |
| | a. THE GOVERNING CODE LISTED IN THE PROJECT GENERAL NOTES | |
| N ACCORDANCE | b. MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES (ASCE 7-16) | |
| DARD. | NATIONAL DESIGN STANDARD FOR WOOD CONSTRUCTION AND SUPPLEMENT (ANSI/AWC NDS-2018) | USE PI |
| AGENCIES TO | d. SPECIAL DESIGN PROVISIONS FOR WIND & SEISMIC (AWC SDPWS-2021) e. THE NATIONAL DESIGN STANDARD FOR METAL PLATE CONNECTED WOOD TRUSS | ROOF |
| TED IN SECTION | CONSTRUCTION (ANSI/TPI 1-2014) B. DESIGN CRITERIA: | FLOOR 5 |
| | a. TRUSSES SHALL BE DESIGNED FOR THE FOLLOWING MINIMUM VERTICAL LOADS AND OTHER LOADS INDICATED ON THE CONSTRUCTION DOCUMENTS (ATTIC MECHANICAL UNITS, ETC.) | WALL ^D |
| | ROOF TRUSS LOADING: | TABLE |
| PIENCE OR VHEN THE SAME TYPE OF D MATERIAL | ASPHALT SHINGLE W/ GYP CEILING: TOP-CHORD DEAD LOAD: 18.6 PSF * (17.3 PSF SUPERIMPOSED) BOT CHORD DEAD LOAD: 5.9 PSF (4.6 PSF SUPERIMPOSED) ROOF - LIVE LOAD: 20 PSF | A. 1 |
| OL INSPECTIONS | DEFLECTION CRITERIA: DEAD + LIVE LOAD L/240 LIVE LOAD ONLY L/360 | В. 1 |
| STING SHALL O THE SPECIAL | *INCLUDES 4 PSF ALLOWANCE FOR PV PANELS | D. (|
| ECTION IS REQUIRED | b. (#-) EQUALS DRAG FORCE IN LBS. DRAG FORCE IS AT A FACTORED LEVEL (0.7E). DRAG FORCES | C. 1 |
| TIL COMPLETION D OR SEISMIC ILITY TO THE | CALCULATED IN ACCORDANCE WITH ASCE 7-16 12.10.1.1. IN STRUCTURES ENTIRELY BRACED BY LIGHT FRAME SHEAR WALLS, OR PORTIONS THEREOF, DRAG MEMBERS SHALL BE DESIGNED TO RESIST FORCES USING THE LOAD COMBINATIONS OF ASCE 7-16 SECTION 12.4.2.3. IN ALL OTHER STRUCTURES DRAGS SHALL INCLUDE THE EFFECT OF OVER STRENGTH PER ASCE 7-16 12.4.3.2. THE | E |
| THE SYSTEM OR LEDGEMENT OF STATEMENT OF | TRUSS DESIGNER SHALL DESIGN FOR THE TRUSSES FOR THE INDICATED HORIZONTAL LOAD ACTING IN BOTH THE TOP AND BOTTOM TRUSS CHORDS AND FOR THE TRANSFER OF THE FORCE TO THE CHORDS THROUGH THE WEB. | D. (|
| | CONTRACTOR REQUIREMENTS: A. THE CONTRACTOR SHALL MEET ALL THE REQUIREMENTS LISTED IN SECTION 2.3.4 OF ANSI/TPI 1-2014 INCLUDING THE FOLLOWING: | 2. TRANS |
| IG OFFICIAL AND ETED IN | a. MEANS AND METHODS: THE CONTRACTOR IS RESPONSIBLE FOR ALL MEANS AND METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, PROGRAMS AND SAFETY IN CONNECTION WITH THE RECEIPT, STORAGE, HANDLING, INSTALLATION, RESTRAINING, AND BRACING OF THE TRUSSES. REFER TO THE GUIDE TO GOOD PRACTICE FOR HANDLING, INSTALLING, RESTRAINING & | A B S |
| | BRACING OF METAL PLATE CONNECTED WOOD TRUSSES (BCSI-B1) | |
| ONTRACTOR FOR | b. TRUSS INSTALLATION SHALL COMPLY WITH INSTALLATION TOLERANCES SHOWN IN BCSI-B1 c. TEMPORARY INSTALLATION RESTRAINT/BRACING FOR THE TRUSS SYSTEM AND THE PERMANENT | |
| of the Building Or to the | TRUSS SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH BCSI-B2. d. CONSTRUCTION LOADING ON TRUSSES SHALL BE DONE IN ACCORDANCE WITH BCSI-B4. | |
| FANY | e. TRUSS DAMAGE, JOBSITE MODIFICATIONS & INSTALLATION ERRORS SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE EOR AND THE TRUSS DESIGNER, REFERENCE BCSI-B5. | |
| √ 1704.2.5. | f. SUBMIT THE DRAWINGS FROM THE TRUSS DESIGNER/MANUFACTURER TO THE BUILDING DEPARTMENT PRIOR TO FABRICATION FOR APPROVAL. A COPY OF THIS SUBMITTAL SHALL BE PROVIDED TO TEH ENGINEER OF RECORD FOR REVIEW OF GENERAL CONFORMANCE TO THE DESIGN INTENT. THE CONTRACTOR SHALL INCORPORATE THE TIME REQUIRED FOR THE SUBMITTAL TO BE REVIEWED, STAMPED AND APPROVED BY ALL PARTIES AND SHALL HAVE THE APPROVED TRUSS PLANS ON THE JOB SITE PRIOR TO FOUNDATION INSPECTION. | C. 1 |
| PREMISES OF ITH CODE XCEPTION: | TRUSS DESIGNER REQUIREMENTS: A. THE TRUSS DESIGNER SHALL MEET ALL THE REQUIREMENTS LISTED IN SECTION 2.3.5 OF ANSI/TPI 1-2014 INCLUDING THE FOLLOWING: | |
| AISC CERTIFIED DR STRUCTURAL | a. TRUSS DESIGNER SHALL SUPERVISE THE PREPARATION OF THE TRUSS DESIGN DRAWINGS WHICH SHALL CONTAIN THE INFORMATION LISTED IN SECTION 2.3.5.5 OF ANSI/TPI 1-2014. THIS INCLUDES ALL TRUSS TO TRUSS CONNECTIONS, AND DETAILS FOR THE "CALIFORNIA FILL" AREAS. | 3. PLYWC |
| JRISDICTION. | b. TRUSS DESIGNER SHALL COMPLY WITH THE REFERENCED CODE AND DESIGN CRITERIA ABOVE. | A. I |
| E OF COMPLIANCE ED AND WORK JCTION | C. TRUSS DESIGNER SHALL SHOW ALL HANGERS, BRACING AND RESTRAINTS AS WELL AS METHOD OF RESTRAINT/BRACING ON THE TRUSS PLANS TO MEET ANY SEISMIC AND WIND REQUIREMENTS OF THE CODE. | E |
| G INSPECTION ISTING AGENCY. ITOR, HOWEVER | d. SUBMIT TRUSS DESIGN DRAWINGS INCLUDING ALL RELEVANT DETAILS FOR THE FABRICATION OF THE TRUSSES AND PREPARE CALCULATIONS. ALL PLANS, DETAILS AND CALCULATIONS FOR THE TRUSSES SHALL BE STAMPED AND SIGNED BY A LICENSED PROFESSIONAL ENGINEER (CIVIL OR STRUCTURAL), LICENSED TO PRACTICE IN THE STATE OF CALIFORNIA. | B. F |
| | | 4. BLOCK |

DOD STRUCTURAL PANELS (SHEATHING)

IOD STRUCTURAL PANELS SHALL MEET THE FOLLOWING MINIMUM STANDARDS EXCEPT WHERE OTHERWISE

| WOOD STRUCTURAL PANEL PROPERTIES | | | | | | | |
|----------------------------------|-----|-------------------------------------|--|-----------------------|-------------|---------------------|-----------------------------|
| USE | PLY | BOND CLASSIFICATION ^C | Sheathing Grade | PERFORMANCE RATING | SPAN RATING | RATING ^B | REFERENCE ^A |
| ROOF | 5 | EXPOSURE 1 | | | | 2022 CBC | |
| FLOOR | 5 | EXPOSURE 1 | | | | | (DOC PS 1-19 OR PS 2-18) |
| WALL D | 5 | EXPOSURE 1 | REFER TO TYPICAL SHEAR WALL SCHEDULE APA | | | | |
| TARI F NOTES: | | | | | | | |

WOOD STRUCTURAL PANELS SHALL CONFORM TO THE REQUIREMENTS FOR THEIR TYPE IN ACCORDANCE WITH THE FOLLOWING VOLUNTARY STANDARDS BY THE ENGINEERED WOOD ASSOCIATION (APA):

- a. VOLUNTARY PRODUCT STANDARD, STRUCTURAL PLYWOOD, PS 1-09
- b. VOLUNTARY PRODUCT STANDARD, PERFORMANCE STANDARD FOR WOOD-BASED

STRUCTURAL-USE PANELS, PS 2-10

- WOOD STRUCTURAL PANELS SHALL BE IDENTIFIED BY THE APA TRADEMARK INDICATING CONFORMANCE TO THE APPLICABLE VOLUNTARY STANDARD
- WHERE PANELS ARE EXPOSED TO REPEATED WETTING AND REDRYING, LONG-TERM EXPOSURE TO WEATHER, OR CONDTIONS OF SIMILAR SEVERITY, "EXTERIOR" APA RATED PLYWOOD SHEATHING SHALL BE USED. C-D "EXPOSURE 1" APA RATED PLYWOOD SHEATHING (CDX) SHALL NOT BE USED FOR CONDITIONS INVOLVING LONG-TERM EXPOSURE TO WEATHER.
- a. EXCEPTION: WOOD STRUCTURAL PANEL ROOF SHEATHING EXPOSED TO THE OUTDOORS ON THE
- UNDERSIDE IS PERMITTED TO BE "EXPOSURE 1" TYPE.
- b. WOOD STRUCTURAL PANELS TO BE USED AS SIDING SHALL COMPLY WITH ANSI/APA PRP-210. ORIENTED STRAND BOARD (OSB) WITH EQUIVALENT CLASSIFICATION AND RATINGS MAY BE USED IN LIEU
- OF PLYWOOD FOR WOOD STRUCTURAL PANEL WALL SHEATHING.
- NSPORTATION, STORAGE, AND HANDLING:
- TRANSPORTATION a. IN TRANSPORTING PANELS ON OPEN TRUCK BEDS, COVER THE BUNDLES WITH A TARP.

STORAGE

- a. ALWAYS STORE THE PANELS UNDER COVER WHENEVER POSSIBLE
- b. WHEN STORING PANELS OUTSIDE STACK THEM ON A LEVEL SURFACE ON TOP OF STRINGERS OR OTHER BLOCKING, THREE STRINGERS MINIMUM.
- c. NEVER LEAVE PANELS IN CONTACT WITH THE GROUND
- d. COVER THE STACK WITH A PLASTIC TARP, ENSURING THAT THE BUNDLE IS WELL VENTILATED TO PREVENT MILDEW.
- e. IF MOISTURE ABSORPTION IS EXPECTED, CUT THE STEEL BAND TO PREVENT DAMAGE
- f. KEEP SANDED OR OTHER APPEARANCE GRADE PANELS AWAY FROM HIGH TRAFFIC AREAS

HANDLING

- a. ALWAYS PROTECT ENDS AND EDGES, ESPECIALLY TONGUE AND GROOVE PRODUCTS, FROM PHYSICAL DAMAGE.
- b. ACCLIMATIZE THE PANELS FOR 24 HOURS MINIMUM BEFORE INSTALLATION BY STANDING THE PANELS ON EDGE WITH A GAP BETWEEN EACH TO ALLOW FOR AIR CIRCULATION OR PER MANUFACTURER'S RECOMMENDATIONS.
- VOOD ORIENTATION
 - ROOF AND FLOOR SHEATHING SHALL BE LAID WITH THE GRAIN OF THE OUTER PILES PERPENDICULAR TO THE FRAMING MEMBERS, SHALL BE CONTINUOUS OVER 2 JOIST BAYS MINIMUM AND END JOINTS SHALL BE JOINED OVER FRAMING AND STAGGERED. LEAVE A $\frac{1}{3}$ " GAP BETWEEN PANELS TO ALLOW FOR PANEL EXPANSION UNLESS RECOMMENDED OTHERWISE BY THE PANEL MANUF. REFER TO SPECIFIC DETAILS IN THE DRAWINGS FOR FURTHER PARAMETERS.
 - PLYWOOD OR OSB WALL SHEATHING MAY BE APPLIED VERTICALLY OR HORIZONTALLY. ALL END JOINTS BE JOINED OVER FRAMING AND STAGGERED.

DCKING:

- A. ROOF: ALL ROOF SHEATHING SHALL BE BLOCKED UNLESS SPECIFICALLY ALLOWED ON PLANS. WHERE PERMITTED TO BE UNBLOCKED, ALL UNBLOCKED EDGES SHALL BE TONGUE AND GROOVE.
- B. ALL FLOOR SHEATHING SHALL BE BLOCKED UNLESS SPECIFICALLY ALLOWED ON PLANS. WHERE PERMITTED TO BE UNBLOCKED, ALL UNBLOCKED EDGES SHALL BE TONGUE AND GROOVE.
- C. WALLS: ALL SHEAR WALLS SHALL BE FULLY BLOCKED AT PLYWOOD EDGES.
- 5. FASTENERS
- A. USE SHEATHING NAILS SAME GAUGE AS COMMON WIRE NAILS WITH LENGTHS AT LEAST EQUAL TO SHEATHING THICKNESS PLUS REQUIRED PENETRATION PER AWS SDPWS TABLE 4.2A OR 4.3A (AS REQUIRED).
- B. EQUIVALENT PNEUMATIC DRIVE NAILS MAY BE USED IF FASTENER MANUFACTURER HAS RECEIVED ICC OR IAPMO APPROVAL FOR THE INTENDED US. FASTENERS TO BE SUBSTITUTED SHALL BE EQUIVALENT IN LATERAL AND WITHDRAWAL STRENGTH TO THE SIZE OF COMMON NAIL SPECIFIED.
- C. USE OF MACHINE NAILING IS SUBJECT TO A SATISFACTORY JOB SITE DEMONSTRATION FOR EACH PROJECT AND THE APPROVAL BY THE PROJECT ARCHITECT OR STRUCTURAL ENGINEER. THE APPROVAL IS SUBJECT TO CONTINUED SATISFACTORY PERFORMANCE. MACHINE NAILING WILL NOT BE APPROVED IN 5/16" PLYWOOD OR OSB SHEATHING. IF NAIL HEADS PENETRATE THE OUTER PLY MORE T HAN WOULD BE NORMAL FOR A HAND HAMMER OR IF MINIMUM ALLOWABLE EDGE DISTANCES ARE NOT MAINTAINED, THE PERFORMANCE WILL BE DEEMED UNSATISFACTORY.
- D. TYPICAL NAILING SHALL BE 10d AT 6" O.C. AT ALL SUPPORTED EDGES AND OVER SHEAR WALLS, AND 10D AT 12" O.C. AT ALL INTERMEDIATE SUPPORTS, UNLESS OTHERWISE NOTED, SEE PLANS AND REFER TO SHEAR WALL SCHEDULE.

| NWA2 | LUMBER |
|---------|---------|
| 0/ 1/11 | LOWIDER |

FRAMING LUMBER SHALL MEET THE FOLLOWING MINIMUM STANDARDS EXCEPT WHERE OTHERWISE NOTED:

| | SAWN LUMBER | R PROPER | TIES | |
|--------------------------|--------------------|-------------|--|----------------------|
| USE | SIZE | SPECIES | GRADE | REFERENCE |
| | 2x4 | D.F. | STANDARD OR BETTER PRESSURE TREATED | 2022 CBC 2303.1.9 |
| MUDSILLS | 2x6 AND LARGER | D.F. | NO. 2 OR BETTER PRESSURE TREATED | |
| | 2x | REDWOOD | FOUNDATION GRADE | |
| | HORIZONTAL FR | AMING LUMBE | R | 4 |
| ROOF JOISTS AND RAFTERS | 2x | D.F. | NO. 2 | |
| FLOOR JOISTS | 2x | D.F. | NO. 2 | WCLIB & WWPA |
| HEADERS AND BEAMS | 4x | D.F. | NO. 2 | |
| | 4x4 AND SMALLER | D.F. | NO. 2 | |
| ANY OTHER HORIZONTAL | 6x6 AND LARGER | D.F. | NO. 1 | |
| | VERTICAL FRA | MING LUMBER | | |
| TOP PLATES | 2x | D.F. | NO. 2 | |
| STUDS | 2x4 & 3x4 | D.F. | STUD | WCLIB & WWPA |
| 310D3 | 2x6 & 2x8 | D.F. | NO. 2 | |
| POSTS | 4x4 & 4x6 POSTS | D.F. | NO. 2 | |
| | 6x6 & LARGER POSTS | D.F. | NO. 1 | |
| | ALL OTHER FRA | AMING LUMBE | ? | |
| ALL OTHER FRAMING LUMBER | ALL SIZES | D.F. | STANDARD & BETTER | WCLIB & WWPA |

- 2. FLOOR JOISTS SHALL BE GRADE STAMPED "S-DRY" WHICH INDICATES A MOISTURE CONTENT NOT EXCEEDING 19 PERCENT.
- 3. ALL SOLE PLATES AND TOP PLATES SHALL BE GRADE STAMPED "KD" WHICH INDICATES KILN DRIED WITH A MOISTURE CONTENT NOT EXCEEDING 15 PERCENT AT BUILDINGS WITH 4 OR MORE STORIES.
- 4. STUD WALLS SHOWN ON PLANS ARE NONBEARING PARTITIONS WALLS, BEARING WALLS OR SHEAR WALLS BELOW THE FRAMING LEVEL, UNLESS NOTED OTHERWISE. STUDS SHALL BE SIZE AND SPACING AS NOTED IN THE DRAWINGS, SEE PLANS AND ARCHITECTURAL DRAWINGS. UNLESS OTHERWISE NOTED.
- 5. MINIMUM FRAMING NAILING SHALL CONFORM TO CBC TABLE 2304.10.2. ALL NAILS SHALL BE COMMON WIRE NAILS. PREDRILL NAIL HOLES TO 70% OF NAIL SHANK DIAMETER WHERE NAILING TENDS TO SPILT WOOD.
- 6. UNLESS OTHERWISE NOTED, ALL WOOD SILL PLATES UNDER BEARING, EXTERIOR, OR SHEAR WALLS IN CONTACT WITH CONCRETE OR MASONRY SHALL BE BOLTED TO THE CONCRETE OR MASONRY WITH 5/8" Ø X 12" BOLTS W/ 0.229" X 3" X 3" PLATE WASHER (GALV) AT 4'-O" O.C. BEGINNING AT 9" O.C. MAXIMUM FROM EACH END OF THE PLATES. THE BOLTS SHALL EXTEND A MINIMUM OF 7" INTO THE CONCRETE OR MASONRY. (POWDER DRIVEN PINS AT 1/3 OF THE BOLT SPACING OR 24" O.C. MAXIMUM MAY BE SUBSTITUTED FOR THE ANCHOR BOLTS AT INTERIOR NON-SHEAR WALLS ONLY).
- 7. PRESERVATIVE TREATMENT:
- A. WOOD MEMBERS SHALL BE PRESERVATIVE TREATED IN ACCORDANCE WITH AITC 109-07, STANDARD FOR PRESERVATIVE TREATMENT, BASED ON THE SERVICE CONDITION PER THE USE CATEGORIES (UC#) SPECIFIED IN AWPA U1-20.
- a. UC1 INTERIOR CONSTRUCTION, ABOVE GROUND, DRY NO PRESERVATIVE TREATMENT REQUIRED. b. UC2 - INTERIOR CONSTRUCTION, ABOVE GROUND, WET - PRESERVATIVE TREATMENT REQUIRED IF THE HUMIDITY OR MOISTURE CONDENSATION IS 20% OR GREATER. c. UC3 - EXTERIOR CONSTRUCTION ABOVE GROUND - PRESERVATIVE TREATMENT REQUIRED.
- B. FOR ALL TREATED WOOD MEMBERS, ALL CUTS, HOLES OR INJURIES SUCH AS ABRASIONS OR HOLES FROM REMOVAL NAILS AND SPIKES WHICH MAY PENETRATE THE TREATED ZONE SHALL BE FIELD TREATED IN
- ACCORDANCE WITH AWPA M4-15. THE FOLLOWING FILED TREATMENTS SHALL BE USED: a. BORED HOLES: HOLES FOR CONNECTORS OR BOLTS MAY BE TREATED BY PUMPING COAL TAR ROOFING CEMENT MEETING ASTM D5643 INTO HOLES USING A GREASE GUN OR SIMILAR DEVICE.
- b. EXTERIOR: COPPER NAPHTHENATE. c. INTERIOR: INORGANIC BORON PRESERVATIVES LIMITED TO USE IN APPLICATIONS NOT IN CONTACT WITH GROUND AND CONTINUOUSLY PROTECTED FROM LIQUID WATER.
- C. ALL LUMBER IN CONTACT WITH CONCRETE SHALL BE PRESSURE TREATED LUMBER WITH AWPA TREATMENT C2 USING EITHER ALKALINE QUAT (ACQ TYPE B AND D), COPPER AZOLE (CBA-A, CA-B), OR SODIUM BORATES (SBX). ANCHOR BOLTS, FASTENERS, AND METAL FRAMING CONNECTORS IN CONTACT WITH PRESSURE TREATED LUMBER SHALL BE HOT-DIPPED GALVANIZED TO A RATING OF G-185 PER ASTM A653.
- 8. PROVIDE 2 STUDS UNDER ALL 4 X 10 AND LARGER BEAMS OR HEADERS AT SPANS 6 FEET OR LONGER, UNLESS OTHERWISE NOTED. WHERE POSTS OR MULTIPLE STUDS UNDER BEAMS OR HEADERS ARE CALLED FOR ON DRAWINGS THOSE POSTS OR MULTIPLE STUDS SHALL BE CARRIED TO THE FOUNDATION/PODIUM LEVEL.
- 9. PROVIDE THE FOLLOWING BLOCKING AS A MINIMUM, UNLESS SHOWN OTHERWISE: 2x FULL DEPTH SOLID BLOCKING BETWEEN JOISTS OVER SUPPORT. 2x FULL DEPTH SOLID BLOCKING BETWEEN JOISTS OVER AND BELOW PARTITION WALLS.
- 10. DOUBLE JOISTS UNDER PARTITIONS RUNNING PARALLEL TO JOISTS, UNLESS SUPPORTED BY A WALL BELOW OR SHOWN OTHERWISE. NAIL DOUBLED JOISTS WITH 16d AT 12" O.C., STAGGERED.
- 11. BRIDGING SHALL BE 2 X SOLID BLOCKS, INSTALLED AS FOLLOWS: ROOF JOISTS MORE THAN 10" DEPTH, 8'-O" O.C. MAXIMUM, NOT MORE THAN 8'-0' FROM SUPPORT. FLOOR JOISTS MORE THAN 10" DEPTH, 8'-O" O.C. MAXIMUM, NOT MORE THAN 8'-O' FROM SUPPORT.
- 12. JOIST HANGERS AND OTHER METAL FRAMING ACCESSORIES ARE REFERRED TO ON PLANS BY PARTICULAR TYPE AS MANUFACTURED BY SIMPSON STRONG-TIE COMPANY, STOCKTON, CALIFORNIA. ACCESSORIES OF OTHER MANUFACTURES WITH EQUIVALENT LOAD CARRYING CHARACTERISTICS MAY BE USED WITH APPROVAL BY SEOR.
- 13. FIRE STOPPING, BACKING FOR INTERIOR FINISHES, NONBEARING WALLS, AND OTHER NON-STRUCTURAL FRAMING ARE NOT NECESSARILY SHOWN ON STRUCTURAL DRAWINGS. REFER TO ARCHITECTURAL DRAWINGS.

HARDWARE AND CONNECTORS

USE ALL SPECIFIED FASTENERS AS SPECIFIED ON PLANS. IF NOT INDICATED ON PLANS PROVIDE FASTENERS PER MFR'S APPROVED ICC-ESR REPORT OR PRODUCT LITERATURE

- 1. DO NOT OVER TIGHTEN NUTS ON TIE-DOWN ANCHOR RODS OR BOLTS. TIGHTEN ANCHOR ROD NUTS ONE-THIRD TO ONE HALF TURN BEYOND FINGER TIGHT 2. INSTALL ALL HOLDOWNS TIGHT TO END STUDS/POST, DO NOT USE FILLER BLOCKS. FOR MISALIGNED ANCHOR
- BOLTS, EXTEND THE ANCHOR ROD AT A 1:6 (HORIZ/VERT) USING A COUPLER WITH EQUIVALENT ANCHOR ROD AND INSTALL THE HOLDOWN HIGHER ON END STUD / POST 3. FOR HOLDOWNS THAT BOLT TO END POSTS, INSTALL THE HEAD OF THE BOLT TO THE BRACKET SIDE, AND ON THE SIDE OPPOSITE THE BRACKET, INSTALL A WASHER BETWEEN THE NUT AND THE STUD / POSTS
- TIE DOWN & COLLECTOR STRAPS
- TIE DOWN AND COLLECTOR STRAPS SHALL BE INSTALLED STRAIGHT AND TRUE. DO NOT FOLD, BEND, KINK OR OTHERWISE ALTER CONNECTOR STRAPS
- 2. INSTALL TIE DOWN STRAPS DIRECT TO POST IN LIEU OF OVER SHEATHING. STRAPS MAY BE INSTALLED ON THE UNSHEATHED SIDE OF THE END STUDS / POSTS



THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

A S ▶ ┗ CIT OTY **2 –** ́ш **m** O ≥ > **∞** ⊣ Ū Ā E ()

С Ш ┣---S S S L NOTE CTION , GENERAL IAL INSPEC П П

Δ

 \sim

S


DATE

01/03/2024 SHEET

Ш


 \sim

UBL

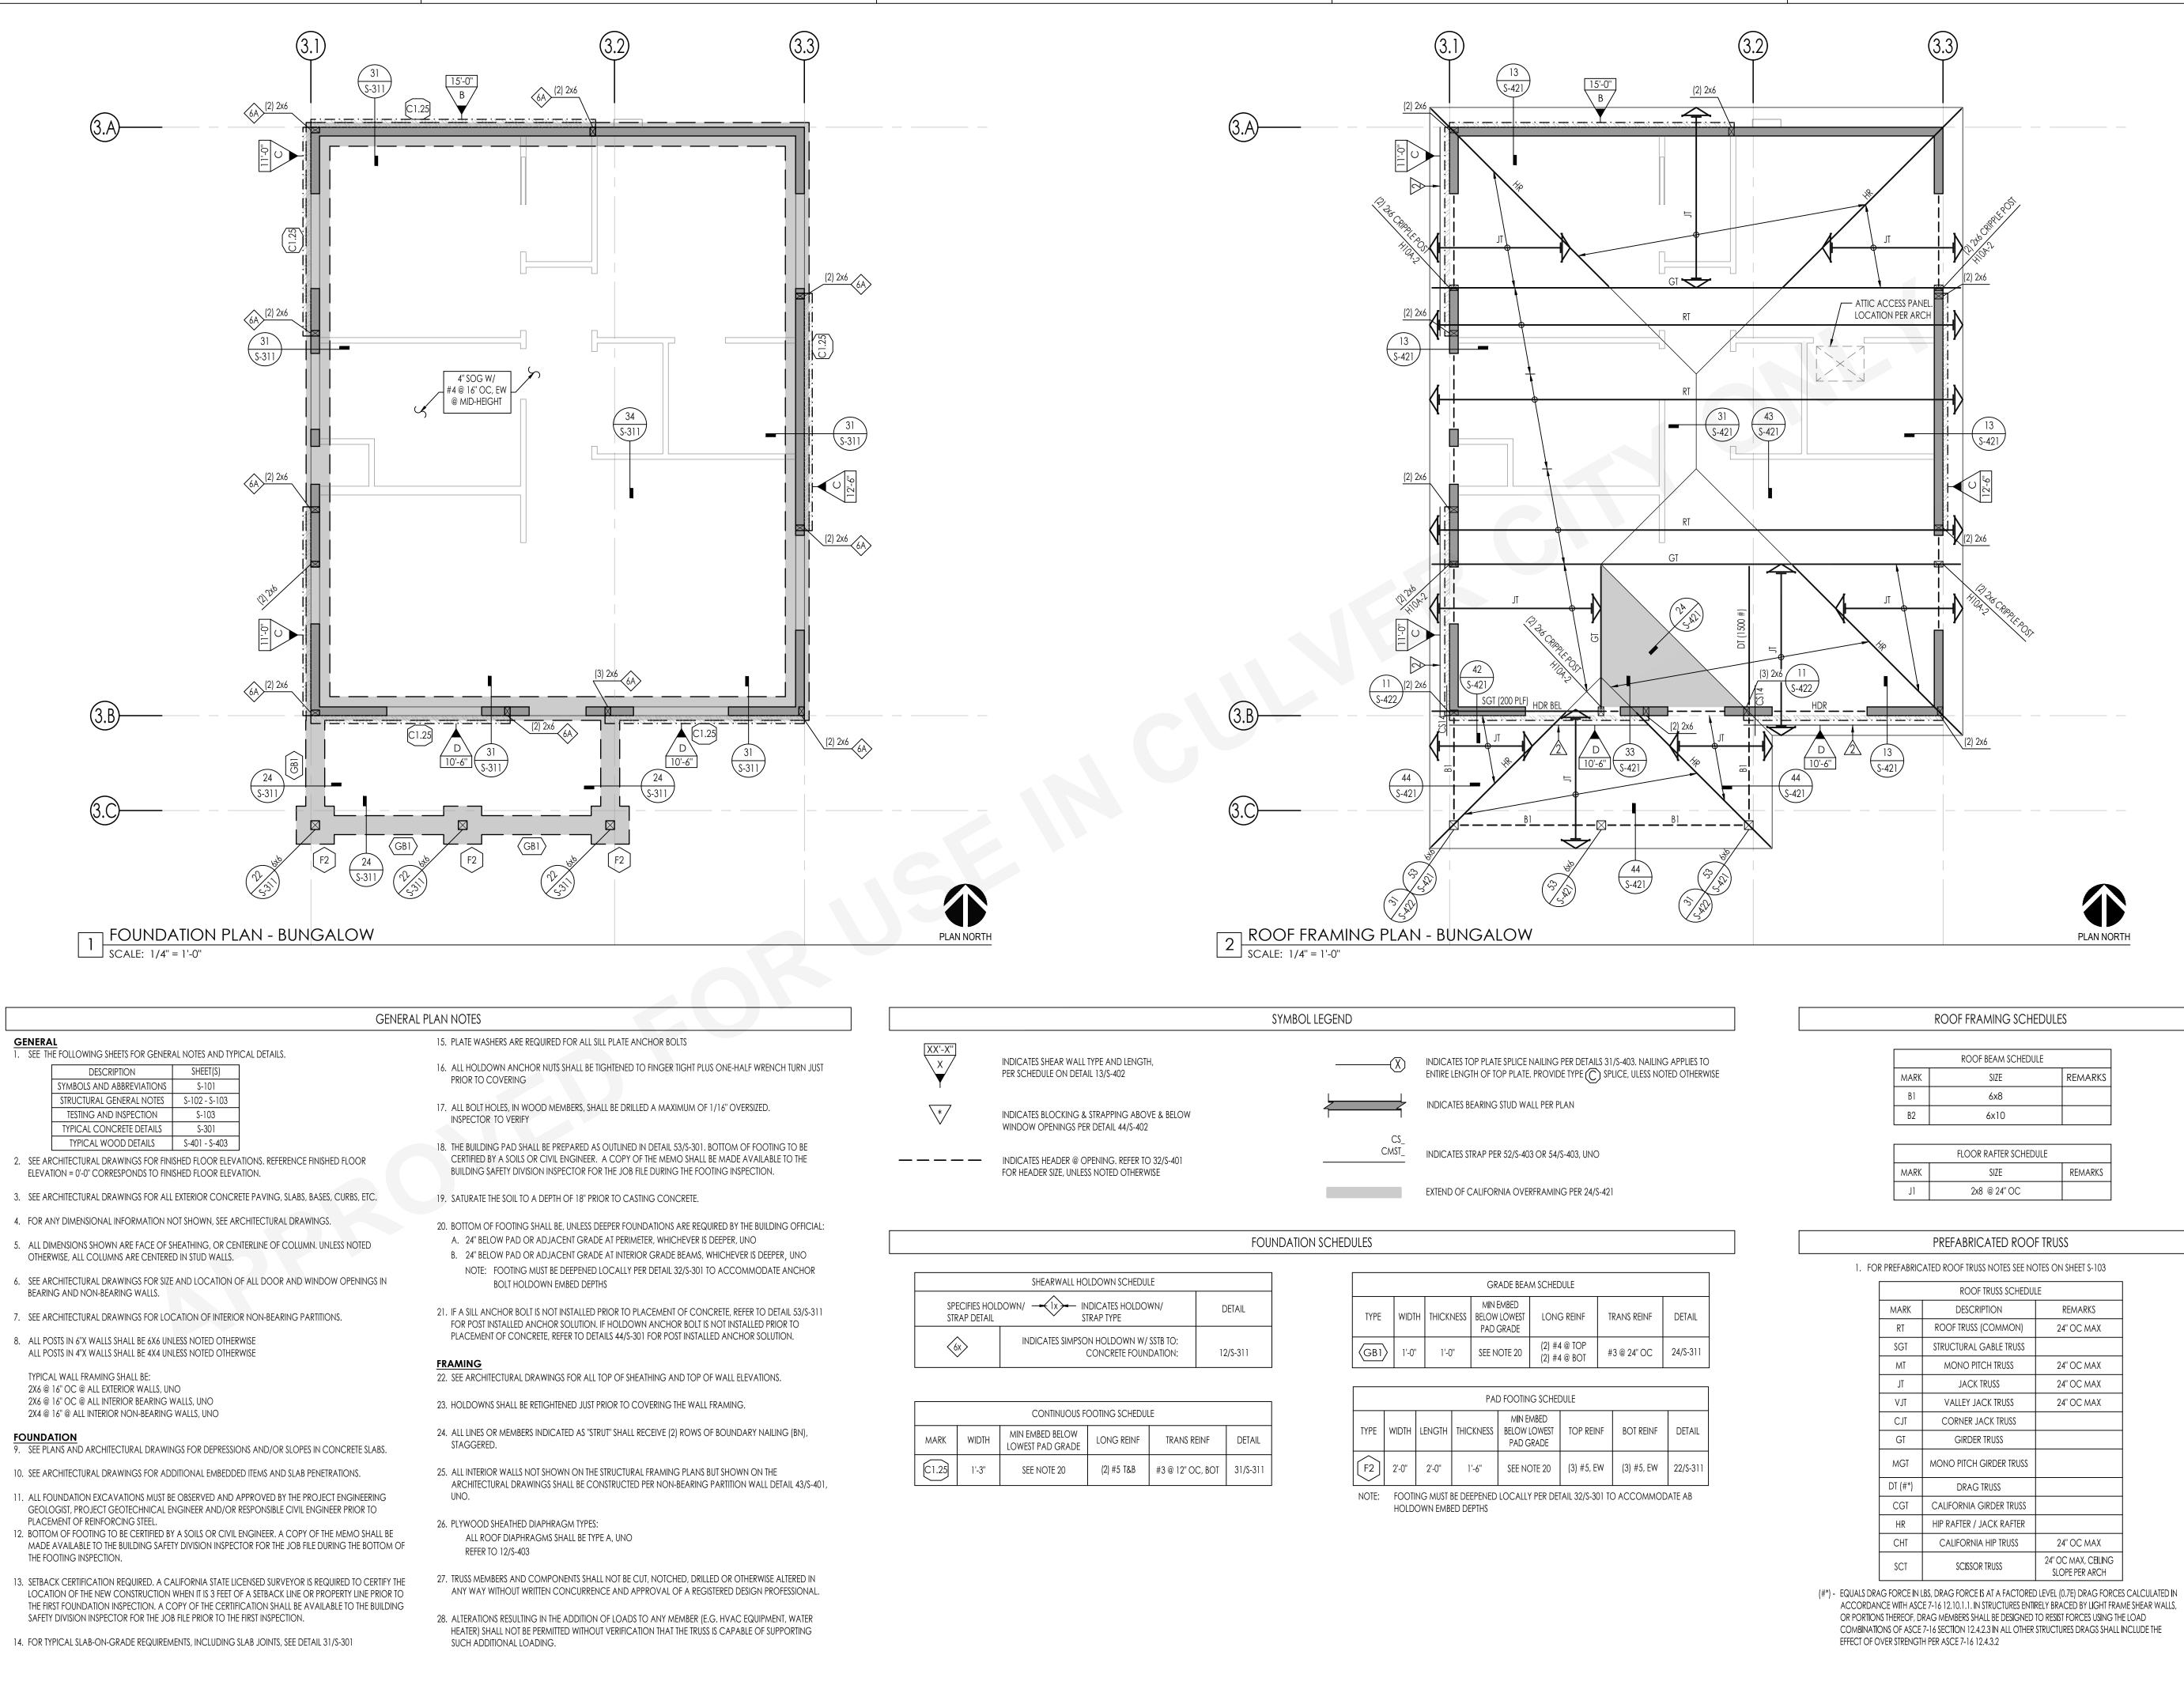


| | ROOF TRUSS SCHEDU | LE |
|---------|--------------------------|---------------------------------------|
| MARK | DESCRIPTION | REMARKS |
| RT | ROOF TRUSS (COMMON) | 24" OC MAX |
| SGT | STRUCTURAL GABLE TRUSS | |
| MT | MONO PITCH TRUSS | 24" OC MAX |
| JT | JACK TRUSS | 24" OC MAX |
| VJT | VALLEY JACK TRUSS | 24" OC MAX |
| CJT | CORNER JACK TRUSS | |
| GT | GIRDER TRUSS | |
| MGT | MONO PITCH GIRDER TRUSS | |
| DT (#*) | DRAG TRUSS | |
| CGT | CALIFORNIA GIRDER TRUSS | |
| HR | HIP RAFTER / JACK RAFTER | |
| CHT | CALIFORNIA HIP TRUSS | 24" OC MAX |
| SCT | SCISSOR TRUSS | 24" OC MAX, CEILINC SLOPE PER ARCH |

ACCORDANCE WITH ASCE 7-16 12.10.1.1. IN STRUCTURES ENTIRELY BRACED BY LIGHT FRAME SHEAR WALLS,

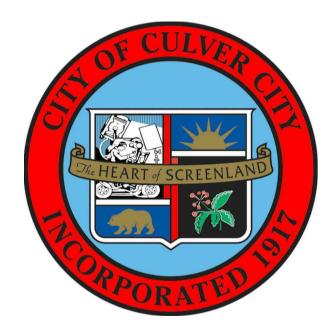

THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

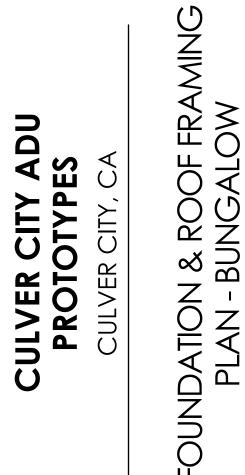

DU

Ū

DATE 01/03/2024


Ш


S

()

UBL

SHEET



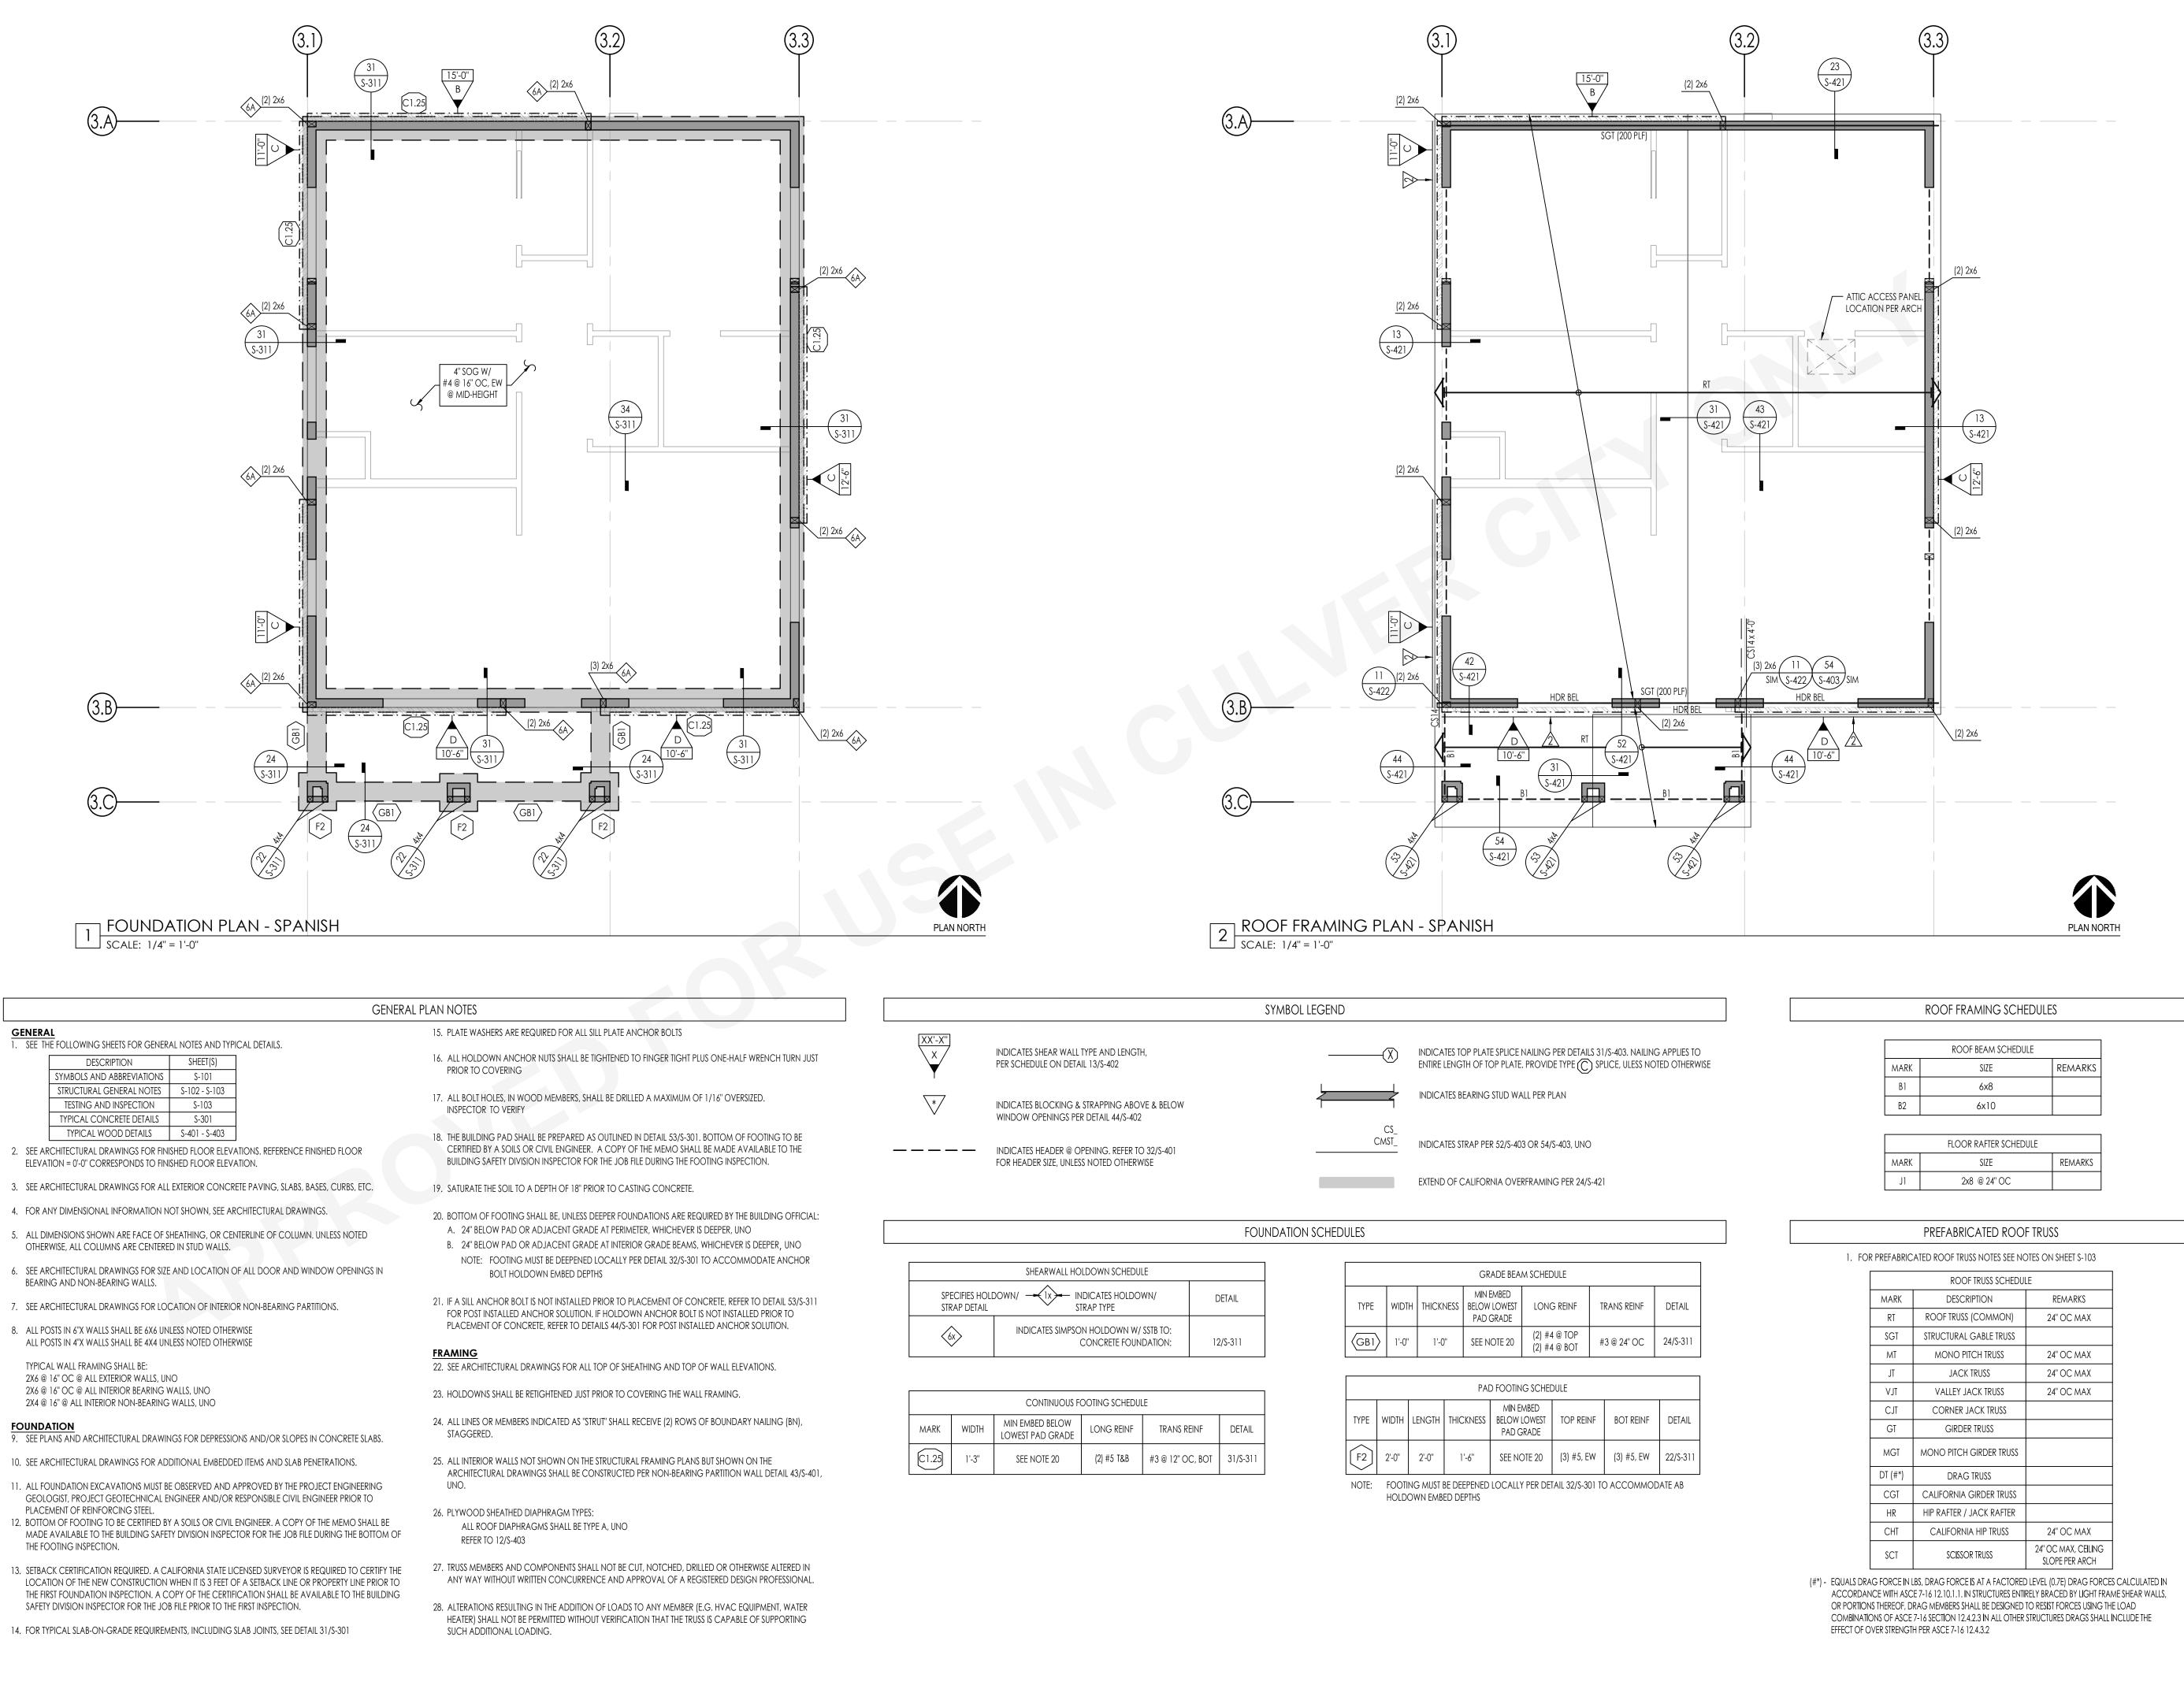

THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

> AMINC Я Н NISI NISI **A S** CITY OTYP sP, oo i ER **2 –** PLAN PROI CULVE OUND/

U

()


DATE

S

UBL

01/03/2024 SHEET

3-21

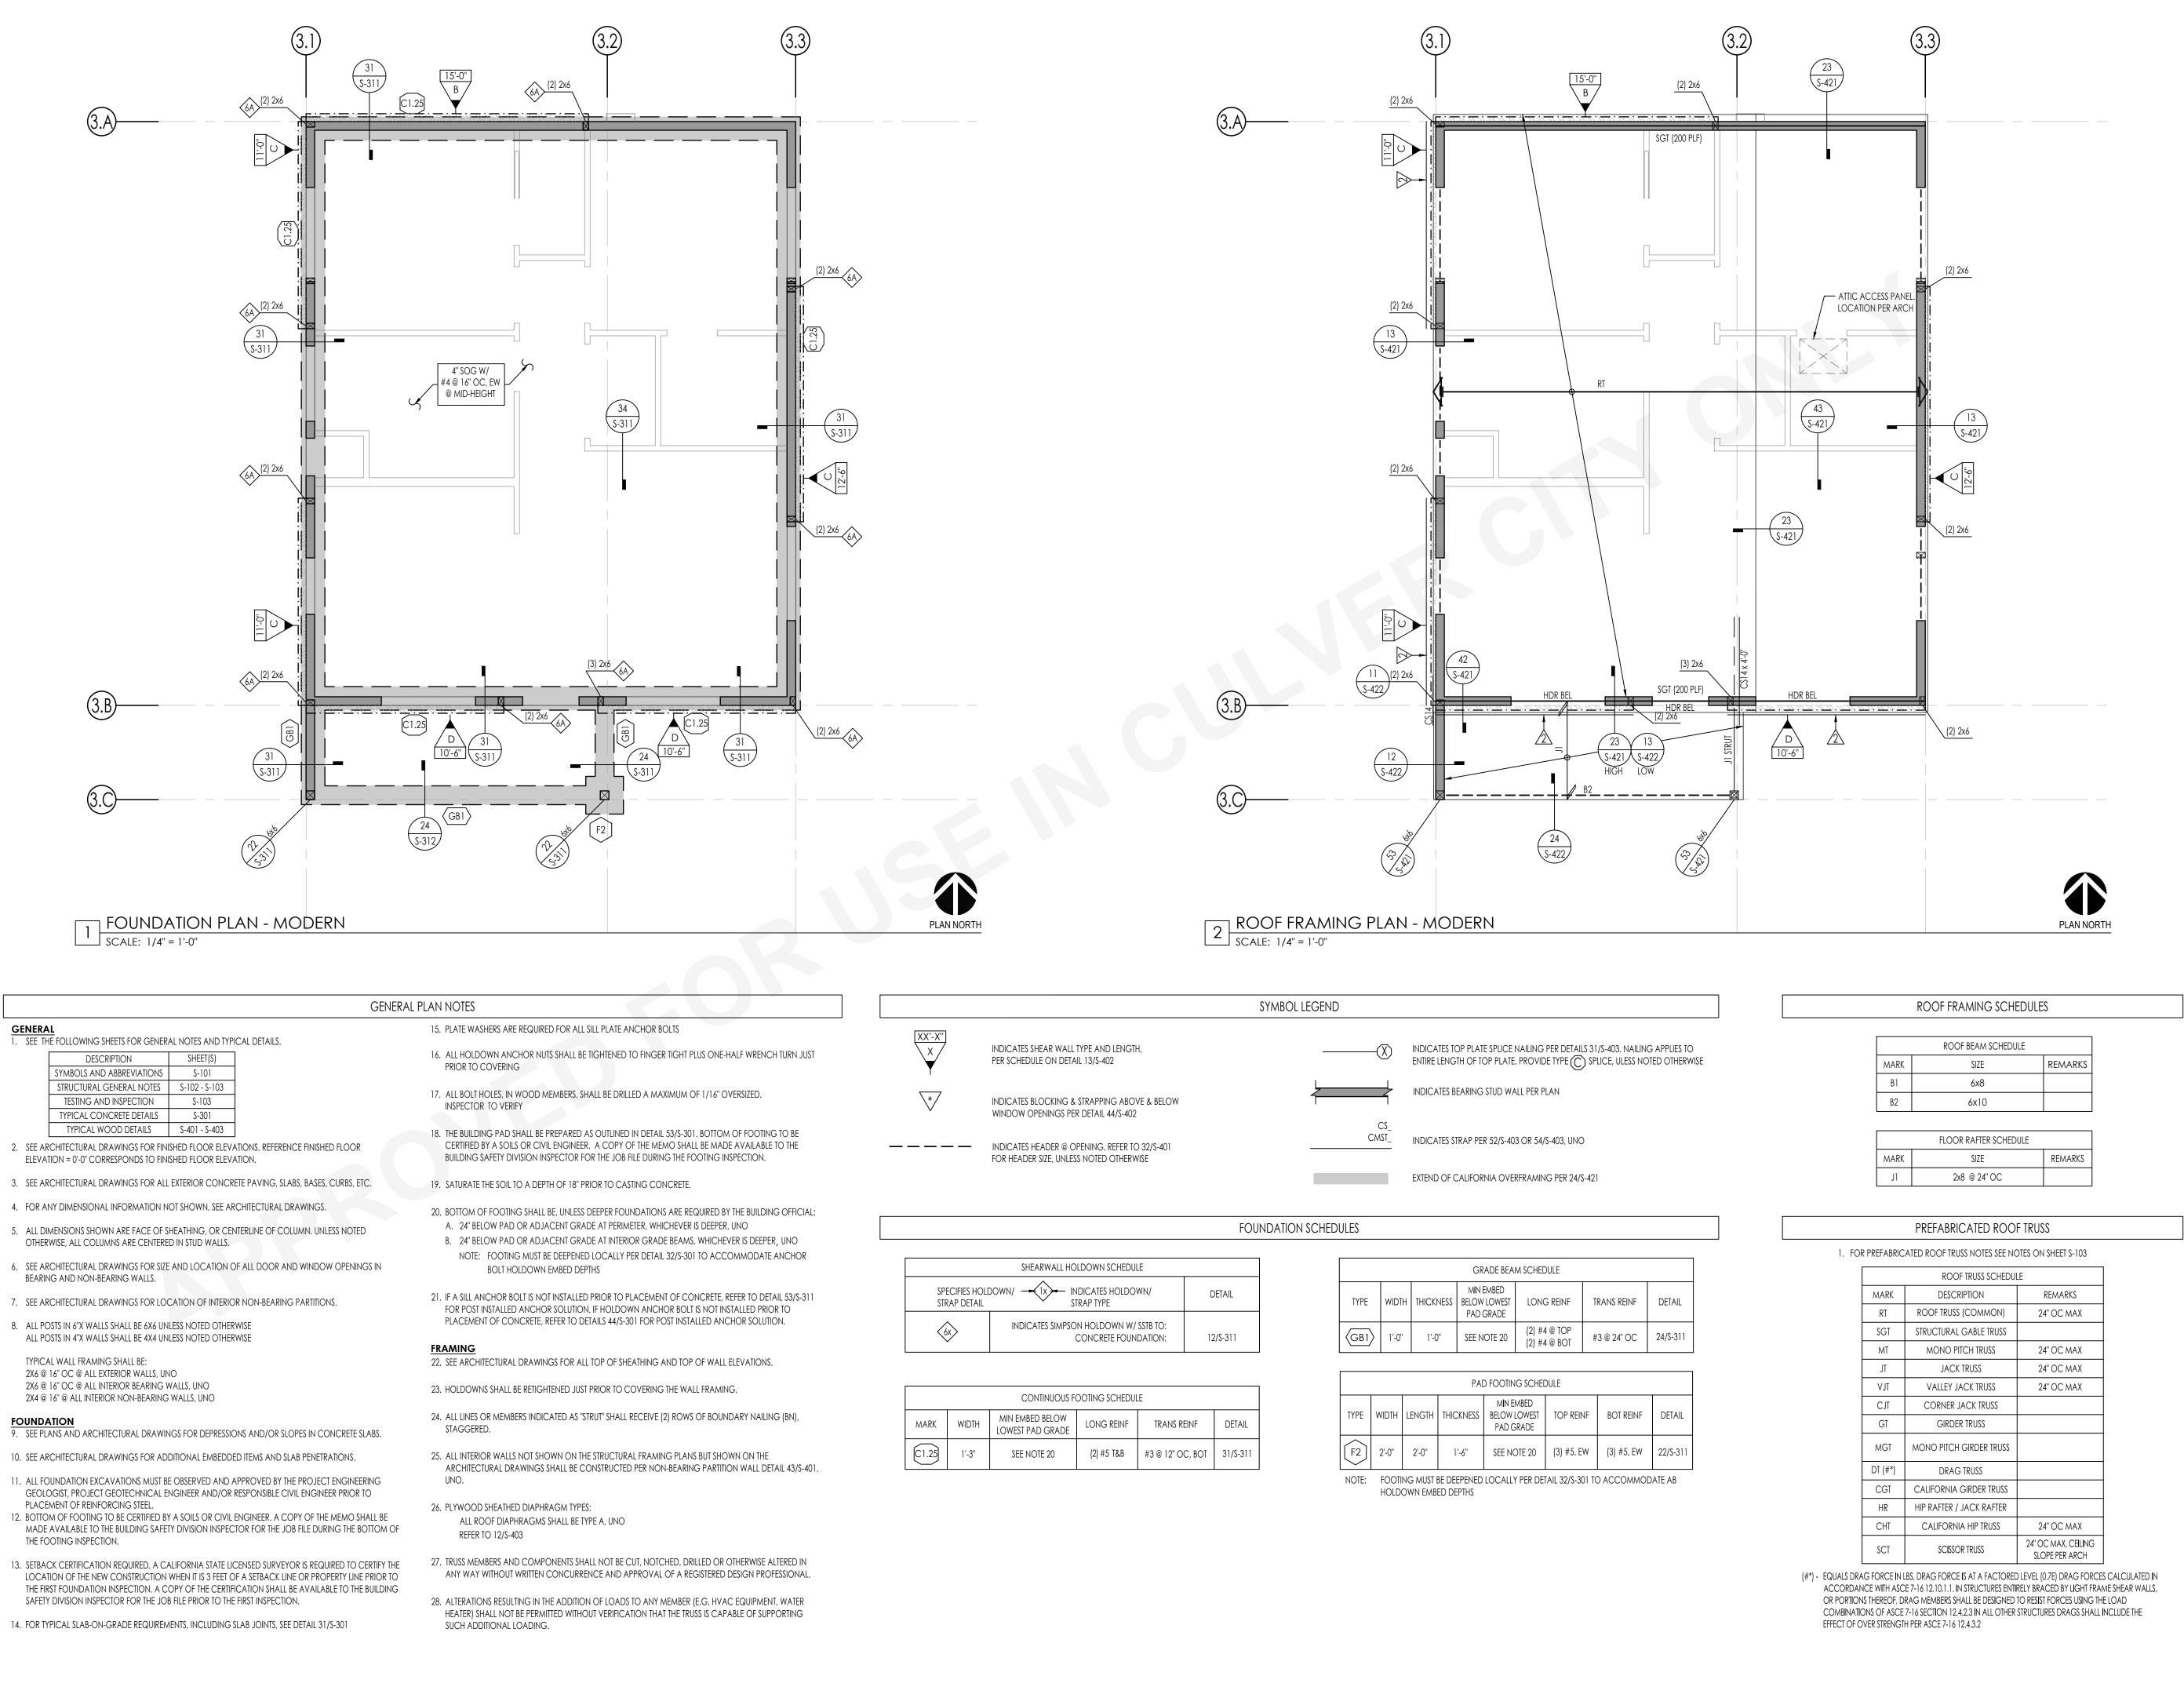



THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

> DNIM OF FR, DERN **A S** CITY OTYP ∞ ' ER **2 –** PLAN. PROI CULVE OUND/

U

()


DATE 01/03/2024


Ш

S


UBL

SHEET



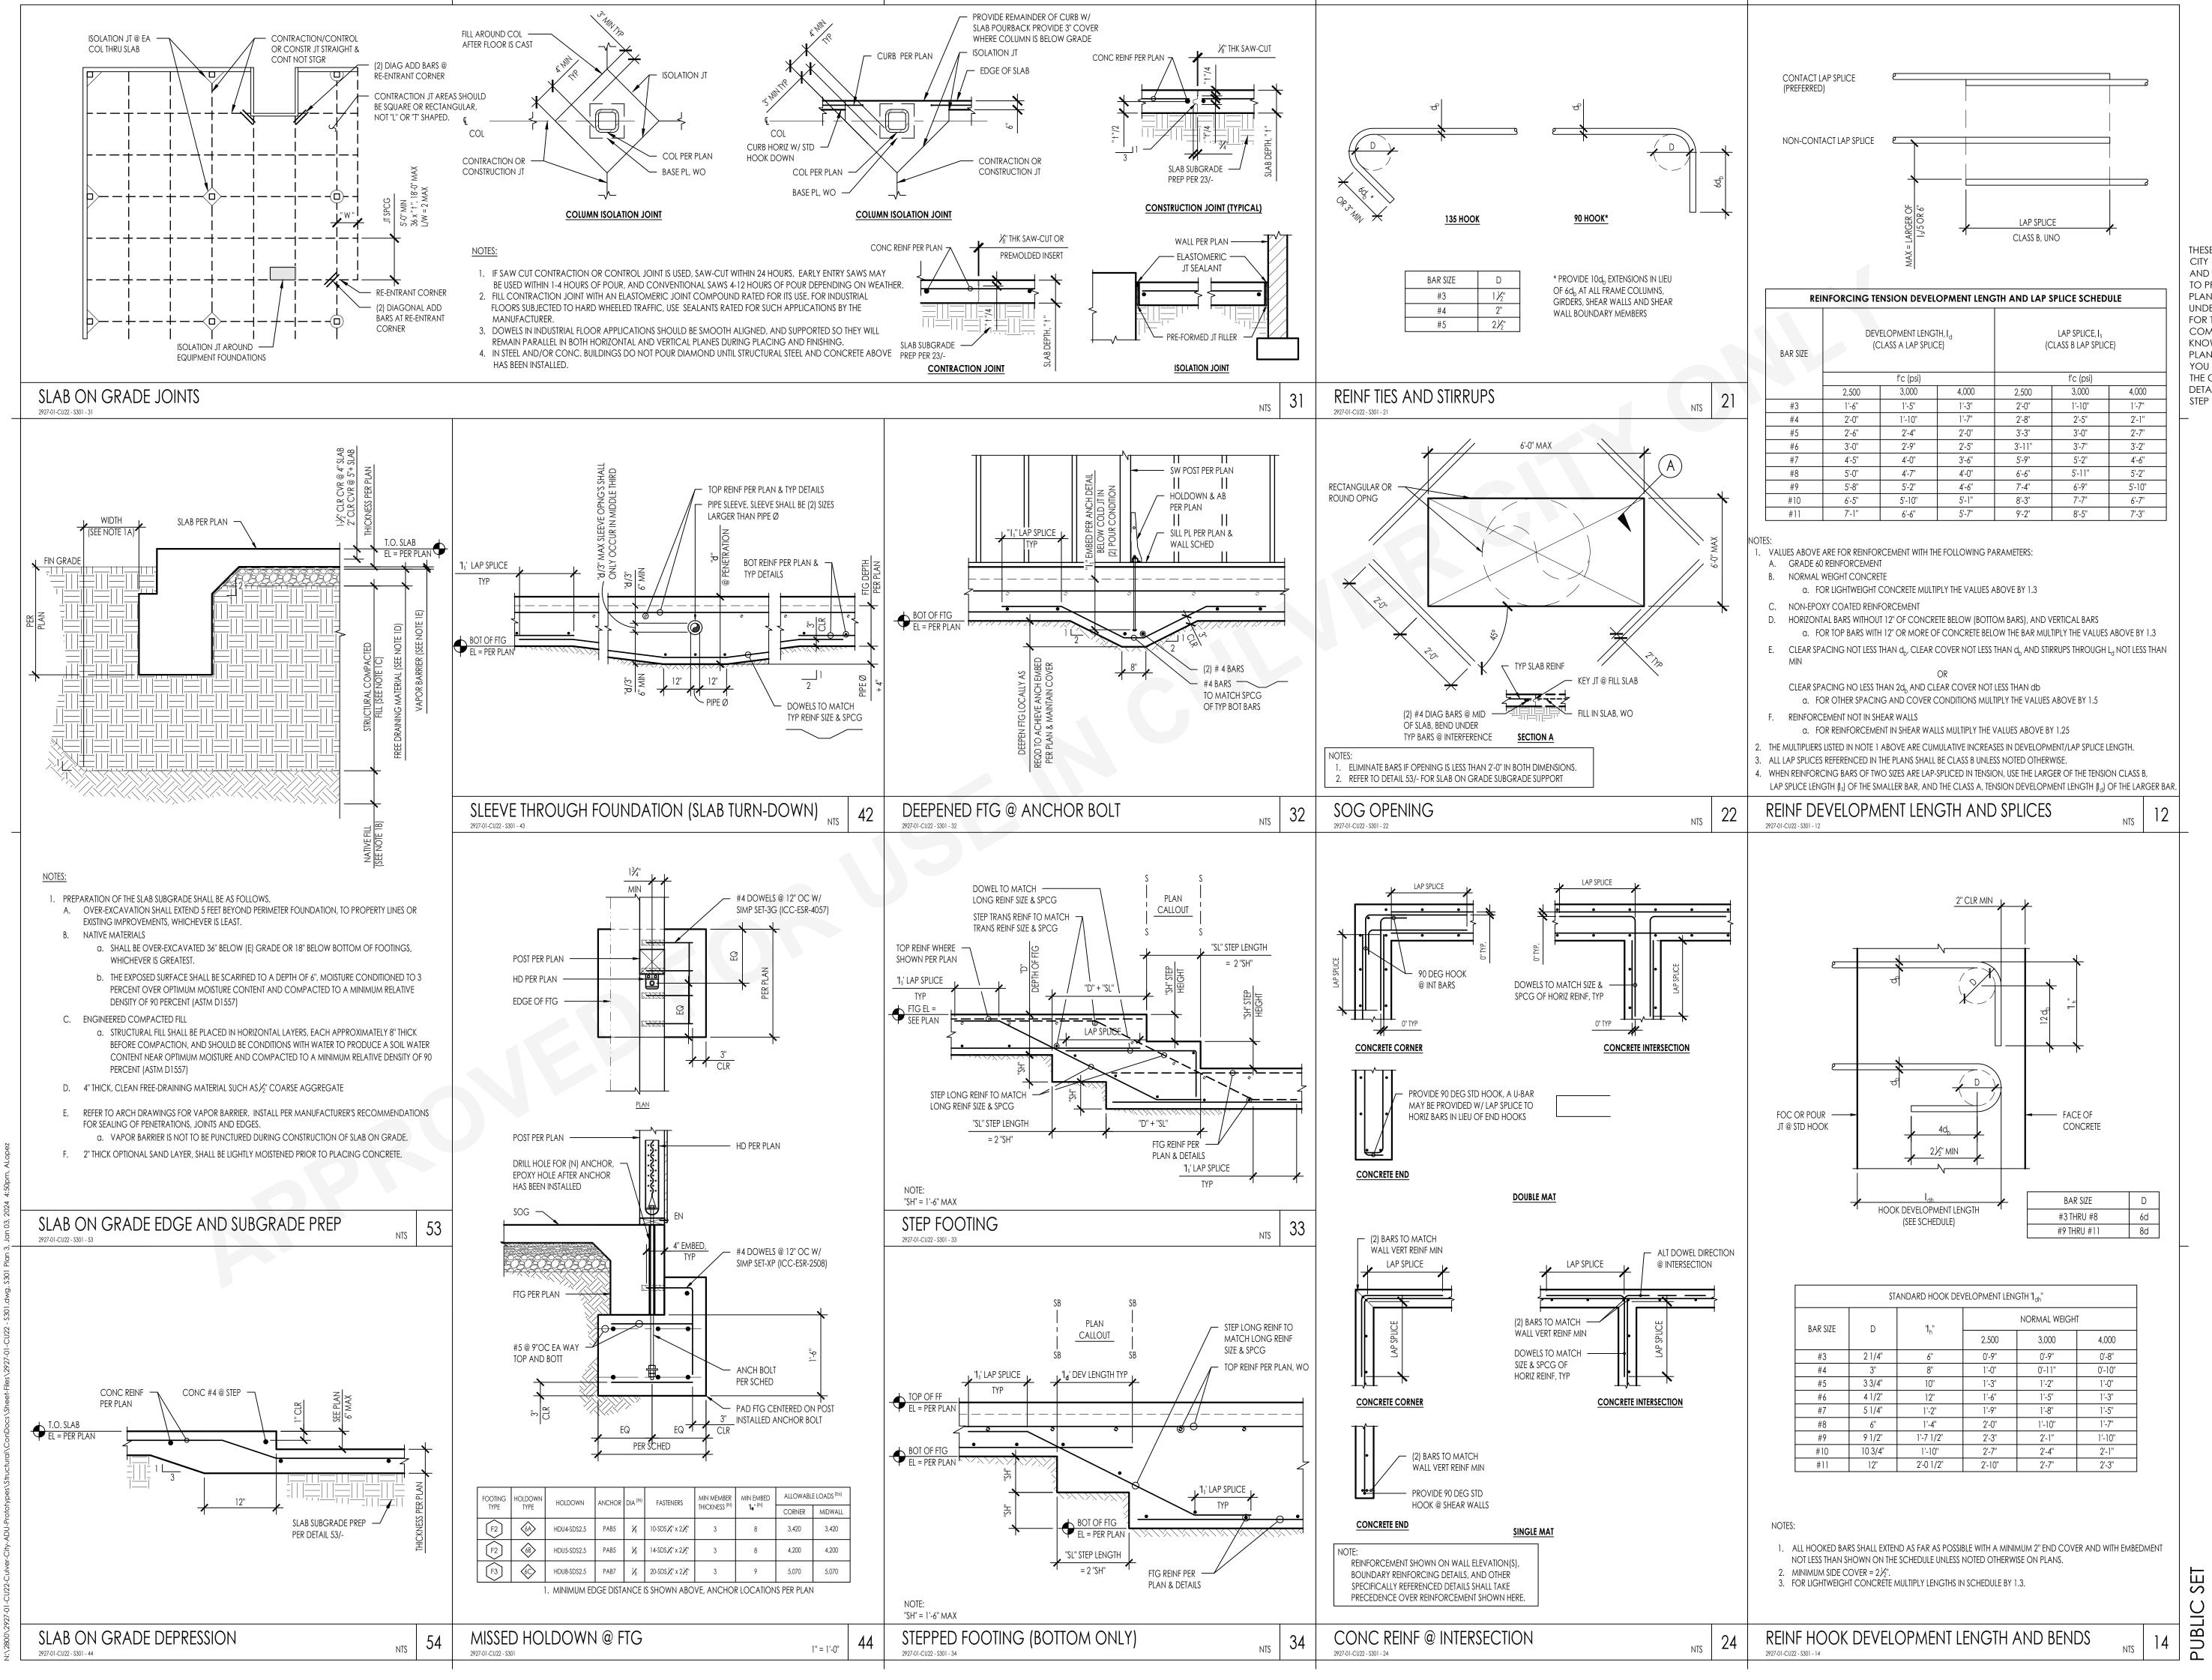

THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

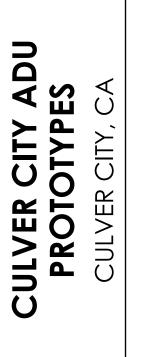

U


DATE

SHEET

01/03/2024


S-301

AILS DET, RETE ONC \bigcirc AL 'YPIC

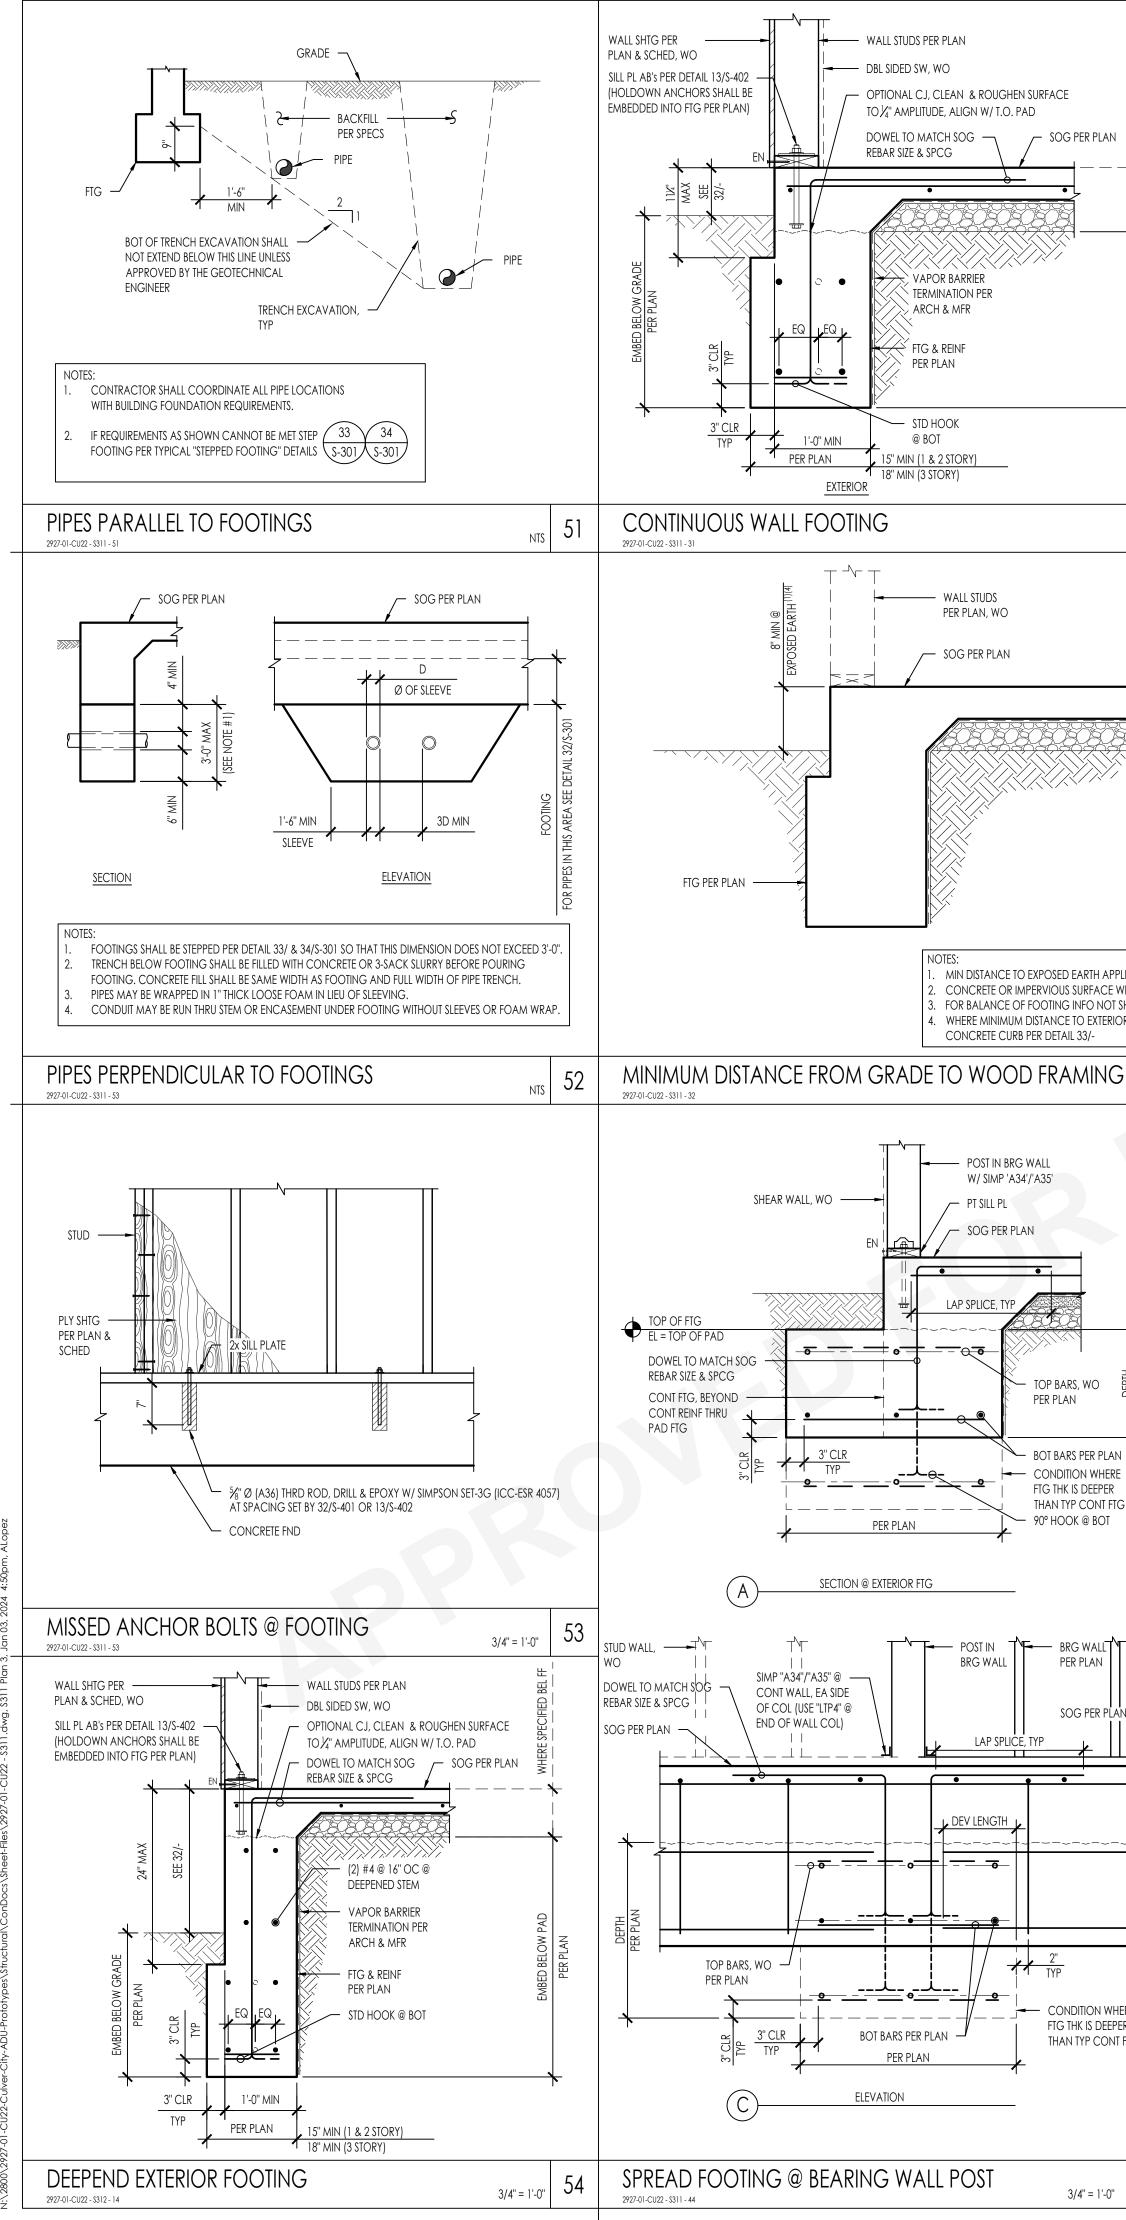


— PT SILL PL

BRG WALL

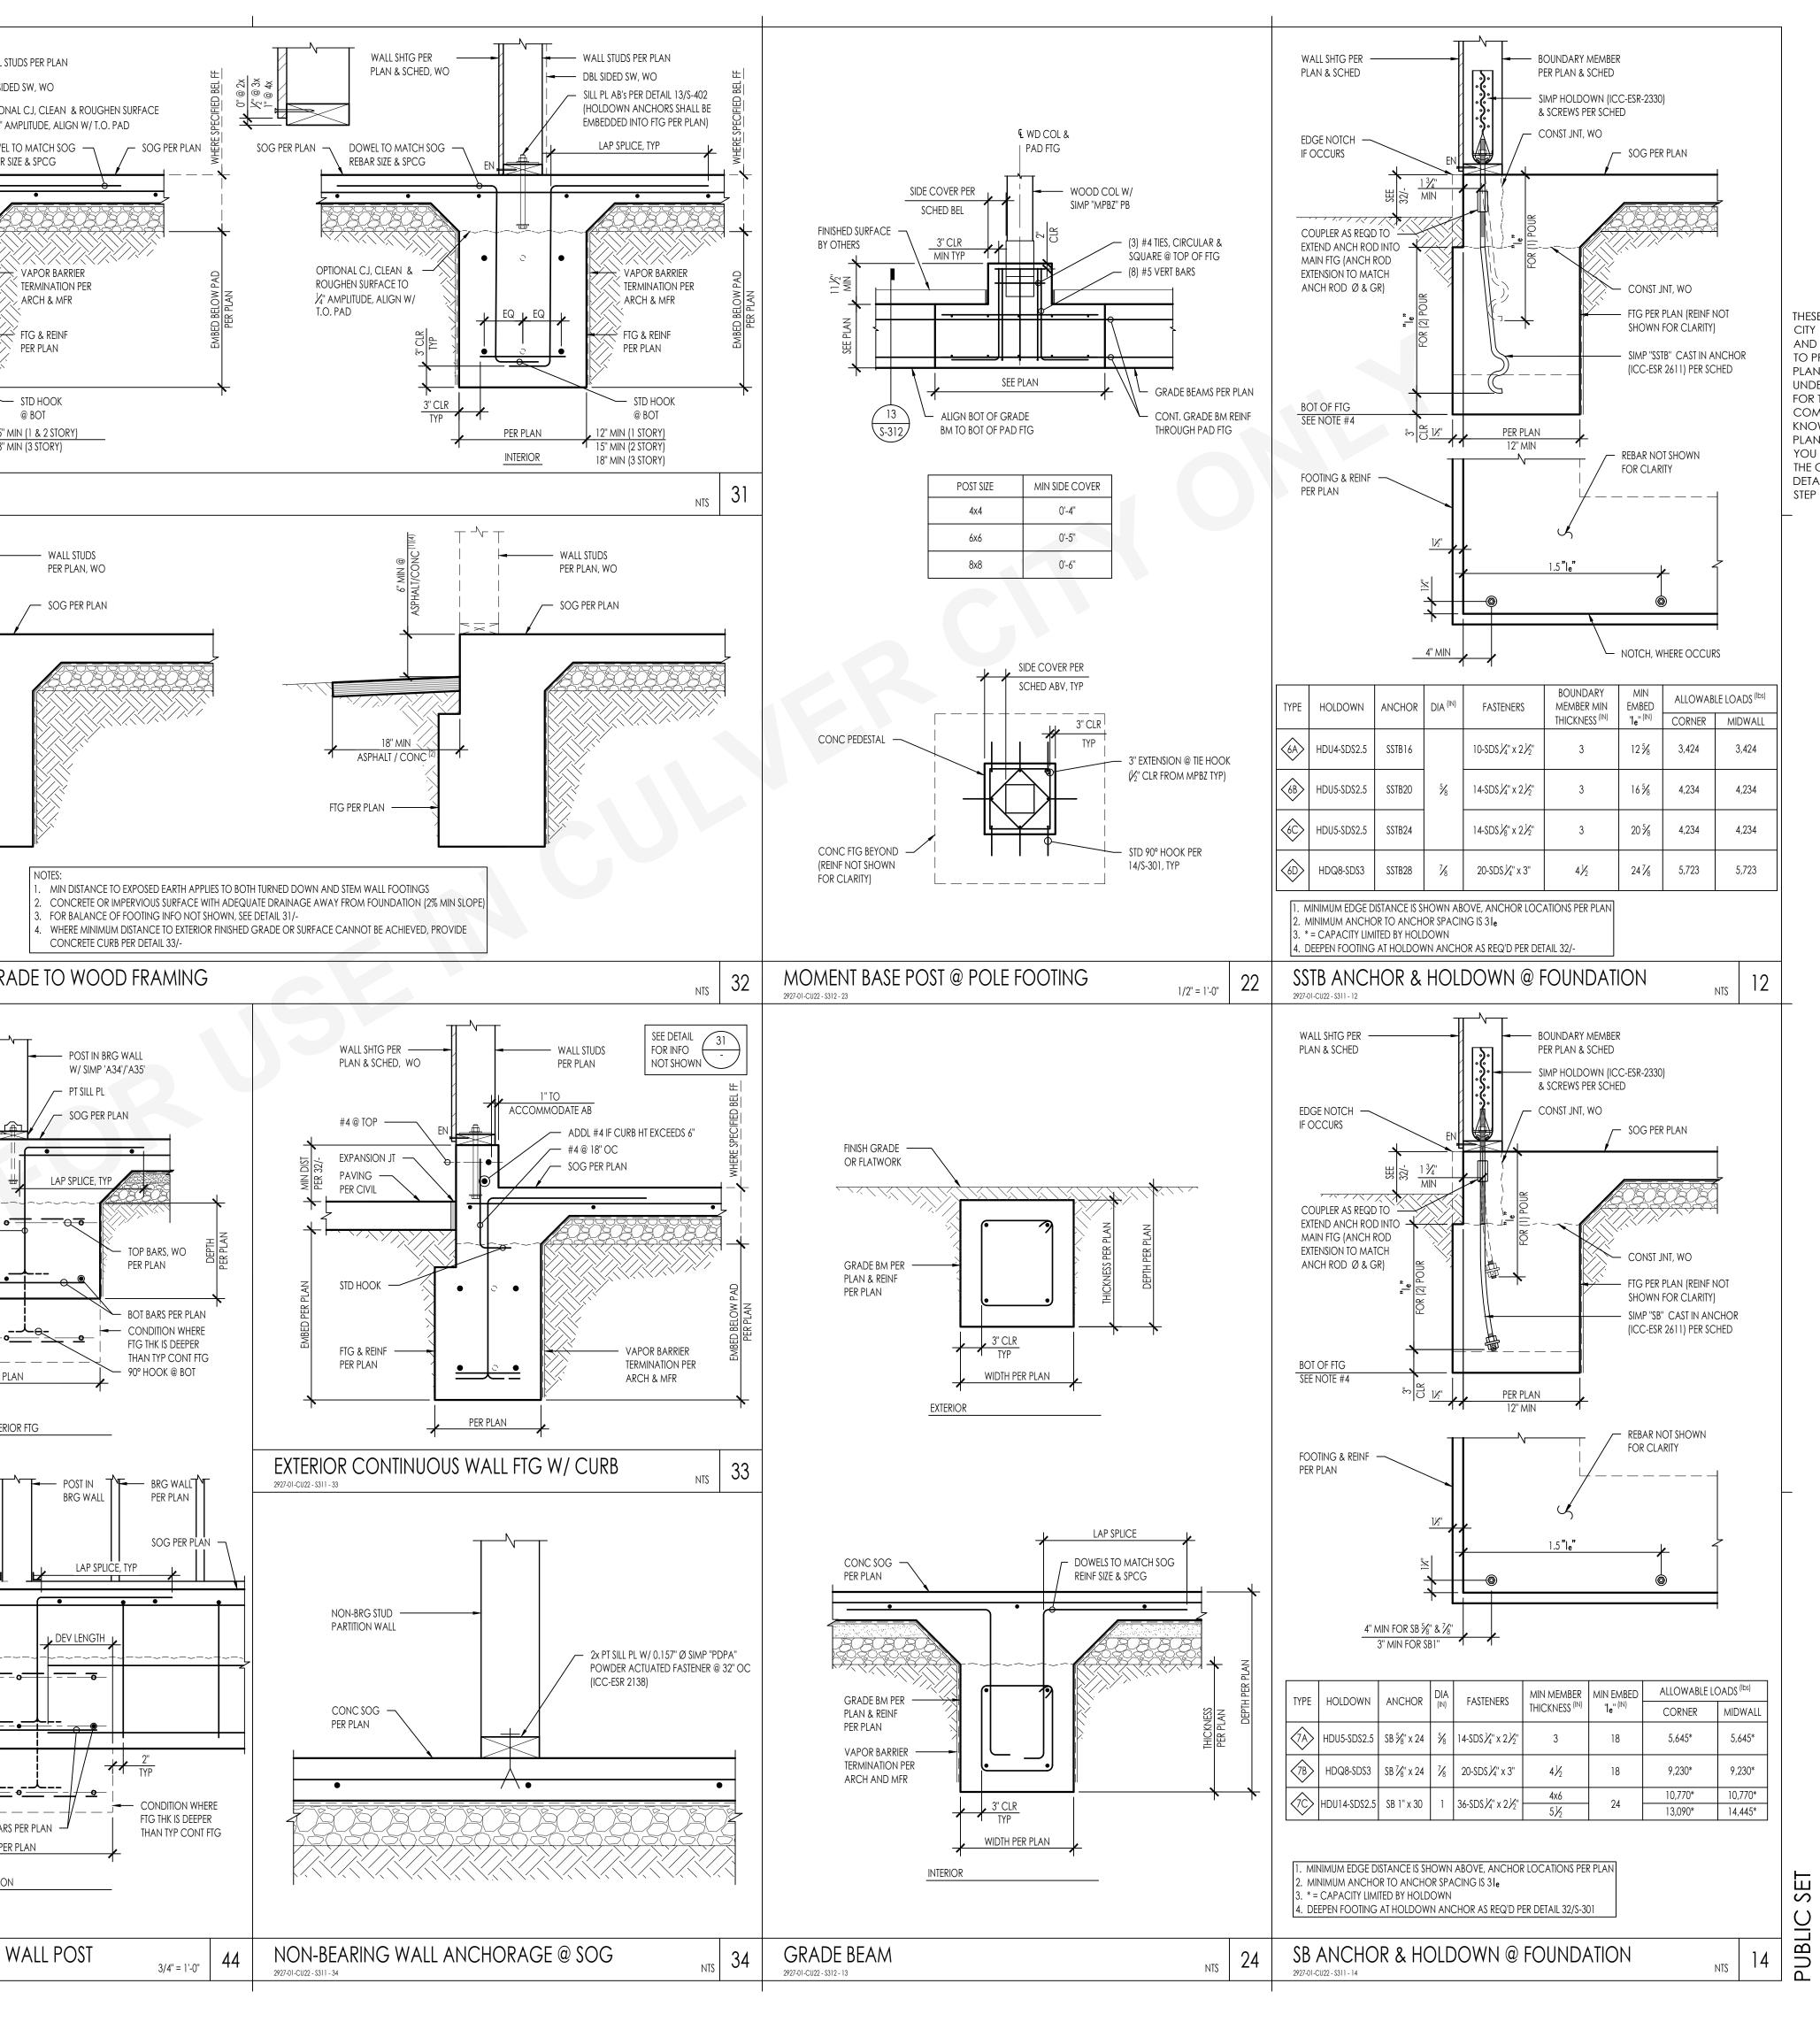



THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

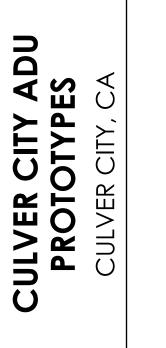



AILS DET CONCRETE

DATE


01/03/2024 SHEET

S-311

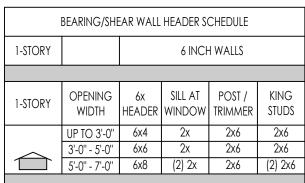

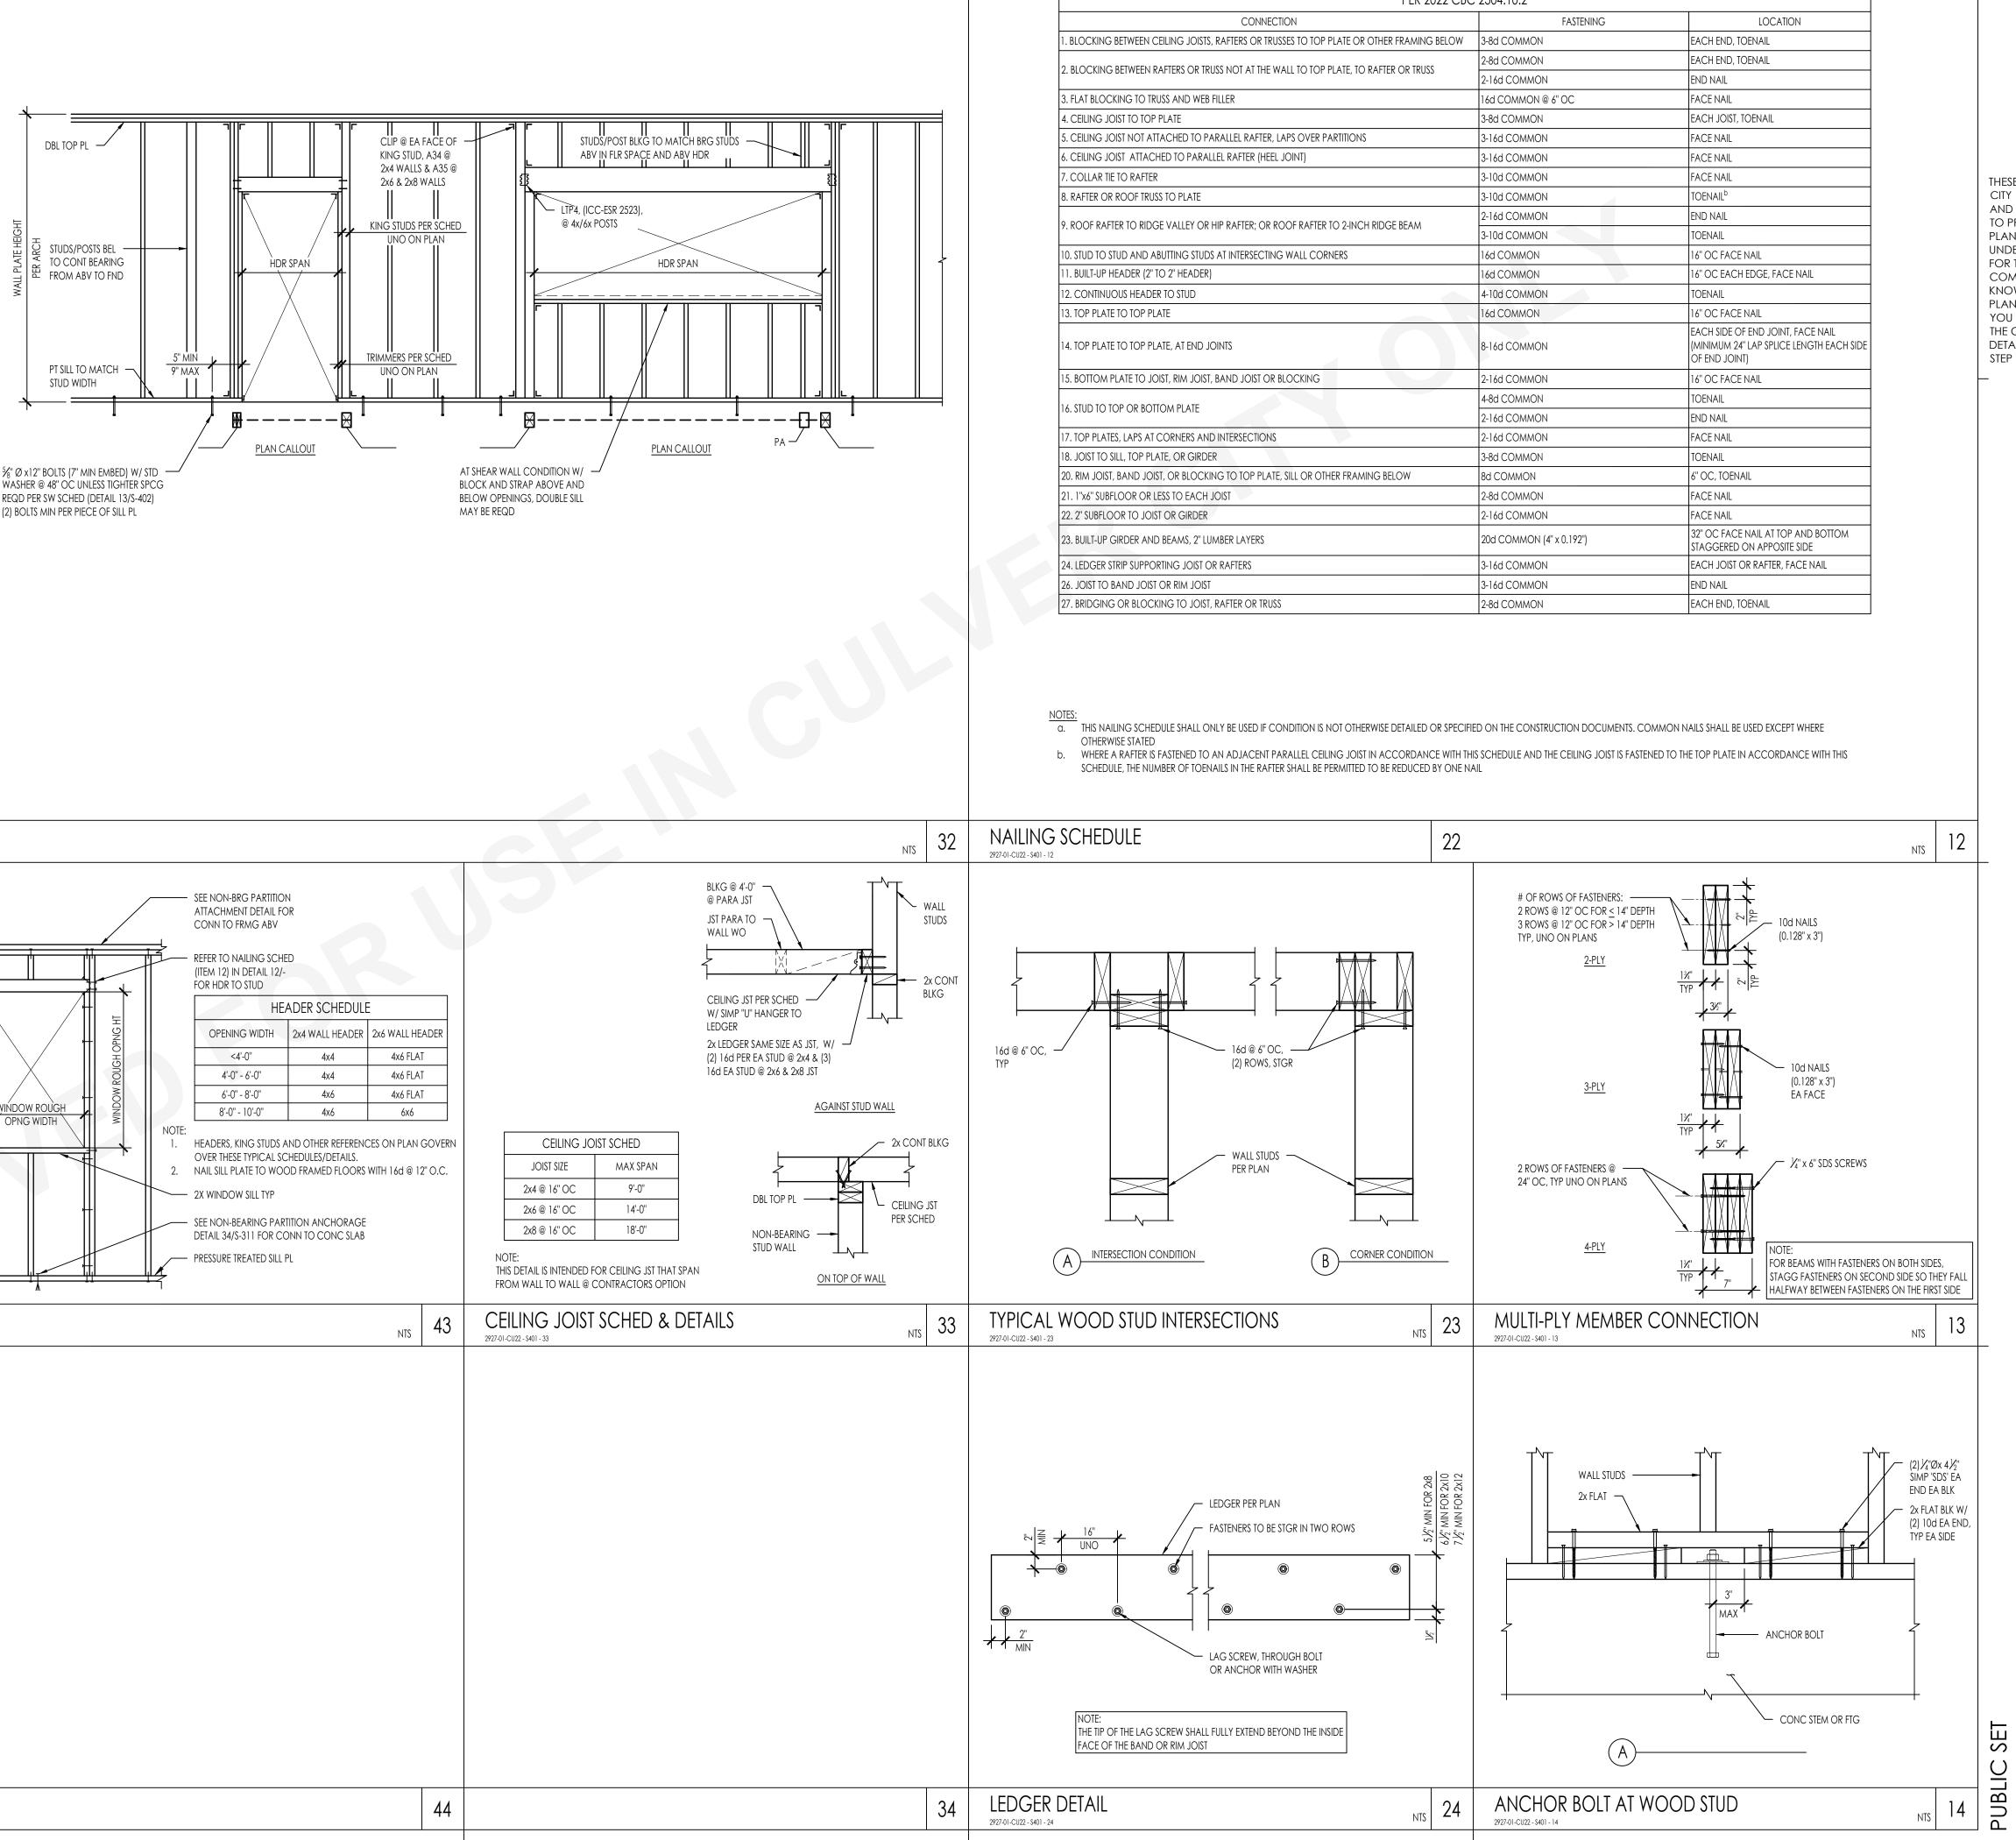

A. FOR SHEAR WALLS SEE 34/S-402 FOR ADD'L REQUIREMENTS. B. FOR INTERIOR NON-BEARING PARTITIONS SEE DETAIL 43/-

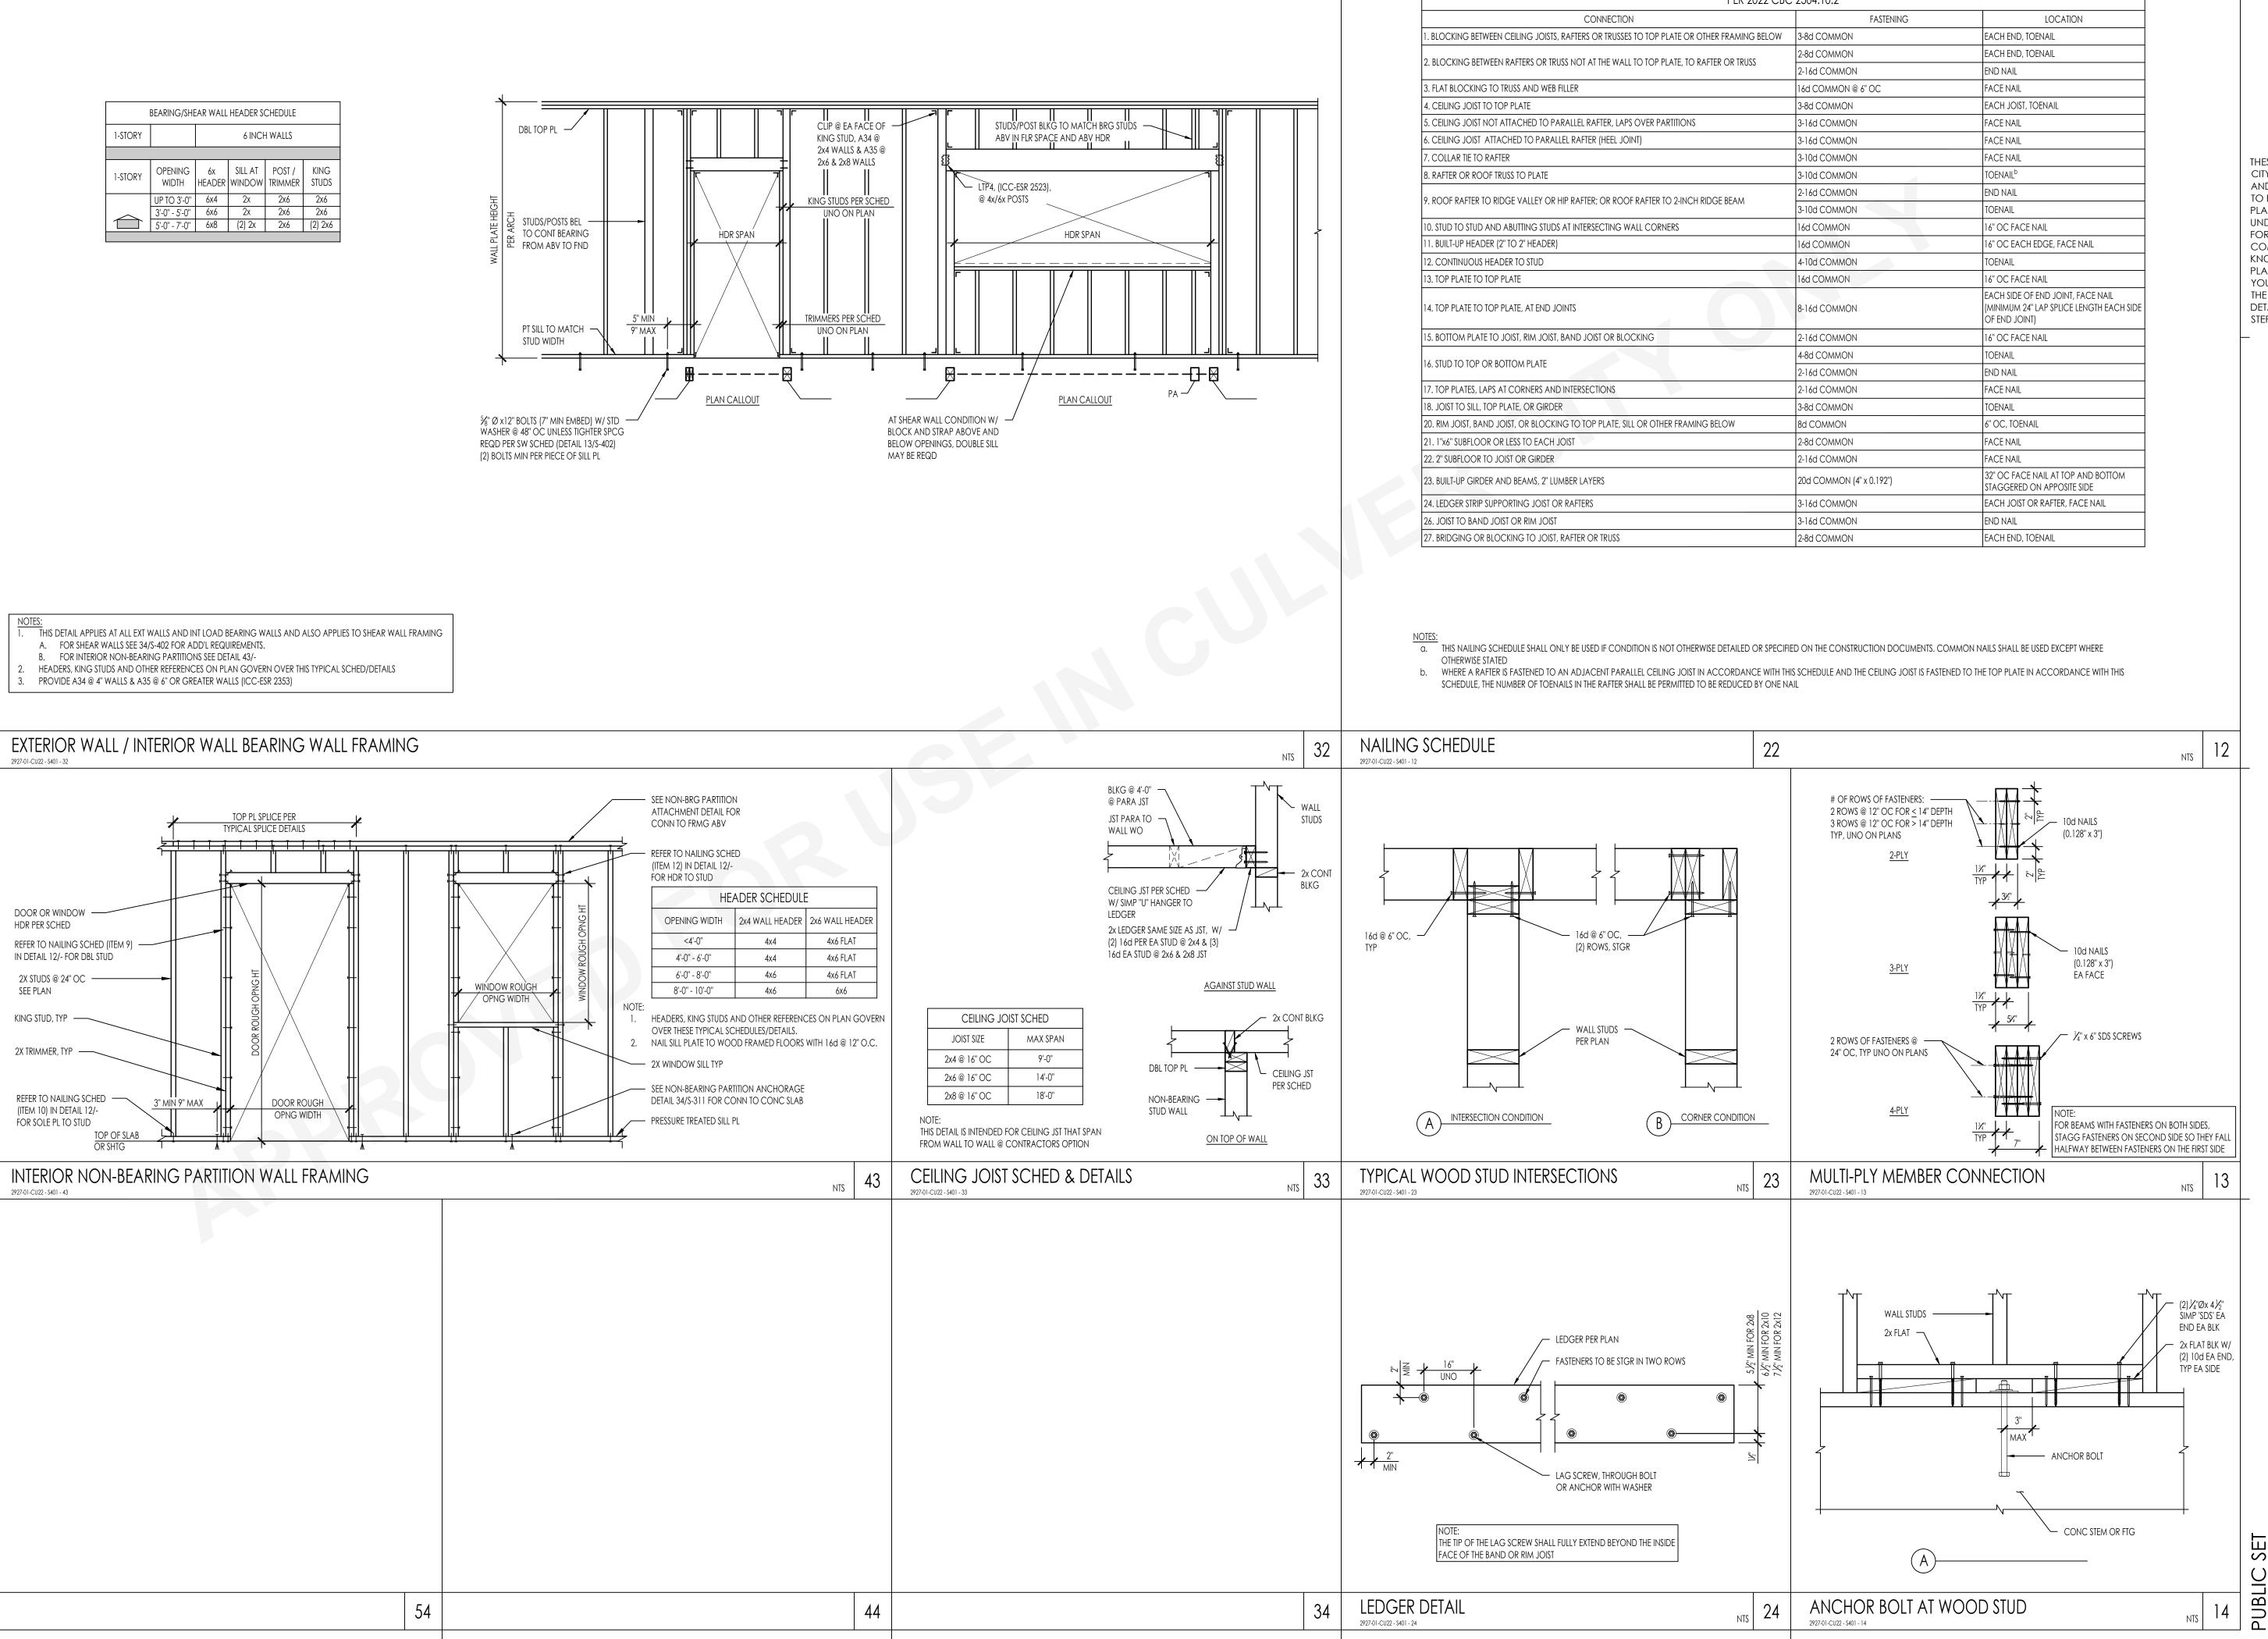



| FASTENING SCHEDULE | | |
|------------------------|--|--|
| PER 2022 CBC 2304.10.2 | | |

| | FASTENING | LOCATION |
|-------------------|--------------------------|--|
| IER FRAMING BELOW | 3-8d COMMON | EACH END, TOENAIL |
| TER OR TRUSS | 2-8d COMMON | EACH END, TOENAIL |
| | 2-16d COMMON | END NAIL |
| | 16d COMMON @ 6" OC | FACE NAIL |
| | 3-8d COMMON | EACH JOIST, TOENAIL |
| | 3-16d COMMON | FACE NAIL |
| | 3-16d COMMON | FACE NAIL |
| | 3-10d COMMON | FACE NAIL |
| | 3-10d COMMON | TOENAIL ^b |
| DGE BEAM | 2-16d COMMON | END NAIL |
| | 3-10d COMMON | TOENAIL |
| | 16d COMMON | 16" OC FACE NAIL |
| | 16d COMMON | 16" OC EACH EDGE, FACE NAIL |
| | 4-10d COMMON | TOENAIL |
| | 16d COMMON | 16" OC FACE NAIL |
| | 8-16d COMMON | EACH SIDE OF END JOINT, FACE NAIL (MINIMUM 24" LAP SPLICE LENGTH EACH SIDE OF END JOINT) |
| | 2-16d COMMON | 16" OC FACE NAIL |
| | 4-8d COMMON | TOENAIL |
| | 2-16d COMMON | END NAIL |
| | 2-16d COMMON | FACE NAIL |
| | 3-8d COMMON | TOENAIL |
| BELOW | 8d COMMON | 6" OC, TOENAIL |
| | 2-8d COMMON | FACE NAIL |
| | 2-16d COMMON | FACE NAIL |
| | 20d COMMON (4" x 0.192") | 32" OC FACE NAIL AT TOP AND BOTTOM STAGGERED ON APPOSITE SIDE |
| | 3-16d COMMON | EACH JOIST OR RAFTER, FACE NAIL |
| | 3-16d COMMON | END NAIL |
| | 2-8d COMMON | EACH END, TOENAIL |



THESE PLANS ARE PROVIDED BY THE CITY OF CULVER CITY AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.




DETAILS TYPICAL WOOD


DATE 01/03/2024


SHEET


S-401

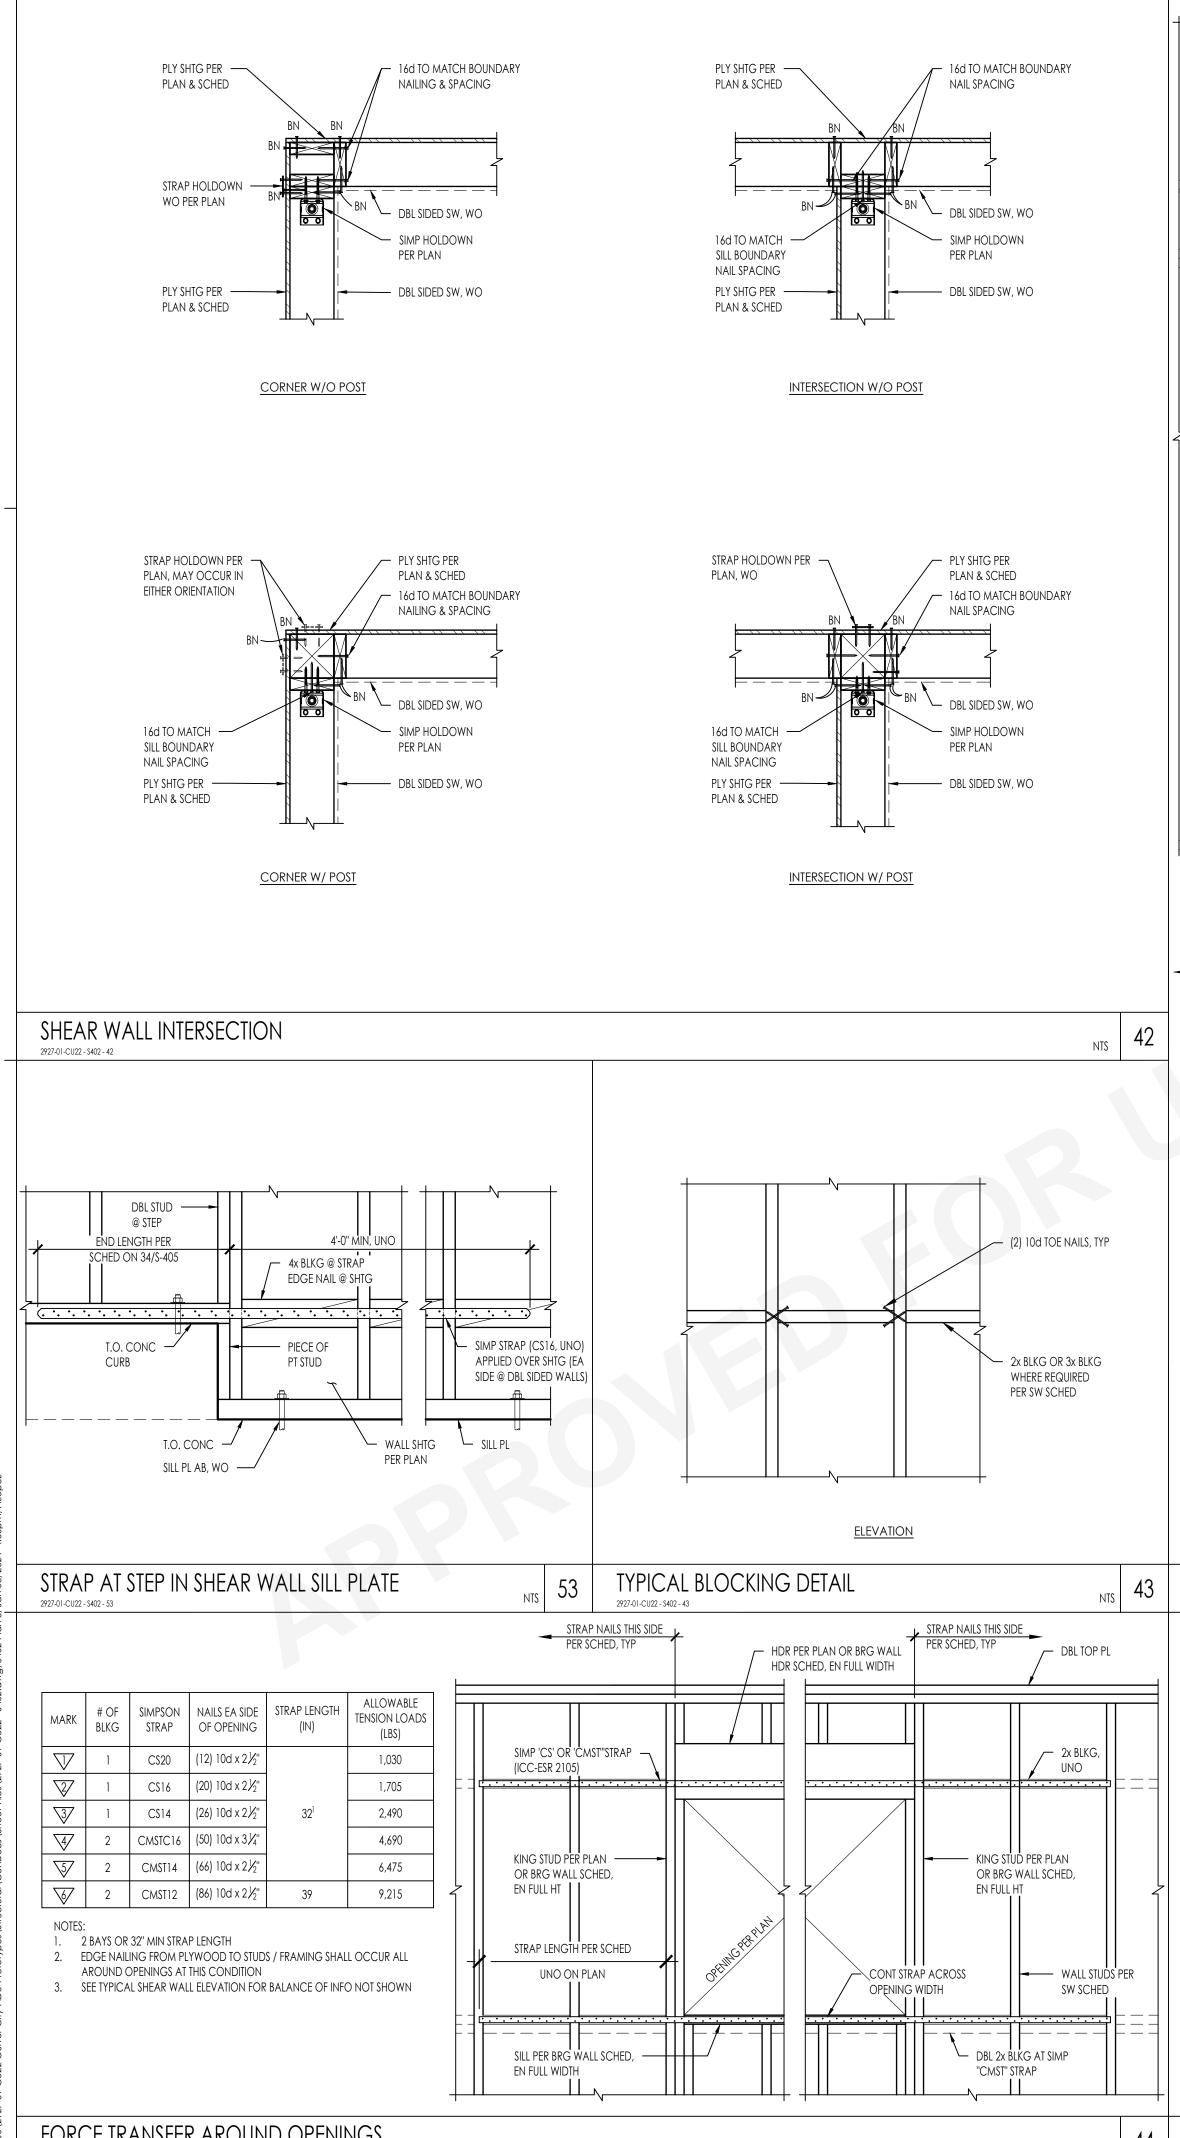



FORCE TRANSFER AROUND OPENINGS 2927-01-CU22 - S402 - 44

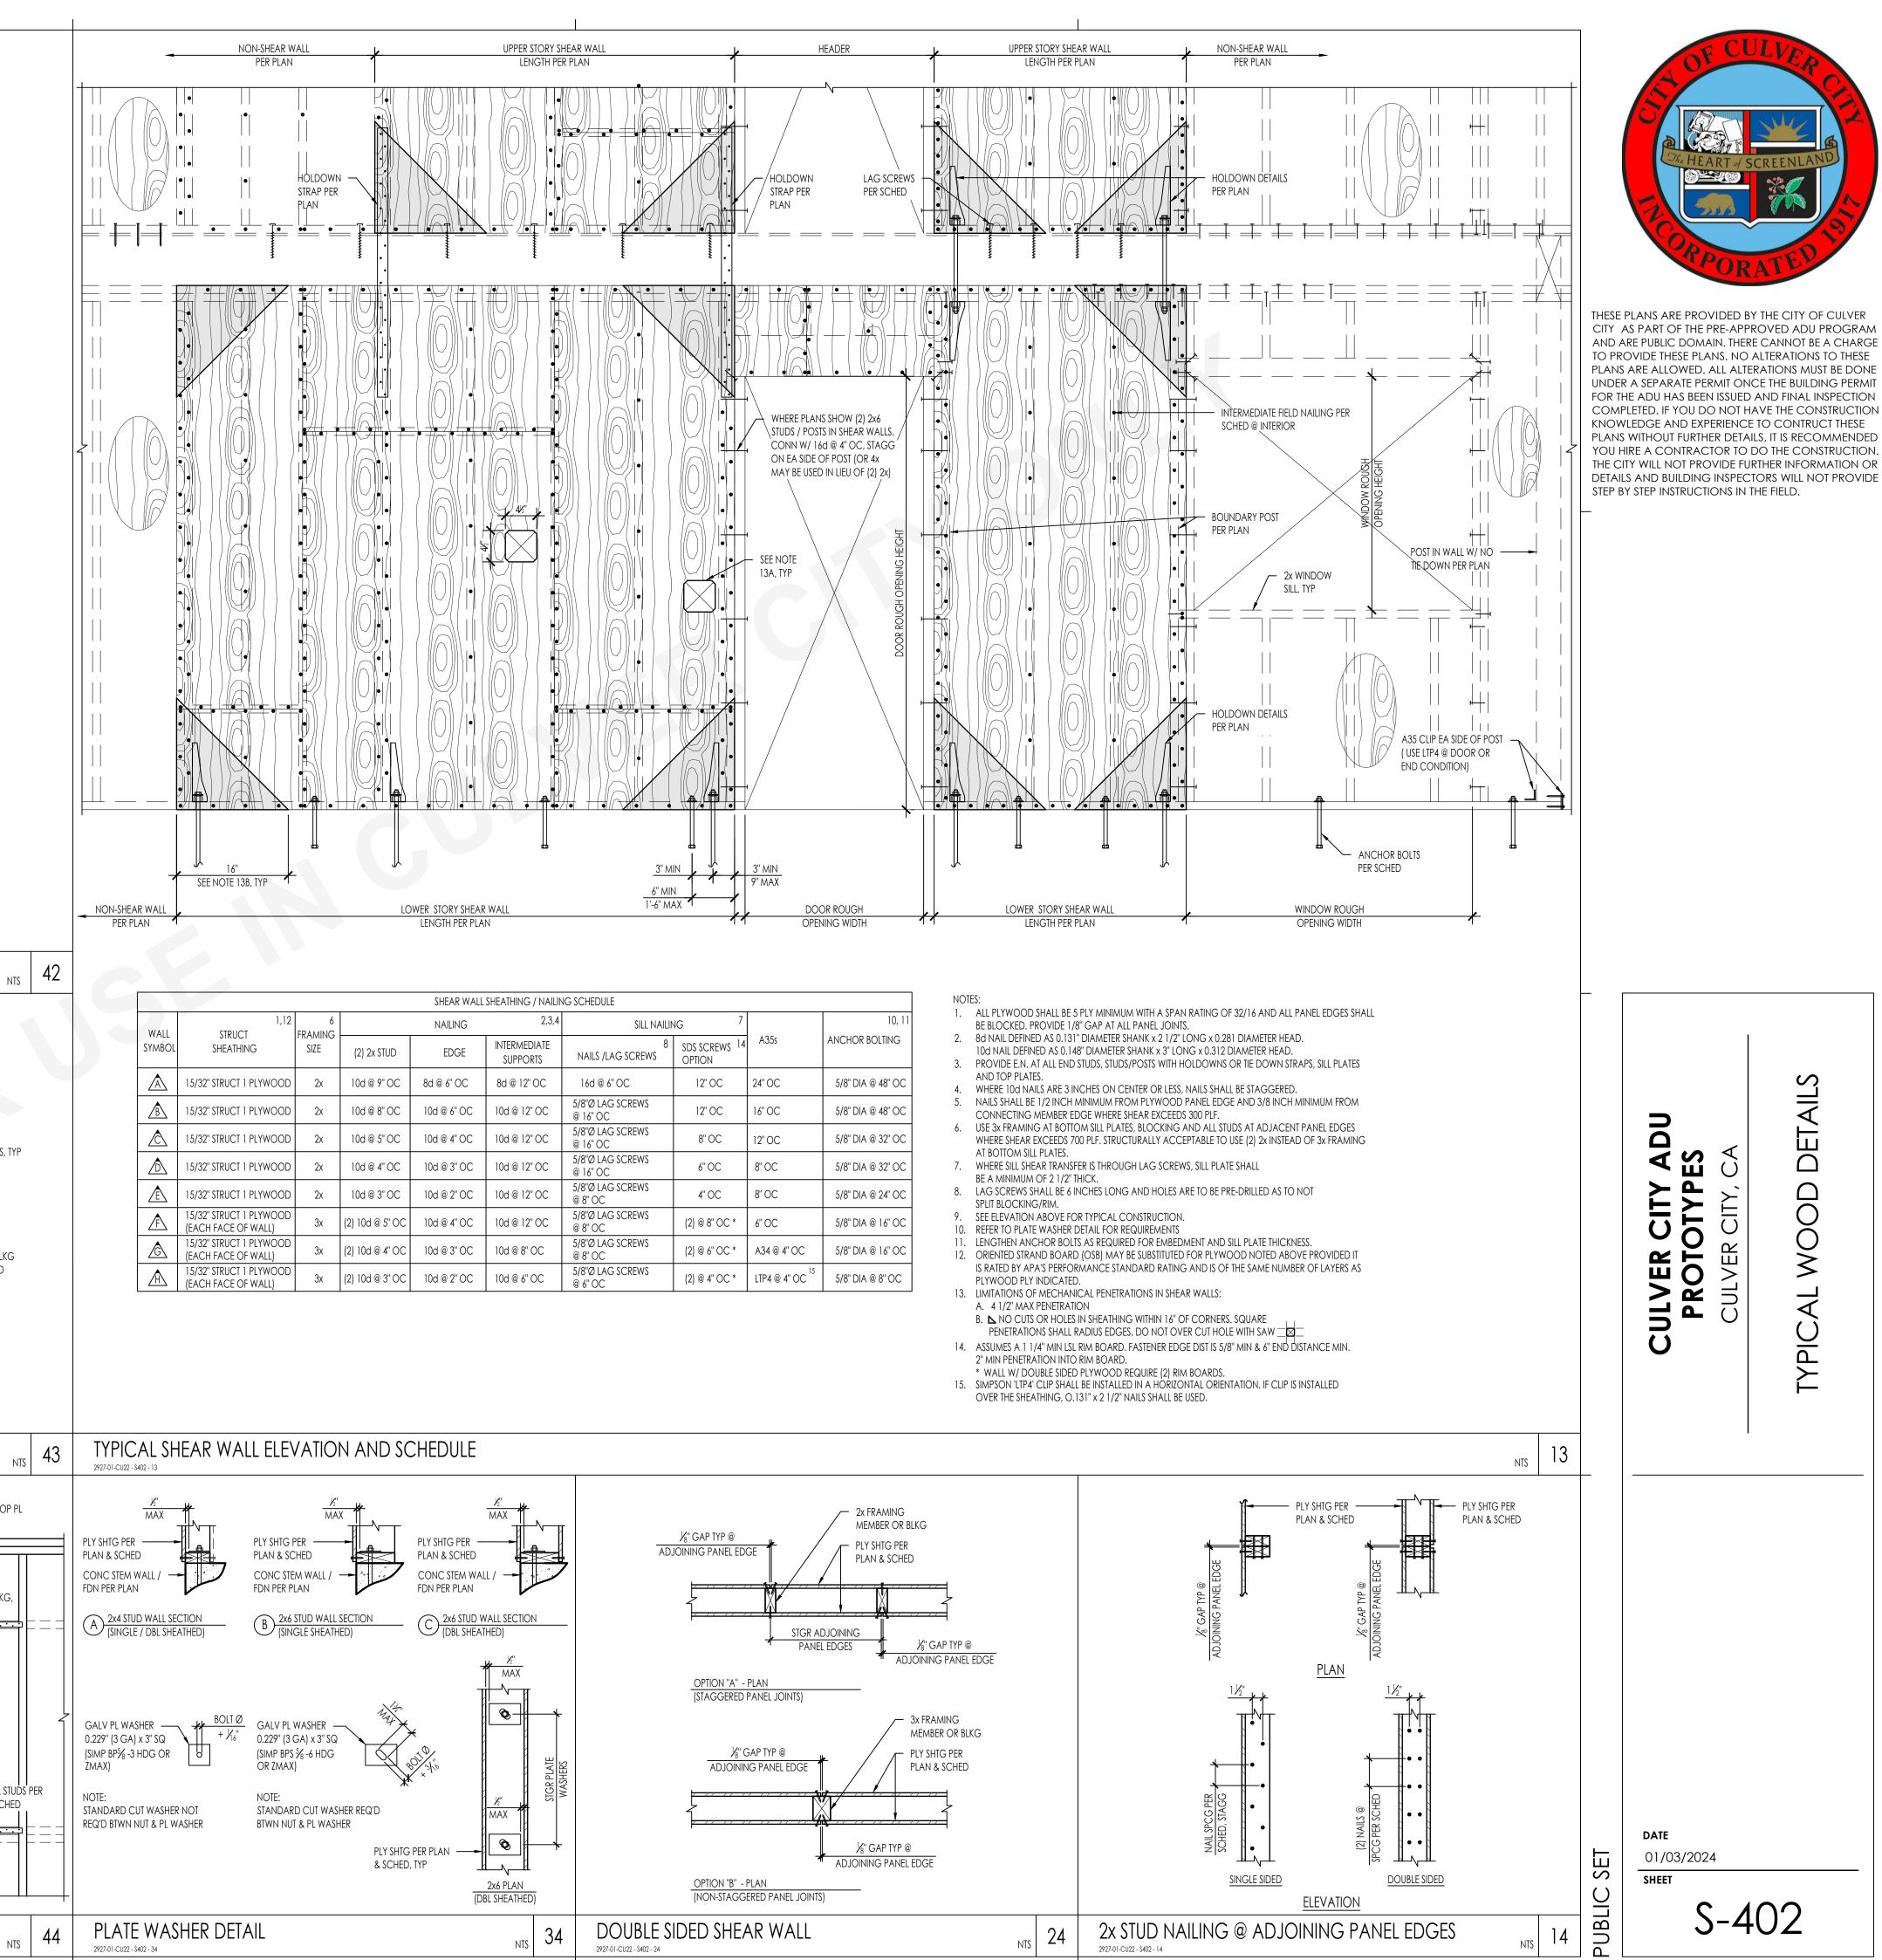


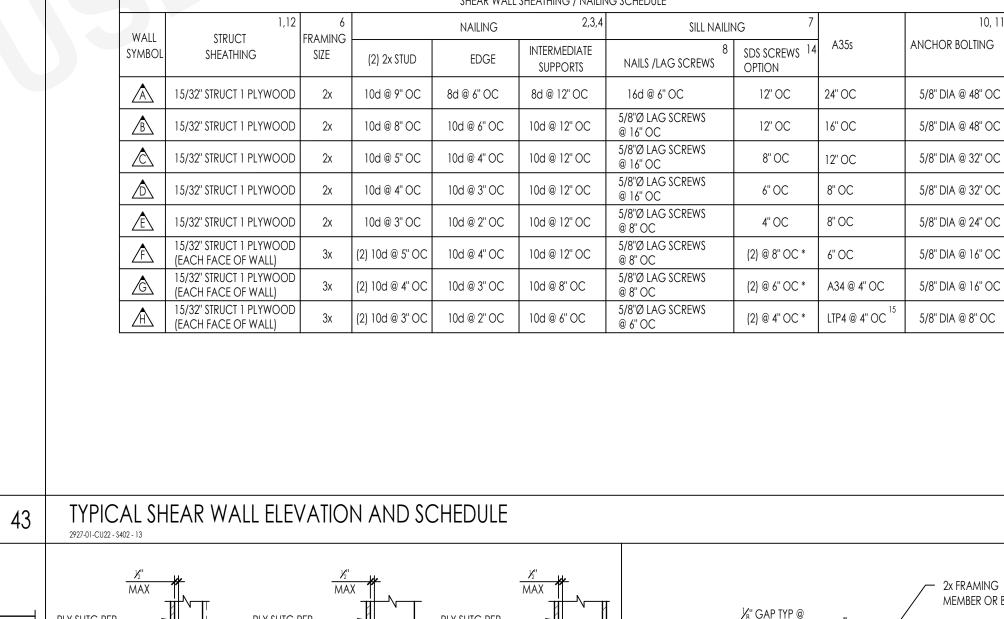

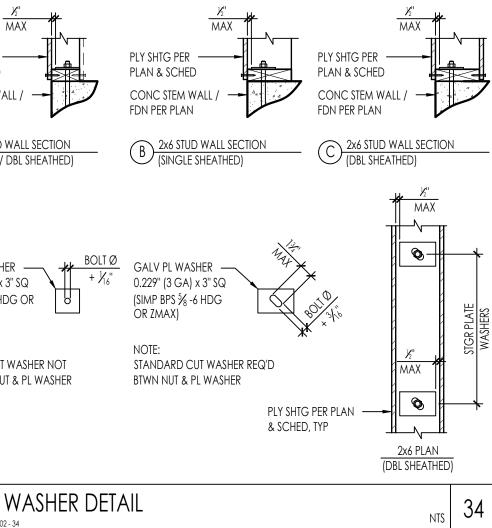

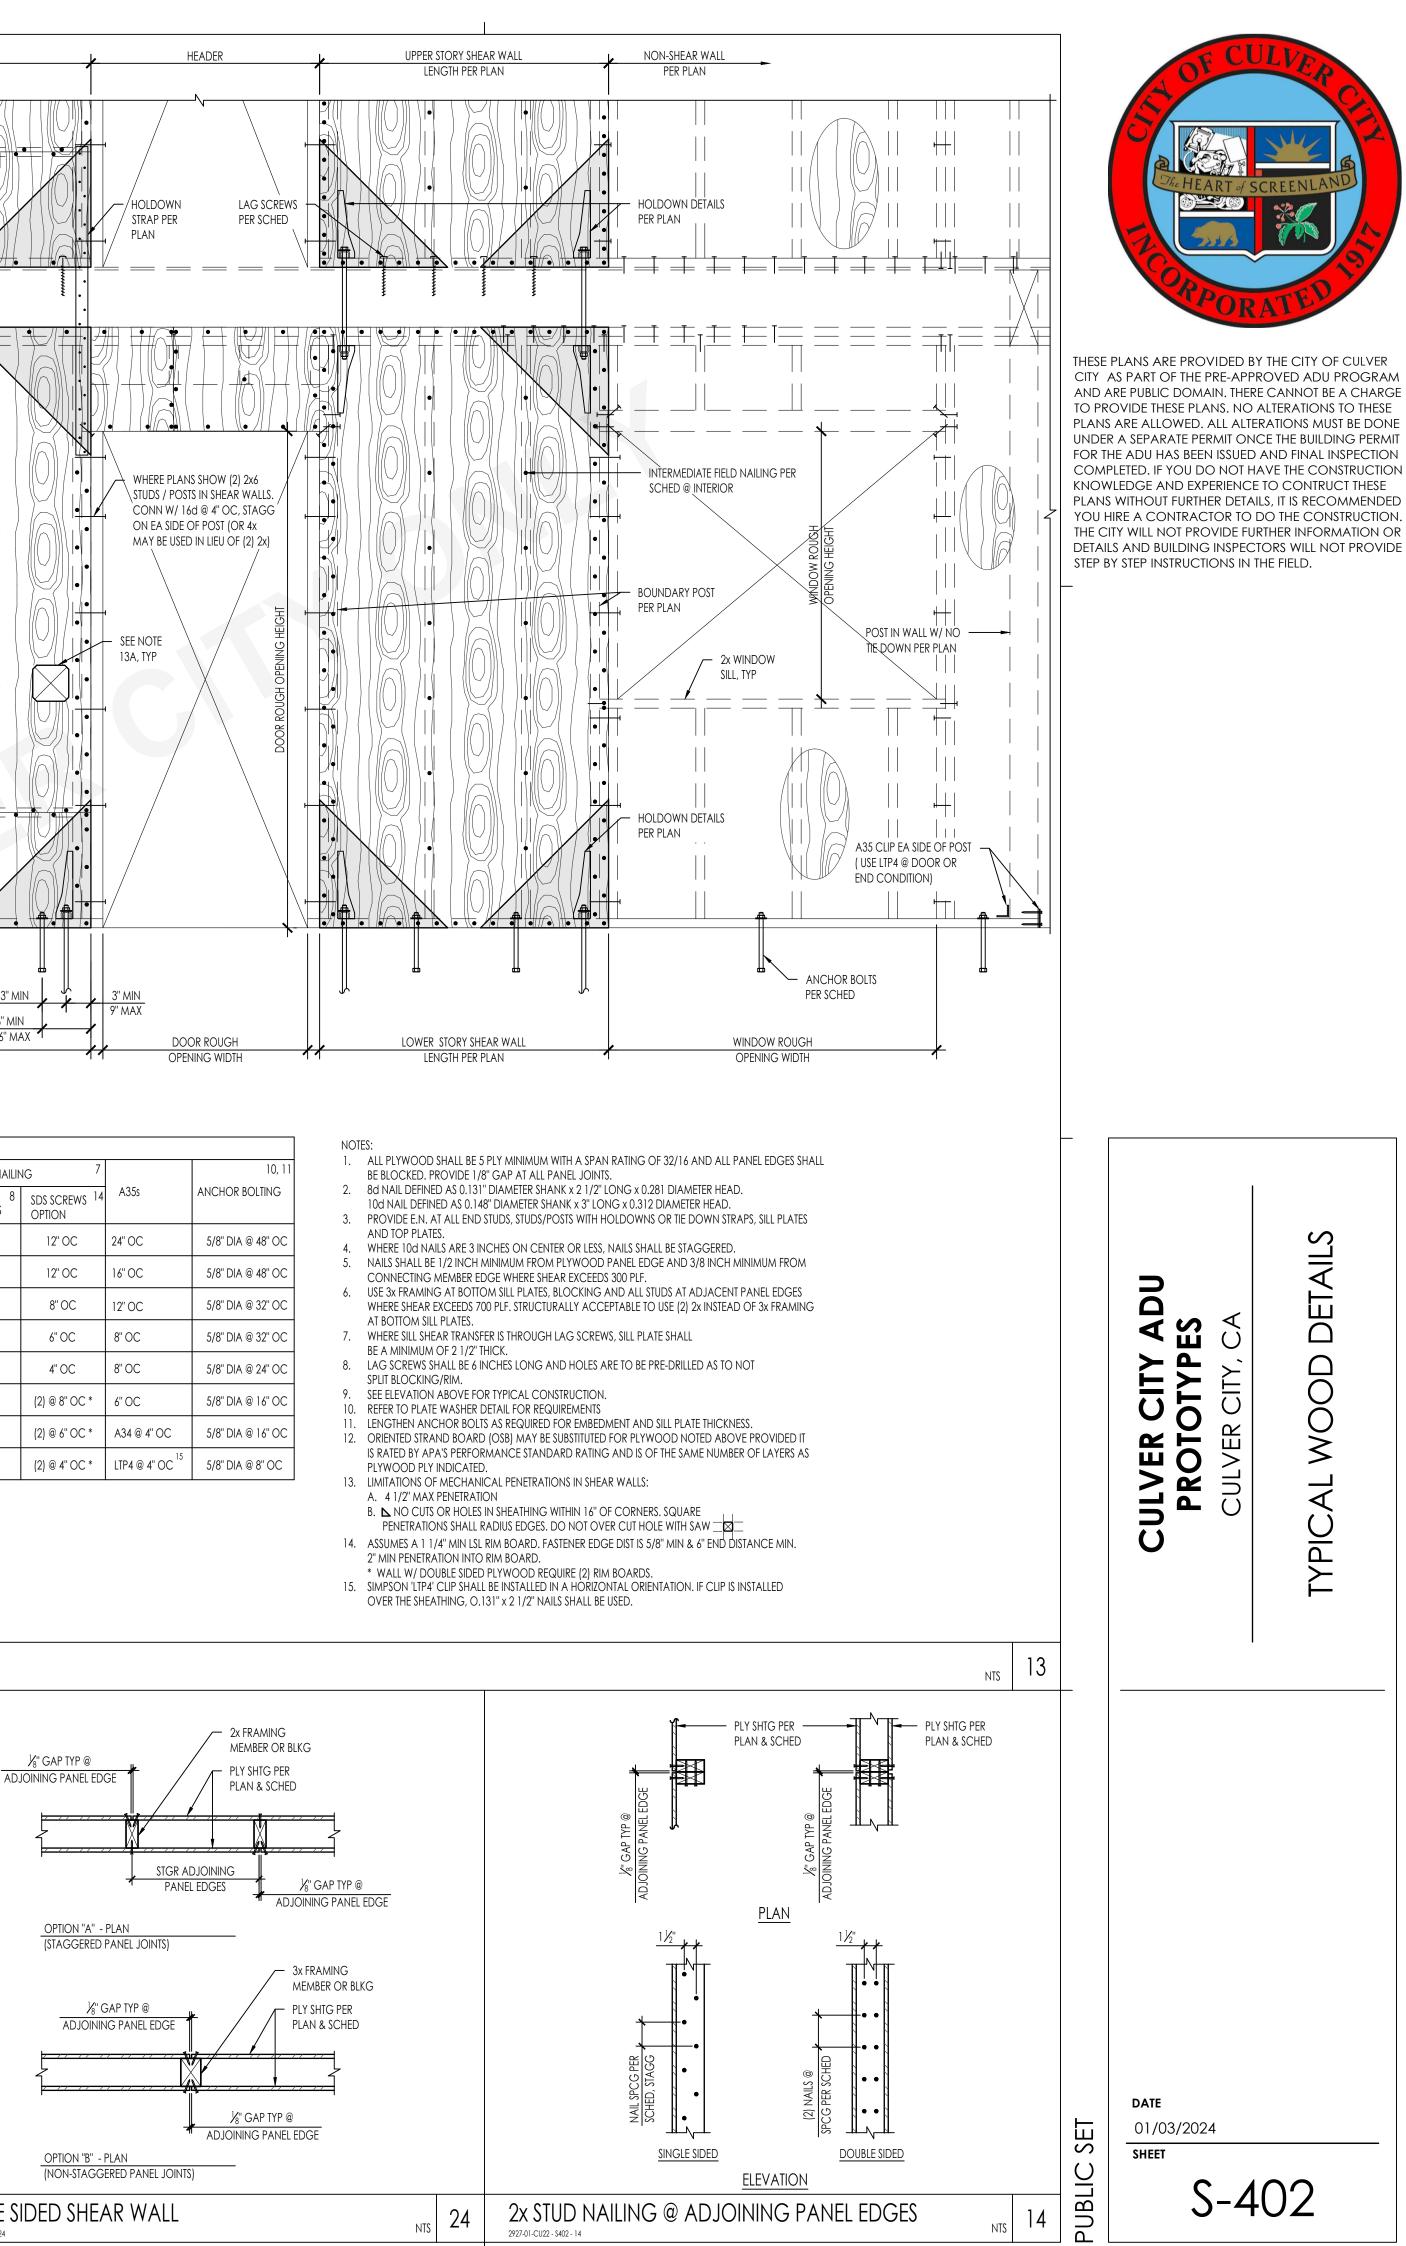

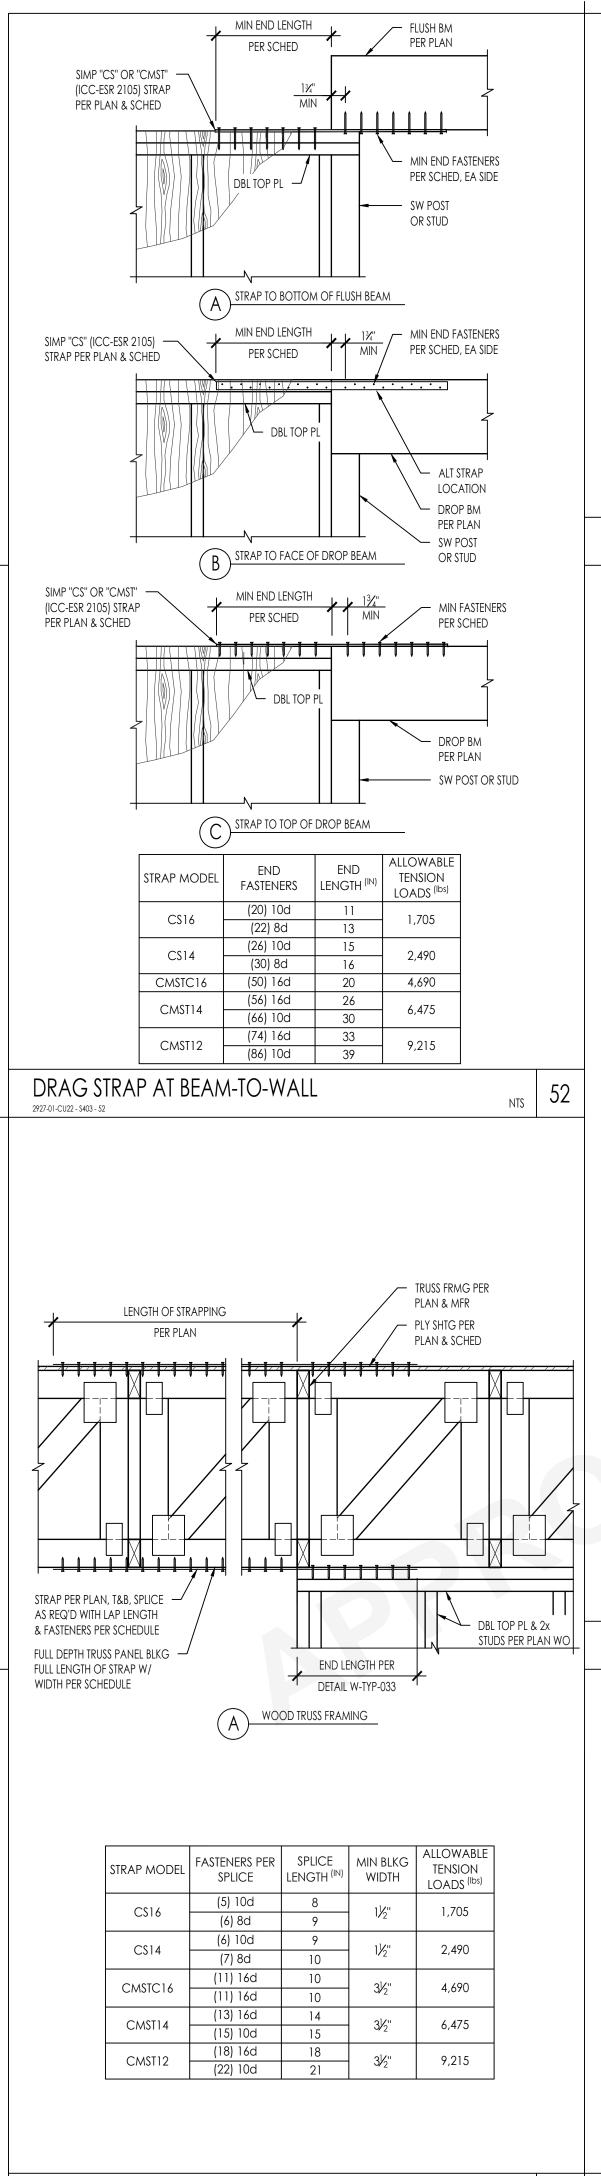

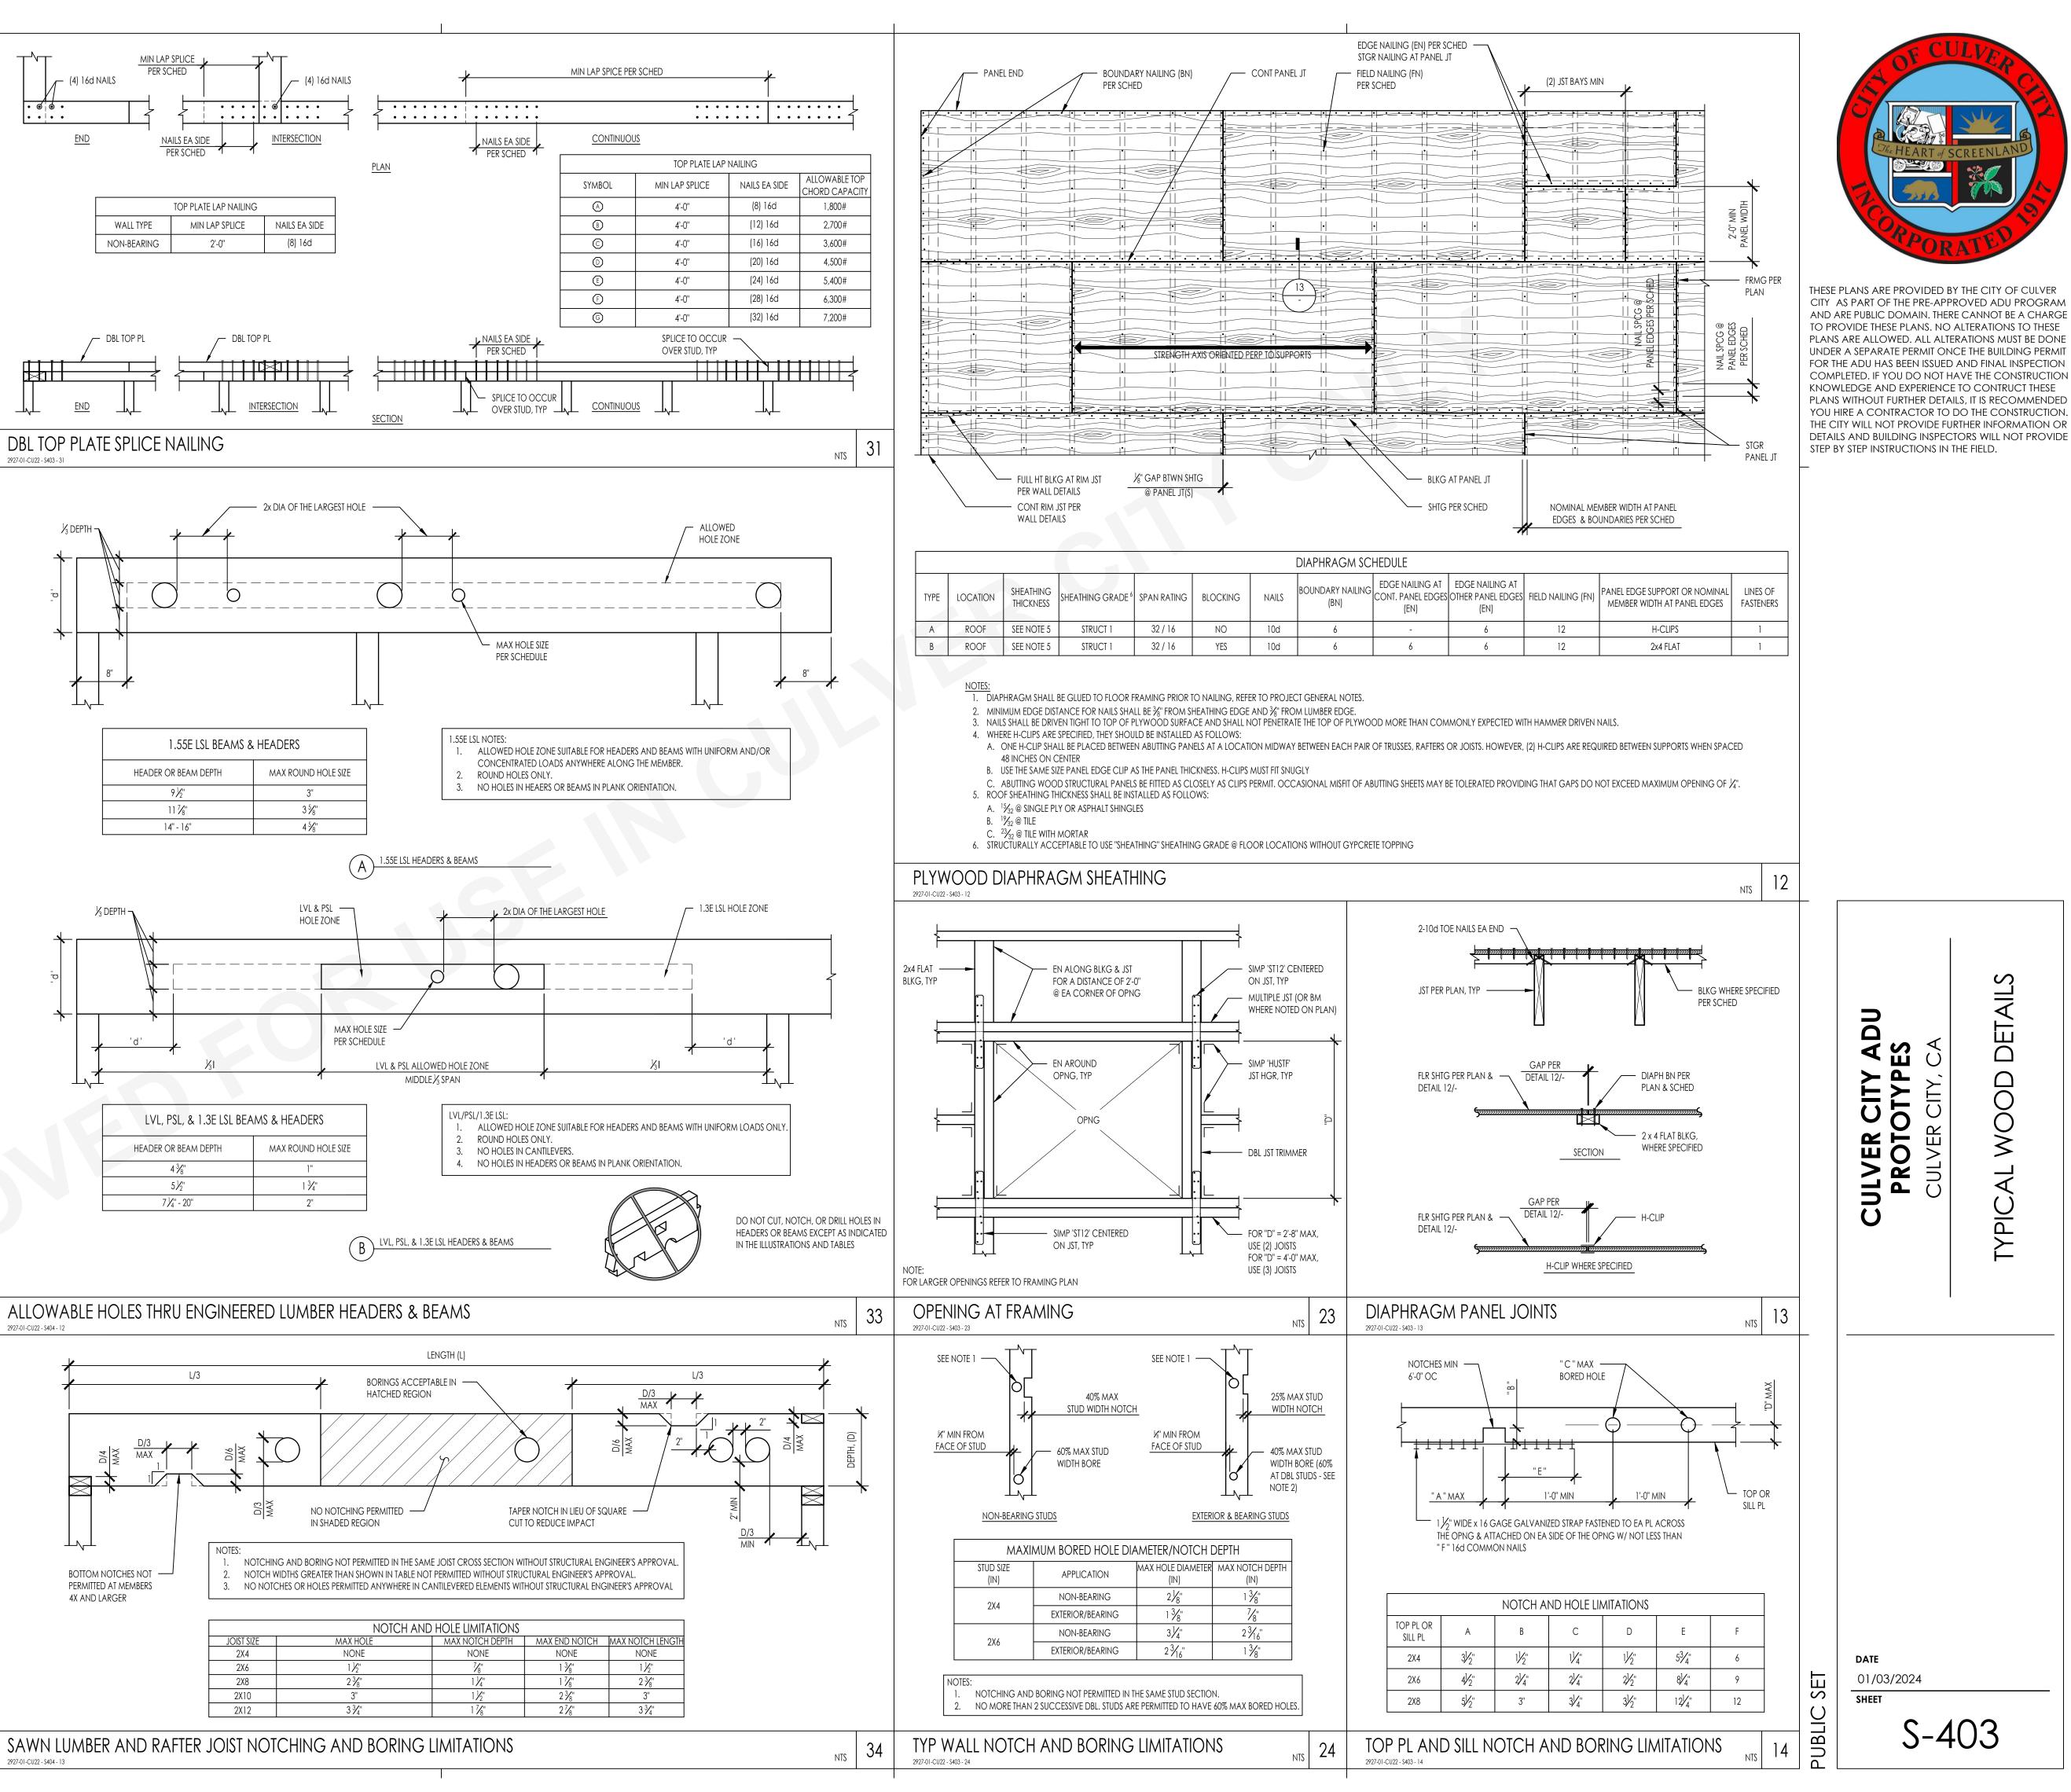

BLOCK & STRAP PERP TO FRMG

2927-01-CU22 - \$403 - 54

NTS 54

THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR

